

Techno-Economic Studies of Integration of Solar PV Technology in Telecommunications Sector for Sustainable Development: A Case Study of Budiriro

ABSTRACT

The telecommunications industry in Zimbabwe keeps growing with an increase in the number of users yearly. The demand on the national grid and low power supply means long hours of electricity outages, which prompts Internet Service Providers (ISP's) to use generators as backup power to keep base stations online for uninterrupted provision of internet to consumers. Generator systems increase operation expenditure (OPEX) of running base stations, produces GHG emissions and intern attract additional cost of emission. This causes an increase in cost of running the business and consequently internet data prices. A case study of was conducted in Budiriro. A framework was developed which analysed six combinations (Grid + Generator, Generator only, Generator + Solar, Solar only, Grid + Solar and Grid only) of power sources based on sustainability pillars; Economical, Environmental and Social, as well as Technical. The six alternatives were simulated in HOMER Pro, a system that evaluates designs for both off-grid and grid-connected power systems, to determine the output (power output, investments, costs and emissions) of these individuals systems. Using a sub criterion of 15 pairwise combinations, the Analytic Hierarchy Process (AHP) was used to rank these systems and the best solution chosen based on the main criteria of the sustainability pillars. The result shows that Grid + Solar PV system provide the best optimal alternative power system to power base stations for the study area, substituting Grid + Generator systems (Existing system). It reduces OPEX by over 1,000 percent offering 37 percent more power and 41.13 tonnes of GHG emissions avoided per year. Socially, power sharing between households and base stations as well as reduction of air and noise pollution. The optimal alternative power source for base station proposed here in this study will help reduce greenhouse gas emission, dependence on grid and operation costs which in turn will reduce data prices, increase internet accessibility at affordable rates and provide a sustainable future of telecommunications businesses in Budiriro.

Keywords: Budiriro, Solar PV, Sustainability, Telecommunications Industry.

1 INTRODUCTION

Telecommunication towers are structures built to carry antennae and auxiliary equipment necessary for mobile network and internet connectivity [1].

A huge number of telecommunication base stations have been erected over the years to be particularly powered by the Zimbabwe national electricity grid. The demand of electricity in other sectors and lack of supply meant these towers needed alternative sources during load shedding, which the industry resorted to use of fossil fuel. The reason to settle for such resolve is to keep systems online for consistent internet supply, failure of which can be catastrophic. This is given by an instance when the whole country lost its internet connection for three days, business slowed drastically and the outage costed the country around \$17 million [2]. The telecommunications industry has been one of the leading industries in Zimbabwe. However, internet data prices have been increasing at an alarming rate over the last five years which has raised a huge concern to the general public who are barely making a living. Internet Service providers (ISPs) attribute the overall price instability to the

soaring fuel prices, grid power price increase as well as huge operating costs of alternative power.

Moreover, these operating costs will continue to surge. Telecommunications industry as we know it, continues to develop each year. According to [3], approximately 3 percent or 600 TWh of the worldwide electrical energy is consumed by telecommunications industries. With the advent of 5G [4] with Fierce Wireless suggest that telecommunications companies expect their operation costs increase up by 5 percent of their 4G counterpart.

To increase internet accessibility in Zimbabwe, there is need to put an end to the data price inflation by designing alternative energy supply to the base stations that eliminate high OPEX associated with generators which typically increase by 35 percent the total operating cost of a wireless base station (BTS), including skyrocketing fuel and expensive on-site maintenance costs [5]. A huge portion of energy used by telecommunications companies goes to the base stations [6]. Power contributes a quarter of total network costs [7].

According to GSMA, [8] over half of the World's population now have access to the internet. As per same report, low- and middle-income countries

(LMICs) account for the 93 percent of the world's population without access to the internet. The main reason being affordability. Reduction of cost as proposed by available research on deployment of solar will only ensure a decrease in data prices cost and a steady increase of internet usage. According to [9] case study, Solar PV reduced OPEX of a telecommunication tower by 84.67 percent. Hence there is potential to pose a significant change in Zimbabwe's local telecommunication industry. Inherently, internet usage simultaneously grows with population of which Zimbabwe's is expected to double in a couple of decades.

This paper is focused on identifying, analysing and proposing energy sources consisting Solar PV technologies and therefore choose an optimal alternative source to power base stations to reduce operation costs for ISPs. This will drive data price stabilisation to make internet which [10] declared as an enabler to the enjoyment of basic human rights, accessible. As well, eradicating the burning of fossil fuels is a big step towards achieving net zero [11].

In addition, while the country keeps battling with increasing the supply by discovering and up scaling energy sources, it is important that energy efficiency systems be ready in place, as these, regardless of the supply, will help improve the overall utilisation of energy in the long run. "Global telecommunication network providers are expected to install nearly 121.9 GW of cumulative new distributed renewable energy generation technologies and distributed energy storage systems capacity between 2021 and 2030," [12]. This research will offer significant help to ISPs for such future prospects.

2 LITERATURE REVIEW

According to a dashboard by [13], Zimbabwe has a huge number of off-grid and bad-grid towers powered by diesel. This proportion is 90 percent higher than regional average by Eastern Africa. However, the country has a policy which give incentives for off-grid and bad-grids that include finance for solar, PAYG solar, and CAPEX/OPEX subsidy. This gives a great opportunity for ISPs to deploy solar without extra cost on CAPEX.

Essentially, the existing system to power base stations makes use of power from two sources namely, grid electricity and backup generators. These backup in some cases both in the study area and some outskirts (beyond the scope of this study) work as the main source of energy during grid outages or as the sole source of power in off-grid base stations.

2.1 Zimbabwe Internet Users

Available data from [14] over the last ten years show an uptrend in the number of internet users. This is shown in Fig. 1. As the internet importance keep growing, the projection could mean more and more users of internet; If over the past years there were around 25 percent increase, there is possibility that in the next ten years there will be probably double the

number of internet users. This can only mean an increase in the number of telecommunication towers to cater for the always rising demand for internet. Which in turn means and increase in demand of energy from the telecommunication industry. If the existing models continue, the data prices will keep rising as more demand for fuel rise, with price soring high to less supply worldwide. Green energy deployment will be the best model to bank on to cater for the exponential growth of internet usage in the coming years.

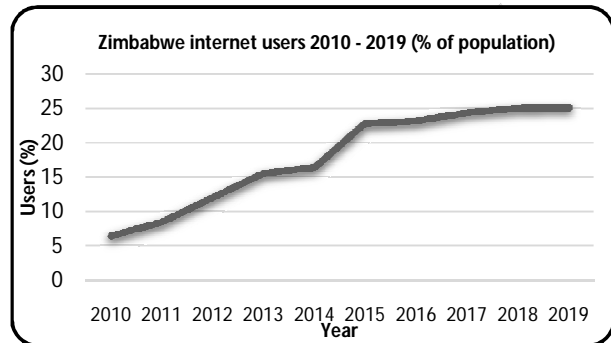


Fig. 1. Zimbabwe internet usage 2010 - 2019

2.2 Zimbabwe Projected Population

The following data from [15] show a linear increase in the projected population, Fig. 2, which is important in the analysis of existing telecommunication models. This data add justification for the deployment of green energy as internet data will continuously increase. Estimates also show that 63 percent of the total population are aged 13 and above, which is mainly the number of people with potential mobile phones and internet connectivity.

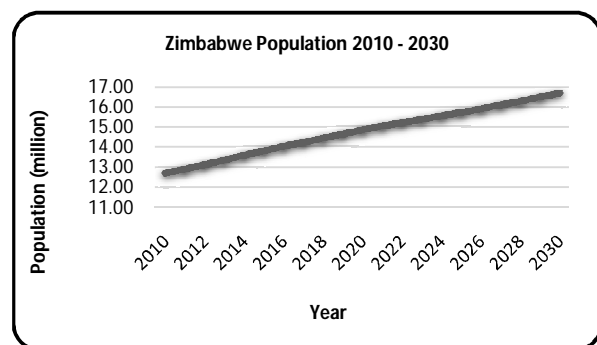


Fig. 2. Zimbabwe population projection

2.3 Zimbabwe Electricity Consumption

As seen in Fig. 3 [16], there is an upward trend establishing. This means that, backed with data in **Error! Reference source not found.**, there is going to be more demand of energy in the future. More energy demand and little supply will incessantly shoot the energy prices even higher, of which the effects will continuously reflect on the data prices. Deploying solar PV to telecommunication industry will help shun the constant internet data hike.

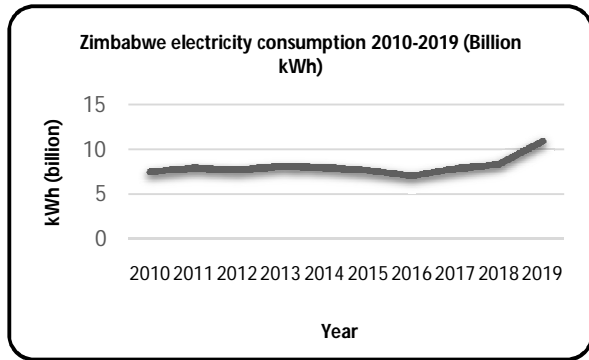


Fig. 3. Zimbabwe electricity consumption 2010 - 2019

2.4 Zimbabwe Electricity Generation

Total electricity generated in all the years since 2001 is displayed in Fig. 4 according to [17]. The data shows that there is no consistency in electricity generation. For over thirty years, the country had never surpassed 10 billion kWh mark until 2019. There is almost a high likelihood that the fluctuations will continue while simultaneously, population, demand and consumption keep rising.

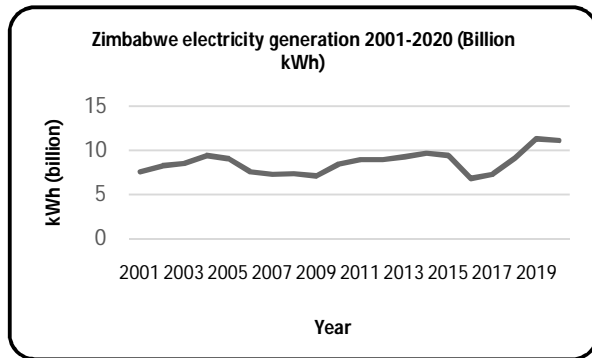


Fig. 4. Zimbabwe electricity generation 2001 - 2020

2.5 Zimbabwe Fuel Prices

A fuel increase over the years explains the data price hikes as well as project the possibility of extension. The world markets do not show any decrease of fuel in the future. As shown in Fig. 5 [18] and [19], the surge in 2022 prices show how unsustainable it is to be dependent on fossils especially fuel that is imported.

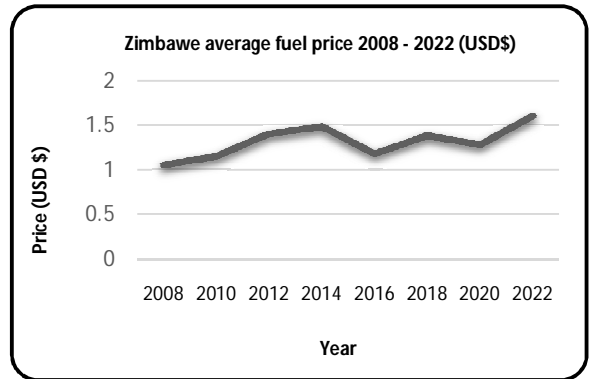


Fig. 5. Zimbabwe average fuel price 2008 - 2022 (USD\$)

2.6 Zimbabwe Lithium Potential

Zimbabwe is one of the top ten producers of lithium [20]. Zimbabwe holds a significant percentage (1.0 % | 220,000 tonnes) of Lithium reserve in the whole world as shown in Fig. 6. There is a huge potential for Zimbabwe to integrate renewable energy in telecommunications and other sectors as well. This is because one of the important components for the development of battery energy storage systems is abundantly available.

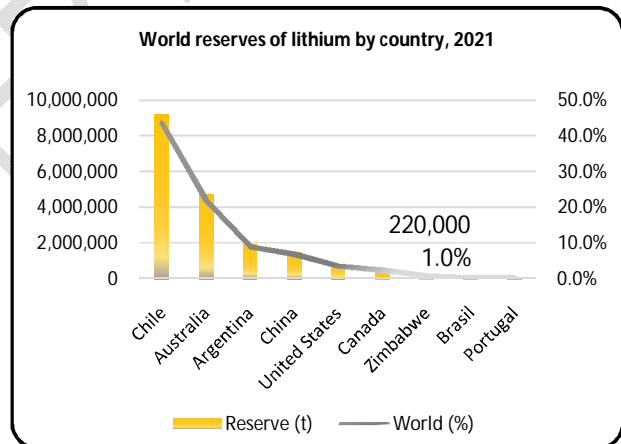


Fig. 6. World reserves of Lithium by country, 2021

2.7 Harare – Zimbabwe Monthly PV data

Renewable energy is energy from a source that naturally replenish within the human timescale. The sun which all renewable energies are dependent on, is a source of energy that does not deplete. This source is abundant in Zimbabwe (5.7 kWh/m² per day) as show in Fig. 7 by [21]. Further, the idea employed in this research is to make sure the ISPs themselves own and maintain their own renewable energy supply systems unlike paying external suppliers.

Harare, the city in which the study area, Budiriro is located – monthly PV performance data given in **Error! Reference source not found.**

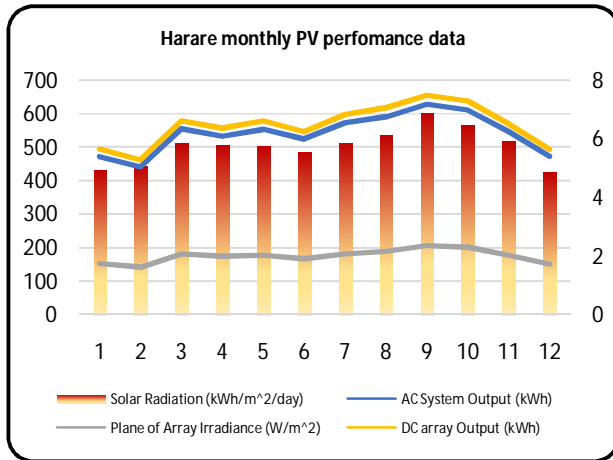


Fig. 7. Harare monthly PV performance data

2.8 Cost comparison for running a Generator/Solar PV

Data by [22] gives a comparison of maintenance of diesel fuel generators to that of Solar PV. As shown in Fig. 8 below, costs saved with solar after 25 years amount to \$ 190,019.00

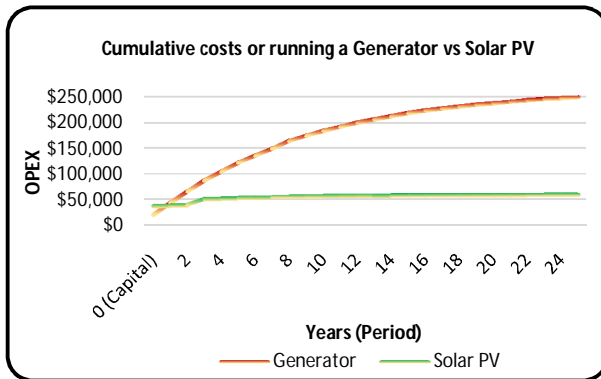


Fig. 8. Cumulative cost or running a Generator vs Solar PV

2.9 Batteries

Because of fluctuations in most renewable energy sources like solar, the storage of the harnessed energy for later use imperative. This allows these energy mixes to balance their supply and demand. Whether from re-appropriation of car batteries or specifically producing battery energy storage systems like stationery energy storage infrastructure.

A Battery Energy Storage System (BESS) is a technology developed for storing electric charge through the manufacture of batteries, or used appropriated lithium-ion electric vehicle batteries [23].

When selecting batteries for Solar Systems, the run time is more important than instantaneous power bursts, hence usage of batteries with higher energy density is advantages. The reasoning being that, PV systems with higher energy density can be less costly mainly during transportation. The energy density is a function of the weight of the battery, and the volumetric

energy density (in Whr/litre³) is a function of volume of battery. A battery with a higher energy density will be lighter than a similar capacity battery with a lower energy density [24].

There are quite a number of batteries with distinctions in materials from which the anode and cathode are made and the type of electrolyte. The most common types of solar batteries are categorised into lead-acid batteries and lithium batteries. Fig. 9 below shows the breakdown of batteries [25].

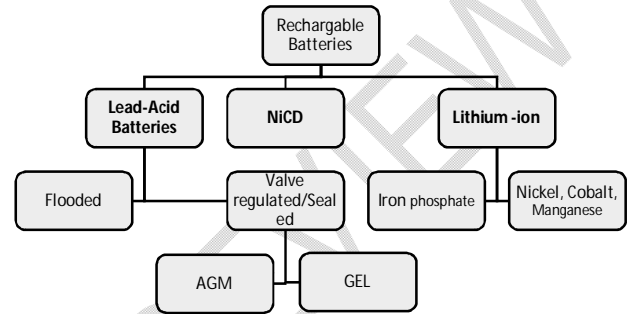


Fig. 9. Types of batteries

Further comparisons are made in Fig. 10 of the two leading battery types used for Solar Systems. The comparison uses, Depth of Discharge (DOD) – The, Round Trip – Percentage of energy that can be used to that it took to fully charge the battery, Maintenance – Cost and routines to keep the battery up, Battery life – Time before a need to replace the battery completely, Charge Cycles – Number of times a battery can go from full charged to discharged in its lifecycle, Capacity – Amount of charge that can be hold after charge, and Size per kWh – The weigh per kWh of batteries, for ease of transportation and storage [26], [27] and [28].

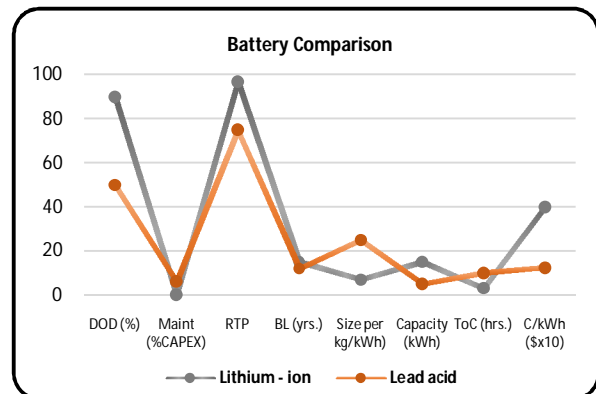


Fig. 10. Battery comparison

This research focused on Lithium batteries. This is because of the resource availability as discussed in 2.6, a resource that is readily available in Zimbabwe. This makes the deployment of solar more favourable because;

1. Lithium is becoming the preferred choice for batteries is green solutions.
2. Zimbabwe is one of the big producers of lithium, this will reduce production cost of batteries, Solar PV installations as well as future maintenance – sustainability.
3. The peak sun hours in Zimbabwe average 5 hours a day. Having lithium batteries means the system can be fully charged in a small period of time within the peak sun hours.

2.10 Simulation – HOMER Pro

HOMER (Hybrid Optimization Model for Multiple Energy Resources) is a design, simulation and optimisation software for building cost effective hybrid microgrid and grid-connected systems that combine traditionally generated, renewable power as, storage, and load management [29].

In simulation, HOMER Pro creates from input parameters, viable systems for all possible combinations of energy sources in a design. A number of systems in some cases even hundreds or thousands can be simulated all of which on the basis of required system capacity.

In optimisation, HOMER Pro closely examines the system combinations and sort systems according to the designer's preferred variable. It can optimise for example for the lowest net present cost if that is the designer's main target. The software's interface is shown in Fig. 11.

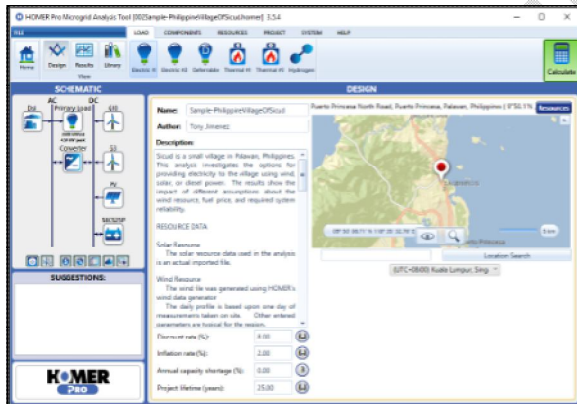


Fig. 11. HOMER Pro interface

3 RESEARCH METHODOLOGY

For the framework to be applicable elsewhere, there is need to assess at a cost perspective the economic feasibility of different approaches that can be applied in the study area through its availability. The process is shown in Fig. 12.

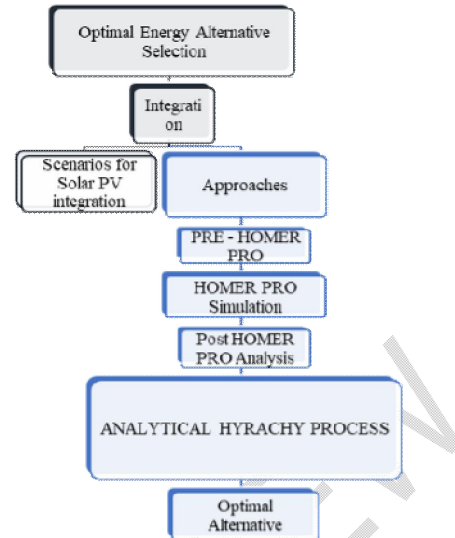


Fig. 12. The research framework

3.1 Scenarios for Integration

The integration of Solar PV on the existing Telecommunication Towers can be approached in three different ways i.e., Base stations built on/near residential houses, Base Stations built near Clinics, Shop, Municipality, Communities and beyond the scope of this research, Base stations built in isolated areas.

3.1.1 Scenario 1 – Base Stations built on/near residential houses

These base stations built on pockets or spaces intentionally left by municipality or next to households or on the households' land through agreement, Fig. 13. The benefits that can be realized from this is the fact that households that agree to install the Solar PVs on their roof will share the Power with the telecommunication companies.

They will absolutely pay nothing since the maintenance will be done by these telecommunication companies.



Fig. 13. Telecommunication towers built near houses

3.1.2 Scenario 2 – Base Stations built near Clinics, Shops, Municipal Centres.

Base Stations that are built closer to municipal premises like offices, solar powered boreholes as seen in Fig. 14, and community halls. These have easy integration since there is a lot of free unutilized area of space both on empty roofs and ground. Solar panels enough to power the community hall and the telecommunication towers can be installed.



Fig. 14. Telecommunication towers built near municipal facilities

3.2 Approaches for Solar Integration

There are a few combinations of approaches that can be used for the integration of solar for the provision of power into the existing base stations. For a broader perspective, there is also need to analyse how the systems without Solar PV perform as well as their environmental impacts so as to prove the importance of Solar PV deployment in this industry. The different energy systems (approaches) considered are; Existing system (Grid + Generators), Generators only, Generators + Solar PV, Solar PV only, Solar PV + Grid and Grid only.

In the aforementioned approaches, the system setup will consist of power supply (either Solar PV with panels with backup storage in form of batteries/ Diesel gensets/Grid/), charge controllers, inverters, and the load (telecommunication tower).

3.2.1 Approach 0 (A0) – Grid + Generator (Existing System)

The existing system has base stations powered with the Grid (National Grid – Hydro Power + Thermal Power) as the main power source and backup generators that kick in during grid outages. A maximum of 40 percent grid availability per day and the rest will be powered by the generator. A 25-kW generator is used in the study with fuel price set at the existing average at USD \$1.74 per litre at the time of simulation, with grid unit power at 0.11 per kWh [19]. GHG emission are calculated based on operation time

and percentage efficiency of generators taken to be 25 percent. The system used a maximum of 40 percent of thermal power portion for electricity [34]. This was used to calculate the GHG emission by the grid. The system configuration is shown in Fig. 15.

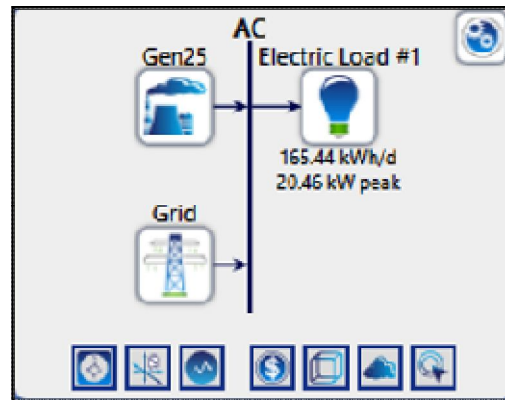


Fig. 15. Grid + Generator (Existing System)

3.2.2 Approach 1 (A1) – Generator only

Grid availability is zero and 100 percent generator. A 25-kW generator is used in the study with fuel price set at the existing average at USD \$1.74 per litre at the time of simulation [19]. GHG emission are calculated based on operation time and percentage efficiency of generators taken to be 25 percent.

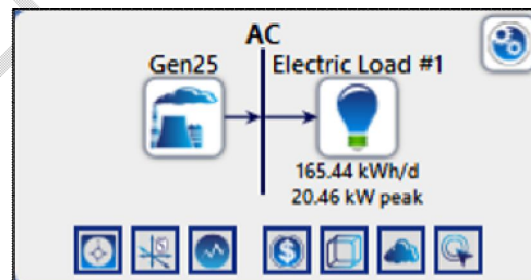


Fig. 16. Generator only

3.2.3 Approach 2 (A2) – Generator + Solar PV

This approach makes use of Solar PV with generators as backup, Fig. 17. Availability of 60 percent generator and 40 percent availability for Solar PV was used. A 25-kW generator is used in the study with fuel price set at the existing average at USD \$1.74 per litre at the time of simulation [19].

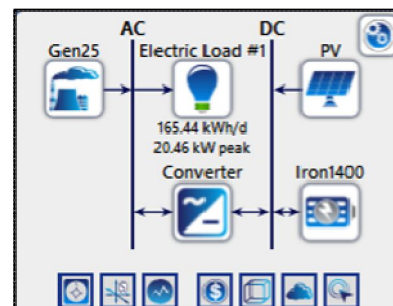


Fig. 17. Generator + Solar PV

3.2.4 Approach 3 (A3) – Solar PV only

In this approach, Fig. 18, the base stations go totally off-grid. This system uses 100 percent of Solar PV power. The system size for the Solar PV and battery bank are in Section 3.3.2 and Section 3.3.3.

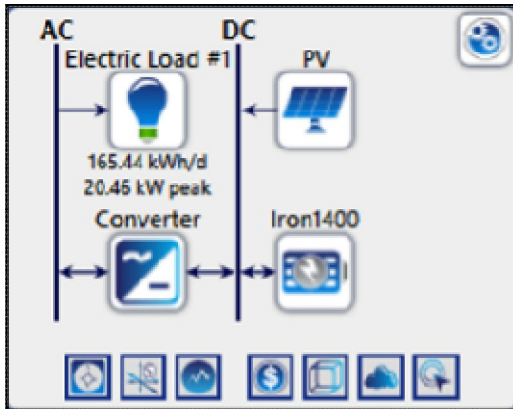


Fig. 18. Solar PV only

3.2.5 Approach 4 (A4) – Grid + Solar PV

In this approach, Fig. 19, Solar PV substitute generators. This essentially means that, solar PV will work during grid power outages as well as during peak hours when power is expensive. The average sun hours in the area are five hours [21], hence the need for a complementary battery pack to increase the reliability of the system during night hours and cloudy days. The input data gave a maximum of 40 percent grid availability per day and the rest will be powered by the Solar PV. The system size for the Solar PV and battery bank sizes are given in 3.3.2 and 3.3.3 respectively, with grid unit power at 0.11 per kWh [19]. The system used a maximum of 40 percent of thermal power portion for electricity [34]. This was used to calculate the GHG emission by the grid.

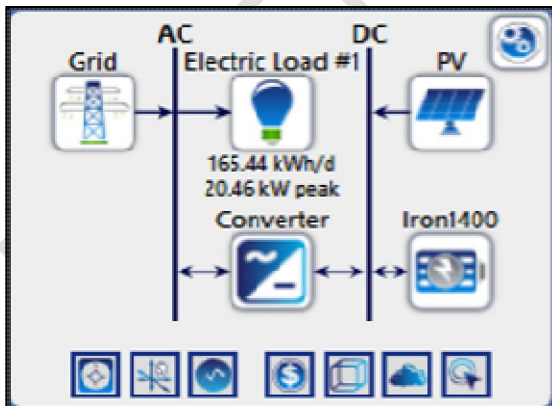


Fig. 19. Grid + Solar PV

3.2.6 Approach 5 (A5) – Grid only

The grid, if available would provide a 100 percent of the power with grid unit power at 0.11 per kWh [19]. The system used a maximum of 40 percent of thermal power portion for electricity [34]. The system is shown

in Fig. 20.

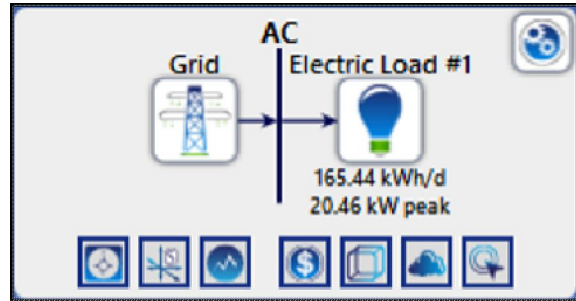


Fig. 20. Grid only

3.3 Pre HOMER-Pro simulation

Before simulation of the proposed approaches, there is base data that needed to be provided for input in the simulation software. This data includes, generator size, grid power provided, PV system size and the battery. A weighting is put on the input parameters based on monthly usage, grid availability and system operation hours.

3.3.1 Solar PV System Sizing

Calculating daily energy use

Energy daily use is approximated from data collected. The data collected has a weekly use of approximately 1,000 kWh per month per base station.

$$\text{Daily energy use} = \frac{\text{weekly use}}{\text{days in a week}} = \frac{1000}{7} = 142 \text{ kWh/dy} \quad (1)$$

Calculating Power Output required by the Solar PV system.

From the data collected of the study area, the approximate daily hours of full sun are around 5 hrs/dy.

$$\text{Power Output} = \frac{\text{Daily energy use}}{\text{Daily hours of full sun}} = \frac{142 \frac{\text{kWh}}{\text{dy}}}{5 \frac{\text{hrs}}{\text{dy}}} = 28.4 \text{ kW} \quad (2)$$

3.3.2 Calculating PV system size

This study makes use of a 0.8 derating factor. The system size is obtained by dividing the power output by the derating factor.

$$\text{Solar PV system} = \frac{\text{Power output}}{\text{Derate factor}} = \frac{28.4 \text{ kW}}{0.8} = 35.5 \text{ kW} \quad (3)$$

A 35.5 kW system will be used as the input system in the simulation of approaches with a Solar PV system.

3.3.3 Battery Bank Sizing

For the battery bank system, it should last the system at least a day before the next full sun hours. Hence the battery should sustain operation for the next full day. The state of charge used will be 20 percent. Since Solar PV power availability is purely dependent on weather which cannot be controlled by human means. It is not wise to put a 100 percent dependence on it.

Hence a 40 percent maximum daily use weighting is placed on it.

$$\text{Daily use} = 0.4 \times 142 \text{ kWh} = 56.8 \text{ kWh} \quad (4)$$

$$\text{Battery bank size} = \text{Daily use} \times \frac{\text{Days of autonomy}}{(1-\text{state of charge})} = 56.8 \text{ kWh} \times \frac{1}{(1-0.2)} = 71 \text{ kWh} \quad (5)$$

This 71 kWh is the amount of energy our battery bank needs to hold in total when fully charged.

3.3.4 Amp hours required

Assuming a 48 V battery pack,

$$\text{Amp hours} = 1,000 \times \frac{\text{Energy storage}}{\text{Battery voltage}} = \frac{71 \text{ kWh}}{48 \text{ V}} = 1,479.167 \text{ @ } 48\text{V} \quad (6)$$

3.3.5 Generator Size

From data once used for base stations design and that from the study area collected. We can approximate an average of 30 kVA backup generator. Also, a power factor of 0.85.

$$\text{Generator Size} = \frac{\text{Generator rating}}{\text{power factor}} = \frac{30 \text{ kVA}}{0.85} = 25.5 \text{ kW} \quad (7)$$

3.3.6 Grid Considerations

The simulation has to have a weighted Grid data. There have to be a limit on the grid capacity to prevent the system optimising towards the grid which might have a relatively cheap power and lower Capital costs. However, the weighting on the grid is fairly applied because of its low reliability due to loadshedding. The maximum capacity is weighted at 3,000 kWh per month.

3.4 Load Profile

The load profile was determined by combining the data collected in the study area and literature. The selected synthetic load in HOMER PRO is a community type of load, Fig. 21, with an average of 165 kWh per day of consumption. This is a bit more than the average BTS consumption with 4kW rating working 24 hours a day. However, with the advent of 5G networks, within the next 10 – 25 years during which this paper is simulating its data on, there is more likelihood that ISP's will have moved to 5G systems. 5G systems need about 68 percent more power than 4G [31]. Hence, this takes the average daily loads above 160 kWh.

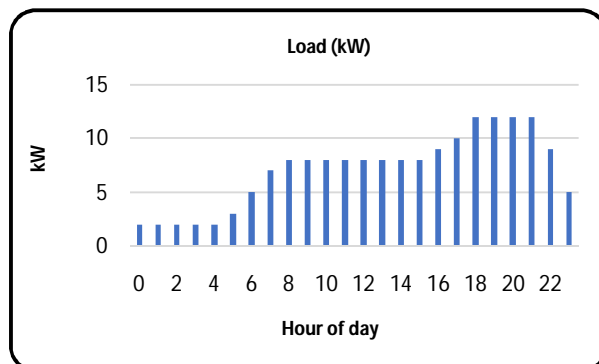


Fig. 21. Load profile

3.5 Analytic Hierarchy Process

Analytic Hierarchy Process (AHP) is a multi-criteria decision-making framework which produce priority scales through pairwise comparisons [32] and [33]. AHP start with a focus, which is the main goal – in this case, selecting the optimal energy supply system to power telecommunication base stations, then second level, the main criteria with which the main goal is based and lastly, the sub criteria.

The analysis for this research has criteria based on sustainability pillars [economic, environmental and social], as well as technical, expanded into 15 sub criteria on which a pairwise comparison was performed. The pairwise comparisons were based on both actual measurements on output HOMER Pro simulation data and a scale derived from relative strength of individual sub criteria standing. Fig. 22 shows the hierarchy Diagram for selecting the optimal alternative power source for base stations.

Analytic Hierarchy Process (AHP) follows a number of steps which are outlined below,

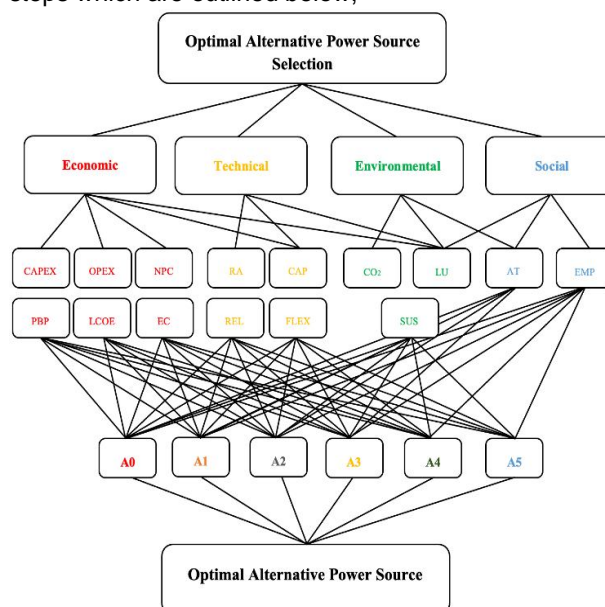


Fig. 22. Analytic Hierarchy for selecting optimal alternative power source

3.5.1 AHP – Step 1: Sub Criteria Classification

The output simulation results from HOMER PRO are categorised into four sustainability pillars **Economical**; Capital Expenditure (CAPEX), Operating Expenditure (OPEX), Net Present Cost (NPC), Levelised Cost of Energy (LCOE), Emission Cost (EC) – **Technical**; Resource Availability (RA), Capacity (CAP), Reliability (REL), Flexibility (FLEX) – **Environmental**; Emission (CO₂), Land Use (LU), Sustainability (SUS) – **Social**; Acceptability (AT), Employment Creation (EMP) according to previous research.

3.5.2 AHP – Step 2: Pairwise Comparison

Here criteria and sub-criteria are compared individually to one another. But firstly, these criteria/sub-criteria are ranked against each other based on actual data or assigned preferred values based on AHP fundamental scale in Table 1.

Table 1. AHP fundamental scale for pair – wise comparisons

AHP Fundamental Scale for Pair-wise Comparisons		
Impact intensity	Description	Definition
1	Equal Importance	Two criteria contribute equally towards the goal
3	Slightly More Importance	One criteria contribute slightly more than the other criteria towards the goal
5	Strongly More Importance	One criteria strongly contribute more over the other criteria towards the goal
7	Very Strongly Importance	One criteria very strongly contribute more over the other criteria towards the goal
9	Extremely More Importance	One criteria has the highest contribution towards the goal than the other criteria
Intensities of 2,4,6, & 8 are used for intermediate values, while intensities 1.1, 1.2, 3.1,3.2...5.15.2,...,7.1, 7.2,..., etc. are used for criteria that are very close in importance towards a goal.		

After preference values are assigned to individual criteria to be compared, the pairwise comparison is made based on the n-by-n matrix in Eq (8).

$$A = \begin{bmatrix} 1 & a_{12} & \dots & a_{1n} \\ 1/a_{21} & 1 & \dots & a_{2n} \\ \dots & \dots & 1 & \dots \\ 1/a_{n1} & 1/a_{n2} & \dots & 1 \end{bmatrix} \quad (8)$$

In this case, pairwise comparison was performed per each approach (A0 – A5). Before the result of the pairwise comparison can be accepted, a consistency must be checked. This consistency is checked based on Eq (9),

$$CI = \frac{\lambda_{max} - n}{n - 1} \quad (9)$$

Where n is the number of criteria and λ_{max} is the principal eigen value estimated from a summation of products between each element of Eigen vector and sum of columns of the reciprocal matrix. This process referred in Eq (10).

$$\lambda_{max} = \sum_{i=1}^n \lambda_{max p} w_i = \sum_{i=1}^n \sum_{j=1}^n a_{ij} w_{ij} \quad (10)$$

According to [33] the pair-wise comparison can maintain consistency only when consistency index (C.I.) is equal to or less than 0.10 calculated based on Eq (11) for an average random consistency index (R.I.) of n-values given in Table 2.

$$CR = \frac{C.I.}{R.I.} \quad (11)$$

Where C.R. is consistency ratio by [33]. All of the pair-wise comparisons for all systems maintained a consistency less than the threshold.

Table 2. Random consistency index

Random Consistency Index (R.I.)								
n	1	2	3	4	5	6	7	8
RI	0	0	0.52	0.89	1.11	1.25	1.35	1.4
	9	10	11	12	13	14	15	
	1.45	1.49	1.52	1.54	1.56	1.58	1.59	

3.5.3 AHP – Step 3: Pair-Wise Performance Comparison

This step involves getting single value scores of each sub criteria in a pair-wise comparison performed, which are 15 in this study. This was done for all six approaches proposed (A0 – A5). This is done by getting the average of the normalised relative weights pair-wise of each of the individual pair-wise. To obtain normalized relative weights for each paired matrix values, the reciprocal matrix from paired comparison matrix were summed up in each column of the reciprocal matrix and each element of the reciprocal matrix divided with the sum of its column. The average weighted scores from each sub criteria for each approach (A0 – A5) are shown in Table 3.

Table 3. Weighted criteria score for all sustainability pillars

App	Economical						Technical				Environmental			Social	
	CAPEX	OPEX	NPC	PBP	LCOE	EC	RA	CAP	REL	FLEX	CO2	LU	SUS	AT	EMP
A0	0.007	0.006	0.006	0.007	0.007	0.007	0.010	0.010	0.011	0.011	0.013	0.016	0.014	0.021	0.022
A1	0.008	0.006	0.005	0.008	0.007	0.006	0.010	0.011	0.011	0.011	0.011	0.016	0.014	0.021	0.028
A2	0.007	0.006	0.006	0.007	0.007	0.007	0.011	0.011	0.011	0.011	0.014	0.013	0.014	0.021	0.024
A3	0.006	0.009	0.009	0.007	0.005	0.008	0.011	0.009	0.011	0.010	0.017	0.011	0.014	0.021	0.019
A4	0.007	0.008	0.007	0.006	0.008	0.007	0.011	0.011	0.011	0.010	0.014	0.012	0.014	0.021	0.017
A5	0.008	0.007	0.008	0.006	0.008	0.007	0.010	0.009	0.009	0.010	0.015	0.016	0.014	0.020	0.015

3.5.4 AHP – Step 4: Alternative Prioritization

In the final step, the behaviour of these six approaches is analysed by changing priority weights on the main criteria i.e., the sustainability pillars. Many questions are asked, on what systems tops when priority is either given to the economic, environmental and social consciousness, as well as technical.

4 RESULTS AND DISCUSSION

The proposed approaches for the integration of solar systems into the telecommunications were simulated and the results analysed through Analytic Hierarchy Process. Data from a total of 15 sub criteria was tabulated in a pair-wise comparison to derive their contribution to the selection of the required solution. In return, sustainability pillars, Economical, Environmental and Social, as well as Technical were each prioritised individually (while keeping the other three constant) across all six approaches to observe their behaviour.

4.1 Simulation Results – Post HOMER Pro Analysis

HOMER PRO 3.5.4 was used in this study to simulate the different proposed approaches. The output results are analysed in this section grouped into respective sustainability pillars.

4.1.1 Economic Analysis

The simulation of approaches in HOMER Pro gives results of a number of economic measures of viability of hybrid systems. These include but not limited to Initial Capital, Net Present Cost (NPC), Operating cost (in \$/year), LCOE, O&M of genset systems (in \$/year) and equivalent Cost of Emission (which is computed from local taxes in a country).

Solar PV systems have generally high initial costs over ten percent more than fossil fuel-based systems with generators. Grid only systems have the least initial capital costs, but a relatively higher operating costs around 108 percent per year more than grid

coupled with solar. Whereas diesel generators only systems have operating costs between 697 – 1,559 percent per year more than grid only systems and grid + solar systems respectively. In essence, generator only systems will spend between \$1,158,025.00 – \$1,244,275.00 in its entire lifetime in operation cost only than the two latter systems which more than ten times more than the initial cost of Solar PV installation. This is shown in Fig. 23.

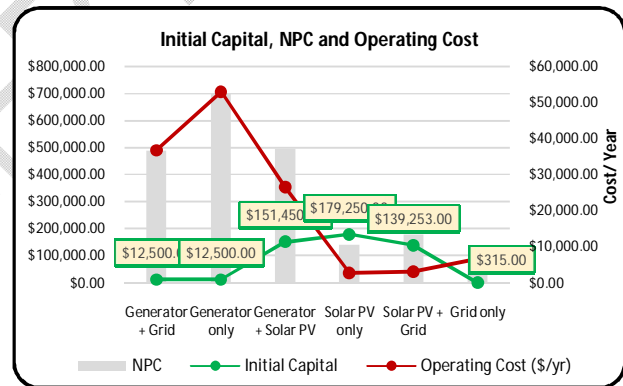


Fig. 23. Initial Capital, NPC and Operating Cost

Because of drastic measures to prevent exacerbating the effects of climate change, taxes are set upon fossil fuel burnt or CO2 released into the atmosphere. Apart from the extra cost of maintenance, generator only systems have 618 and 278 percent more extra cost paid in emissions than grid + solar PV systems and grid only systems respectively, as shown in Fig. 24. Generator-based systems have generally lower LCOE than purely solar PV only system (\$2.40). Grid + solar PV system (\$0.20) and grid only system (\$0.11) has the lowest electricity cost per unit. The existing system (grid + generator) has 190 percent more cost per unit of electricity than grid + solar system.

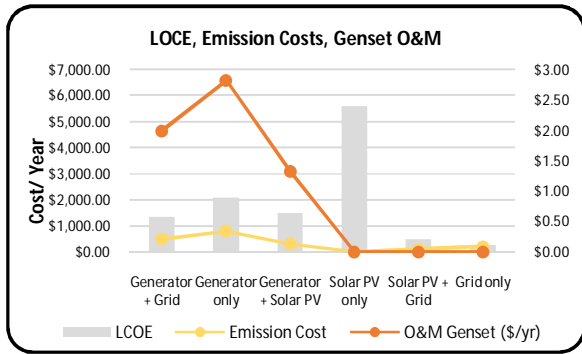


Fig. 24. Genset O&M, Emission Cost and LCOE

4.1.2 Technical Analysis

Solar PV + grid system has 37 percent more energy per year than the existing system (generator + grid) based on the weighted input figures in the simulation results shown in Fig. 25. This means that at a LCOE of \$0.20 per kWh, ISPs can sell the extra power back to the grid or share with home owners to subsidise their land use as a rental for the spaces used and still have enough to run their base stations.

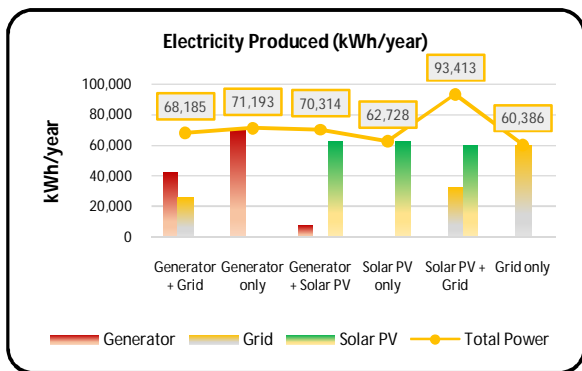


Fig. 25. Electricity production per year of different approaches

4.1.3 Environmental Analysis

According to a simulation on PV Watt web Solar PV Calculator [31], a 100 m² of roof space can produce up to 30 kWh of energy per year. This approximate to 3.5 m² per kWh of energy space. Fig. 26 below gives an overview of land use with Solar PV Systems having around 200 m²/kW. The same figure compares the amount of CO₂ released by the individual approaches. The existing system (Grid + Generator System) has 359 percent emissions in tonnes per year more than that of Grid + Solar PV System.

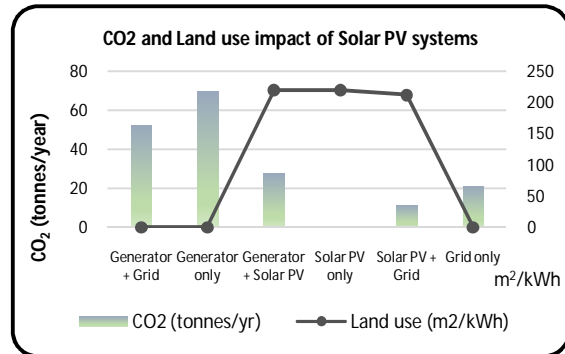


Fig. 26. CO and Land Use of approaches

4.2 System Selection

From the simulation results as presented in Fig. 27, it is noticed that Grid and, Solar PV + Grid Systems stand out in many sustainability pillars. Other systems are not favourable means of power in the telecommunications industry. In a general sense, hybrid systems with any portion of Solar PV are more preferable than those with generators.

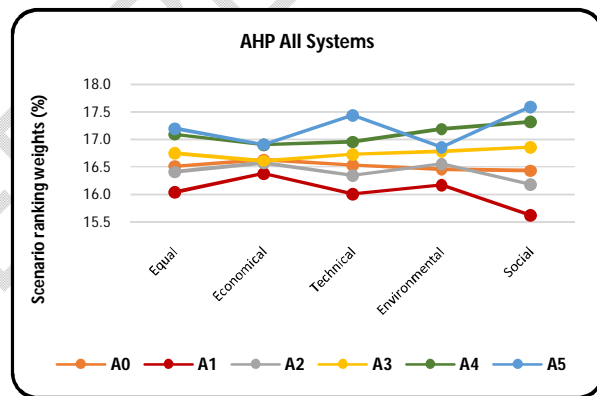


Fig. 27. Analytical Hierarchy Process (Economic 20%, Technical 20%, Environmental 40% and Social 20%) [A0 - Generator & Grid System; A1 - Generator only System; A2 - Generator & Solar PV System; A3 - Solar PV only System; A4 - Solar PV & Grid System; A5 - Grid only System]

The sustainability performance of all the systems is given in Fig. 28. All the approaches are ranked based on the total percentage weights across all sustainability pillars. Grid only system ranks first, followed by Grid + Solar PV system, with Generators ranking lower than systems with Solar PV. From their sustainability performance it is evident that generator systems are visibly less preferable, hence, cannot be selected as a means of power in the telecommunication industry.

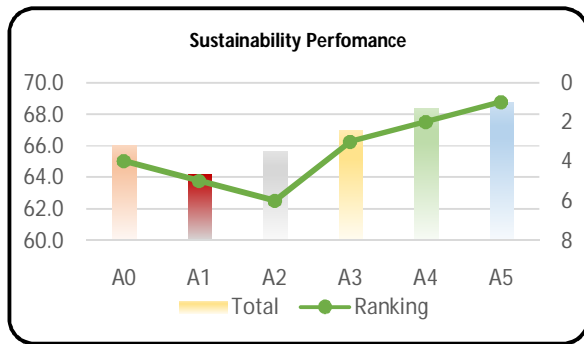


Fig. 28. Analytical Hierarchy Process combined prioritisations [A0 – Generator & Grid System; A1 – Generator only System; A2 – Generator & Solar PV System; A3 – Solar PV only System; A4 – Solar PV & Grid System; A5 – Grid only System]

Grid only System in particular, have higher technical preference, and social sustainability. This is mainly because Grid Systems take very minimal land space, produce quiet power in the supplied area as opposed to noisy and vibrating generators. As well, Grid systems means setting up huge companies at macro level in the process, creating employment for the local people. However, their unreliability makes them less preferable. Furthermore, the energy mix in Zimbabwe is currently dominated by hydro. During times of drought or low rainfall, hours of outages drastically increase, up to 24 hours per day in some cases; during that same time, thermal stations, if available, fire up and take the bigger percentage in the energy mix. Though this can supplement the energy demand, firstly – it's not sufficient; secondly – it increases GHG emission. The goal is to reduce and possibly in the near future eliminate fossil fuel use. Reducing dependence on the grid in some other industries, in this case telecommunications, can significantly reduce demand and possibility of emissions by thermal plants as base station power can prioritise using more of Solar PV. Most importantly, grid outages are the reasons for ISPs to turn to generators for back-up power. Hence, to increase reliability of base station power supply by offering redundancy, it therefore leaves Grid + Solar PV system (A4) the optimal alternative power system for powering telecommunications base stations.

Based on the priority results, Grid + Solar PV systems ranks higher on the Economic and Environmental sustainability pillars which are very crucial pillars in modern day business. A system of Grid + Solar PV is not only the best due to redundancy but even feasible as ISP's will only focus on Solar PV installation as the Grid connection already exists. As reported in Fig. 25, Solar PV + Grid have the highest energy production per year. According to the scenarios in **Section 3.1**, residencies or municipal premises on which ISP's can install Solar PV gain free use of power according to this paper's design proposition; A4 – Grid + Solar PV System can produce sufficient power for this model.

4.3 The optimal alternative system

From the selected approach A4 – Grid + Solar PV, there are a number of potential benefits if adopted by the ISP's.

For energy systems projects, NPC is the best measure of how feasible its implementation is in comparison to others and where a breakdown of sales and net revenue are not given. A system is more preferable if it minimises NPC. As presented in Fig. 29, Grid + Solar PV (A4) system offer by 170 percent lower NPC over its entire lifecycle than Grid + Generator (A0) system.

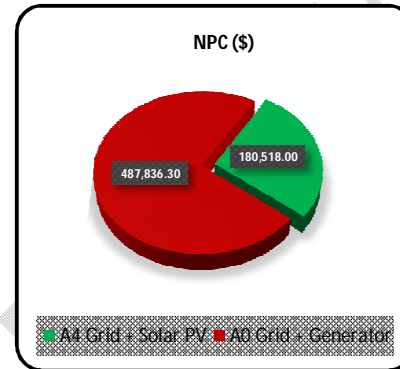


Fig. 29. NPC comparison for Grid + Generator | Grid + Solar PV systems

Solar PV systems have generally a higher CAPEX than Generator based systems. This is proven in Fig. 30 below with Grid + Solar PV (A4) systems 1,014 percent higher initial capital than Grid + Generator (A0). However, if Solar PV systems are well maintained, they stand as a one-time investment in their lifecycle of 25 years, which is more than that of generator systems, 10 years. This essentially means that midway in the lifecycle of Solar PV, there is a new generator installation.

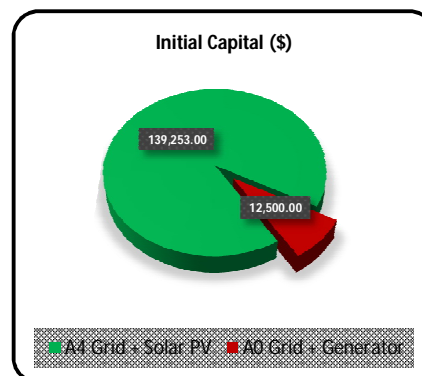


Fig. 30. Initial Capital comparison for Grid + Generator | Grid + Solar PV systems

The reason why the existing system Grid + Generator would cause an increase in data price is because the unit cost of electricity (\$0.58 per kWh) is generally higher than the grid (\$0.11 per kWh) in the area. By adopting Grid + Solar PV, ISPs reduce the unit cost of

electricity by 183% as shown in Fig. 31 to \$0.20 per kWh.

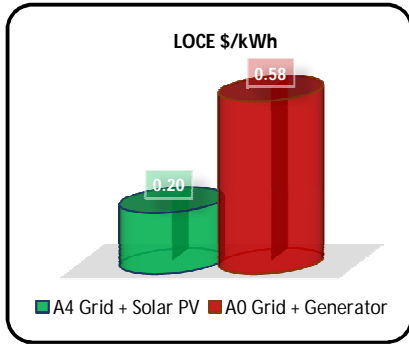


Fig. 31. LCOE comparison for Grid + Generator | Grid + Solar PV systems

Operating expenditure for generator-based systems are always high. Though the initial cost is a thousand percent less than those of Solar based systems as of yet, it is still important to note that with cost of running those generators only, it cost more that 100 percent initial cost of solar PV systems over the entire life time. In this case, Grid + Generator system has 1,052 percent more OPEX per year than the proposed approach. The distribution is shown in Fig. 32 below.

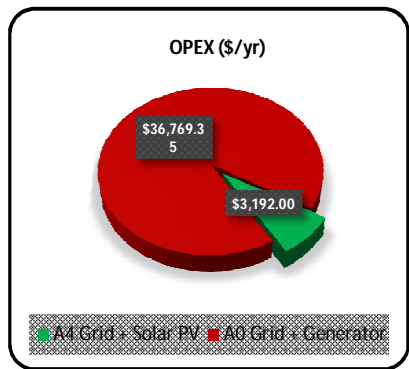


Fig. 32. OPEX comparison for Grid + Generator | Grid + Solar PV

Setting a cost on carbon is a measure put by governments to reduce emissions by taxing the emitter. To avoid these taxes ISP's can adopt systems with less GHG emissions. By coupling the grid with Solar PV, telecommunications companies can avoid 348 percent additional cost on emission. The distribution is show in Fig. 33.

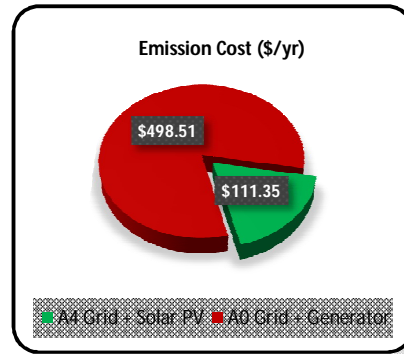


Fig. 33. Emission cost for Grid + Generator | Grid + Solar PV

The existing system (Grid + Generator System) has 359 percent emissions in tonnes per year more than that of Grid + Solar PV System. The distribution is show in Fig. 34 for perspective. By adopting the proposed approach there is potential of 41.13 tonnes per year of GHG emissions avoided per base station.

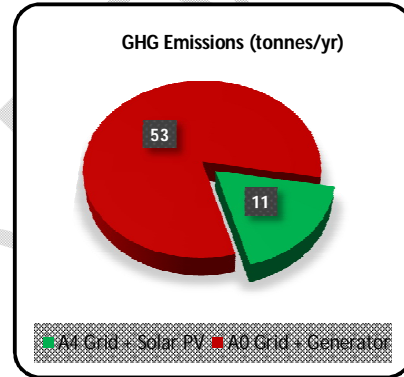


Fig. 34. GHG Emissions Grid + Generator | Grid + Solar PV

To fully make use of the proposed approach, the installed Solar PV has to provide excess power to share with either the household or municipality on which the Solar PV is installed. At the same power capacity, the simulation results show that the Grid + Solar PV system can produce 37 percent more energy than the existing system as shown in Fig. 35.

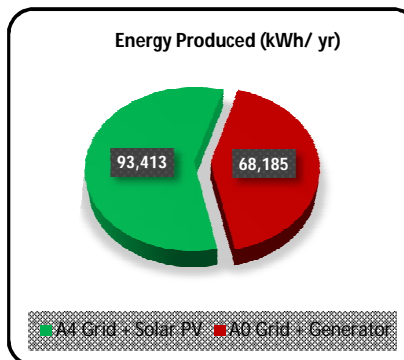


Fig. 35. Energy Produced Grid + Generator | Grid + Solar PV

5 CONCLUSION

The research's aim was to find a solution for deploying Solar PV by proposing an optimal alternative energy supply system to power telecommunications base stations based on sustainability pillars; Economical, Environmental and Social, as well as Technical. Budiriro was used as a Case Study, a reference, to be able to streamline the research outcomes. The study derived six power system configurations from the available possible power sources in the study area. The systems were then simulated in HOMER Pro and from the simulation results, the systems were ranked through Analytic Hierarchy Process (AHP) by performing pairwise comparisons of 15 sub criteria. After considering a number of factors like reliability, power output and mainly sustainability, Grid + Solar PV system came out as the optimal alternative system to power telecommunications base stations in the study area. The results show that the optimal system reduces OPEX by over 1,000 percent offering 37 percent more power and 41.13 tonnes of GHG emissions avoided per year. The solutions given here within can be applied in similar areas with similar demand and most importantly a sufficient solar irradiation, which is the main resource the study focused on.

REFERENCES

- [1] Law Insider. Law Insider: Telecommunication Tower definition. Law Insider. [Internet] March 24, 2022. <https://www.lawinsider.com/dictionary/telecommunication-tower>.
- [2] CNN World. CNN World: Internet shutdowns aren't just Africa's problem. They're happening worldwide. CNN World. [Internet] January 18, 2019. <https://edition.cnn.com/2019/01/17/africa/internet-shutdown-zimbabwe-censorship-intl/index.html>.
- [3] Rethinking energy efficiency models of cellular networks with embodied energy. Humar, Iztok, et al. 2011, IEEE Network, pp. 40 - 49.
- [4] Hardesty, Linda. Fierce Wireless: 5G base stations use a lot more energy than 4G base stations: MTN. Fierce Wireless. [Internet] April 3, 2020. <https://www.fiercewireless.com/tech/5g-base-stations-use-a-lot-more-energy-than-4g-base-stations-says>.
- [5] BHB. Wireless Base Stations: Meet the cost and carbon challenge. Lisbon: AEG Power Solutions, 2013.
- [6] Game Theory Framework Applied to Wireless Communication Networks. Yaacoub, Elias, Ghazzai, Hakim and Alouini, Slim Mohamed. 2016, p. 35.
- [7] Novergy Solar. Novergy - Power Geration for Generations: Do you know how solar can empower the telecom industry. Novergy - Power Geration for Generations. [Internet] July 5, 2022. <https://www.novergysolar.com/do-you-know-how-solar-can-empower-the-telecom-industry/>.
- [8] GSMA. GSMA: Over Half World's Population Now Using Mobile Internet. [Internet] September 28, 2021. <https://www.gsma.com/newsroom/press-release/over-half-worlds-population-now-using-mobile-internet/>.
- [9] Optimal Solar Power System for Remote Telecommunication Base Stations: A Case Study Based on the Characteristics of South Korea's Solar Radiation Exposure. Alsharif, Mohammed H and Kim, Jeong. 2016, Sustainability, pp. 16-17.
- [10] United Nations. Report of the Special Rapporteur on the promotion and protection of the right to freedom of opinion and expression. New York City: UN General Assembly, 2011.
- [11] UNFCCC. United Nations Climate Change. United Nations Climate Change: The Paris Agreement. [Internet] November 4, 2016. <https://unfccc.int/process-and-meetings/the-paris-agreement/the-paris-agreement>.
- [12] Nastu, Jennifer. Environmental Leader: Telecoms to Triple Electricity Consumption, Boosting Growth of Distributed Energy Generation. Environmental Leader. [Internet] February 9, 2021. <https://www.environmentalleader.com/2021/02/telecoms-to-triple-electricity-consumption-boosting-growth-of-distributed-energy-generation/>.
- [13] GSMA. GSMA Mobile for Development: Renewable Energy Dashboard. GSMA Mobile for Development. [Internet] July 22, 2022. <https://www.gsma.com/mobilefordevelopment/renewable-energy-dashboard/>.
- [14] The World Bank. The World Bank: Individuals using internet (% of population) Zimbabwe. The World Bank. [Internet] April 2022, 2022. <https://data.worldbank.org/indicator/IT.NET.USER.ZS?locations=Z>.
- [15] United Nations. United Nations: Department of Economic and Social Affairs. United Nations. [Internet] August 2019. <https://population.un.org/wpp/Download/Standard/Population/>.
- [16] US. Energy Information Administration. US. Energy Information Administration: Zimbabwe, data. US. Energy Information Administration. [Internet] April 20, 2022. <https://www.eia.gov/international/overview/country/ZWE>.
- [17] U.S. Energy Information Administration. U.S. Energy Information Administration: How much coal, natural gas, or petroleum is used to generate a kilowatt hour of electricity? U.S. Energy Information Administration. [Internet] May 24, 2021. <https://www.eia.gov/tools/faqs/faq.php?id=667&t=6>.
- [18] The World Bank. The World Bank. The World Bank: The World Bank in Zimbabwe. [Internet] November 15, 2021. <https://www.worldbank.org/en/country/zimbabwe/overview#1>.
- [19] ZERA. Zimbabwe Energy Regulatory Authority: Home - FUEL PRICES IN ZIMBABWE ZWL AND USD. Zimbabwe Energy Regulatory Authority. [Internet] April 20, 2022. <https://www.zera.co.zw/>.
- [20] Statista. Statista: World lithium reserves 2021, by country. Statista. [Internet] June 21, 2021. <https://www.statista.com/statistics/268790/countries-with-the-largest-lithium-reserves-worldwide/>.
- [21] Solargis. Solargis: Solar resource maps of Zimbabwe. Solargis. [Internet] June 29, 2022. <https://solargis.com/maps-and-gis-data/download/zimbabwe>.
- [22] 22. The Solar Hub. The Solar Hub: Cost analysis Solar vs Generator and Solar vs Hybrid. The Solar Hub. [Internet] October 25, 2020. <https://thesolarhub.org/resources/cost-analysis-generator-vs-hybrid/>.
- [23] Renault Group. Renault Group: ELECTRIC MOBILITY - The future of energy storage: are batteries the answer? Renault Group. [Internet] January 7, 2021. <https://www.renaultgroup.com/en/news-on-air/news/the-future-of-energy-storage-are-batteries-the-answer/>.
- [24] Sino Voltaics. Sino Voltaics: Energy Density and Specific Energy of Battery. Sino Voltaics. [Internet] July 5, 2022. <https://sinovoltaics.com/learning-center/storage/energy-density-and-specific-energy-of-battery/>.
- [25] Solar Energy Batteries-A Critical Review. Shukir, Samhar. 2022, Journal of Instrumentation and Innovation Sciences, pp. 25-30.
- [26] Solar Reviews. Solar Reviews: Solar panel maintenance: Everything you need to know. Solar Reviews. [Internet] April 4, 2022. <https://www.solarreviews.com/blog/solar-panel-maintenance-everything-you-need-to-know>.
- [27] Ultralife Corporation. Ultralife: Summary of Li-Ion advantages compared to Lead Acid. Ultralife. [Internet] July 12, 2022. <https://www.ultralifecorporation.com/ECOMMERCE/category/applications/energy/energy-storage>.
- [28] IRG. Infinite Renewables Group: How to choose the best battery for a solar energy system. Infinite Renewables Group. [Internet] July 12, 2022. <https://infinity-renewables.com/how-to-choose-the-best-battery-for-a-solar-energy-system/>.
- [29] Homer Energy. Homer Energy: Homer Software. Homer Energy. [Internet] 2022. <https://www.homerenergy.com/>.
- [30] Huawei Technologies. 5G Power Whitepaper. s.l.: Huawei Technologies Co., Ltd., 2019.
- [31] PVWatts Calculator. PVWatts Calculator. PVWatts Calculator. [Internet] April 1, 2022. <https://pvwatts.nrel.gov/pvwatts.php>.

- [32] The Analytic Hierarchy Process - What it is and how it is used. Saaty, R W. 1987, *Mathl Modelling*, Vol. 9, No. 3-5, pp. 161-176.
- [33] Decision making with the analytic hierarchy process. Saaty, Thomas L. 2008, *Int. J. Services Sciences*, Vol. 1, No. 1, pp. 83-89.
- [34] Zimbabwe Power Company. (2021, November 4). *Zimbabwe Power Company*. Retrieved from Zimbabwe Power Company: <https://www.zpc.co.zw/>

UNDER PEER REVIEW