

# Assessment of Noise Pollution from Petrol Generators in Nigeria: An Analysis of Distance, Capacity and Age Variables

---

## ABSTRACT

Irregular and epileptic power supply in Nigerian, parts of Africa and some other parts of the globe has made electricity generators the primary source of power for domestic and commercial purposes in such places. These generators produce noise pollution in the environment. Noise pollution is hazardous to human hearing and health and it adversely affect plant growth and development. This study investigated the noise generated from five different capacity gasoline generators of varying ages at varying distances, representing the range of petrol generator for both domestic and commercial uses in Nigeria. Five petrol generators of varying capacities 2, 3, 6, 10 and 14 kilo Volt Ampere (kVA), and age 1, 2, 3, 4, 5 years respectively were used for the experiment. The sound level from the generators were measured at varying distances of 0, 5, 10, 15 and 20 m respectively using a digital sound level meter. Two-way Analysis of Variance (ANOVA) was used to test the difference between generators of different ages at the varying distances ( $\alpha = 0.05$ ). The sound intensity decreased as distance from the generators increased. The lowest sound was recorded for the generators of age 1, and increased as the age of the generators increased. For the capacity of generators tested, weighted (A) sound level produced by 1 year old generators at distances 0-20 m from the generator ranged from 60.9-83 dB (A) for 2 kVA generator; 60.2-84.1 dB (A) for 3 kVA generator; 64.7-86 dB (A) for 6 kVA generator; 66.52-88.02 dB (A) for 10 kVA generator; 70-91.8 dB (A) for 14 kVA generator respectively. The study showed that sound levels from generators increased as they aged. The sound levels from all the generators indicate noise pollution, as they are, on average, above the World Health Organization's specified limits of 30 and 70 decibels for indoor and outdoor environments, respectively. Consequently, the sound generated by various petrol generators is a significant source of noise pollution.

*Keywords: Petrol-powered electricity generators; electricity generators; sound levels; noise pollution; World Health Organization (WHO) limits.*

## 1. INTRODUCTION

Mechanical power required in supplying most of the energy needed for global industrialization and motorization is supplied by fossil fuels [1]. Most of the earth's secondary source of energy comes in form of mechanical or electrical energy. The socio-economic development and standard of living of any nation are influenced by its energy generation capacity and per capita power consumption. This is evident with countries such as the United States of America, Australia, Germany and Japan with high per capita power consumption and countries like Bangladesh, Cambodia, Nigeria and Myanmar with low per capita power consumption [2]. Nigeria as a country is highly blessed with abundant natural resources required for electricity generation. These resources include crude oil, coal, tar sands, natural gas, wind, hydro, solar radiation, numerous biofuel sources, as well as othersources of energy such as hydrogen, geothermal and nuclear energy [3; 4]. According to Babatunde *et al.* [5], only 45% of Nigerians have access to electricity supply. This access is both unstable and unreliable due to inadequate generation and incessant collapse of the grid [6]. Thus, to satisfy their energy needs, Nigerians have resulted to the use of gasoline and diesel generators to augment for their power needs both for domestic and commercial purposes.

This development is accompanied with both economic and environmental consequences. Noise pollution is one of the factors listed amongst the major disadvantages of internal combustion (IC) engines in addition to low power production efficiency, high heat loss and air pollution. The pressure wave that results from alternating air pressure pulses of high and low pressure is known as sound [7].

Sound, according to Amos *et al.* [12], is the result of an object vibrating in open air and emitting pressure waves into the air. He noted that the decibel (dB) scale defines the level of sound from 80 to 100 dB as (very loud), 100 to 125 dB (uncomfortable) and 140 dB (threshold of pain), and 70-75 dB as normal. Noise is defined as an undesirable or an unwanted sound [8]. The recurring opening and closing of the exhaust valves of the IC engines creates a pressure pulse from high pressure of exhaust gases being transformed to low pressure. This effect creates sound waves that produces noise. Electricity generators are normally accompanied with vibrations and noise from the engines, which poses environmental, social and health challenges to man and animals [8]. Vibration and noise from electricity generators is a global problem [9]. However, the Nigerian experience is enormous as a result of irregular and epileptic power supply, making electric power generators the primary source of power for domestic and commercial purposes [10; 24]. According Okoro [11], there has been a steady increase in the rate of importation of electric power generators over the years. Babatunde *et al.* [5] estimated the importation of about 60 million generators of varying sizes into Nigeria, used massively in offices, business premises, homes, schools, churches, and others. Shopping or commercial centres are particularly affected, where several units operate simultaneously to run businesses. Unmuffled gasoline and diesel engines produce exhaust noise in the range of 85-100 and 100-125 decibels (dB), respectively [11]. The human ear has the ability to receive noise from 0-140 dB [13]. Noise from 0-80 dB can be considered healthy. As the sound level exceeds 100 dB, it will become sensationally loud to the ear, and about the threshold of 140 dB the sound level will become painful noise to the ear. Prolonged exposure to high decibel levels can lead to hearing damage [11].

Plant growth and development can be adversely affected by noise pollution. Photosynthetic process can be disrupted by high decibels leading to reduced plant production [14]. According to Barberousse [15], stress from induced noise can deter seed germination and thus affect plant production processes. Some species of plants also depend on definite acoustic signals for seed pollination. Excessive noise can disrupt this process, leading to interruptions in ecological interactions and biodiversity. A wide variety of animal species are adversely affected by noise pollution. Loud noises can disrupt natural habitats and behaviours of wildlife, causing altered migration patterns, changes in feeding and breeding habits, and increased stress levels. Excessive noise can disrupt the conveyance of vital signals to animals that rely on acoustic communication for mating, territorial defence, or parental care [16].

According to Mbamali *et al.* [16], sound levels beyond the World Health Organization's (WHO) recommended limit of 70-75dB have been associated with ailments such as hypertension, aberrant foetal development, intense emotions, and inappropriate behaviour. Such noise levels have also been reported to cause instantaneous hearing impairment as well as complaints and friction among neighbours. Chronic exposure to sound at above 105 dB can impair hearing acuity in addition to other associated health risks when exposure is prolonged [17].

The increase in dependency on electricity generators in Nigeria has led to spike in noise pollution both in homes and business places which has a damaging impact on the environment, human, animal and plant health [18]. Effects of noise on humans include: irritation, interference with communication, distraction or loss of concentration, insomnia and high blood pressure. Noise-Induced Hearing Loss (NIHL), a progressive and seemingly undetectable decrease in hearing sensitivity, can be brought on by prolonged exposure to less powerful yet harmful sounds [19].

The range of noise level of a normal electric generator is between 80-105 dB at 6.4 m [20]. This noise level fall into very loud to uncomfortably loud level with respect to sensitivity of human ears. This makes electrical generators a source of noise pollution to the environment. In the United States, for instance, laws and regulations usually permit noise levels in residential homes to not exceed 67 dB, and in industrial locations not exceed 72 dB [20]. Noise pollution from generators has been mostly mitigated using mechanical silencers for active noise control, and acoustic foam or textile materials for passive control methods [21].

Most previous research on noise pollution from petrol generators focused on questionnaire responses from users and assessments of noise pollution from clustered generators [22; 23; 24]. This study aims to provide a more detailed analysis by investigating noise pollution at varying distances from five gasoline generators of different capacities and ages, representing both domestic and commercial uses in Nigeria.


## 2. MATERIALS AND METHODS

### 2.1 Experimental procedure


The experiment was carried out at the Department of Agricultural and Food Engineering, Faculty of Engineering, University of Uyo, Nigeria, lying between latitude  $4^{\circ}32'$  and  $5^{\circ}33'$  N and longitude  $7^{\circ}25'$  and  $8^{\circ}25'$  E. Five petrol generators of varying capacities 2, 3, 6, 10 and 14 kilo Volt Ampere (kVA), and age 1, 2, 3, 4, 5 years respectively were used for the experiment. A digital sound level meter with model no. UT353 mini sound meter [range (30-130 dB); 0.1 dB resolution;  $\pm 1.5$  accuracy; response rate (31.5-8 Hz)] was used to measure the ambient sound level. Thereafter, the sounds levels from the generators were measured at varying distances of 0, 5, 10, 15 and 20 m respectively. The experiment was carried out in three replications. The mean differences of the experimental results were analyzed using Two-way Analysis of Variance (ANOVA) to test the difference between generators of different ages at the varying distances at ( $\alpha = 0.05$ ).

### 3. RESULTS AND DISCUSSION

The results of the estimated marginal mean of sound intensity generated from the various generators at varying distances and years are presented in Figs 1-5. The model relationship of sound loudness from generator capacities against age and distance is as shown in Table 1. The two-way (ANOVA) relationship at ( $\alpha = 0.05$ ) between the ages of generators and distances from the generator and sound level is shown in Table 2.

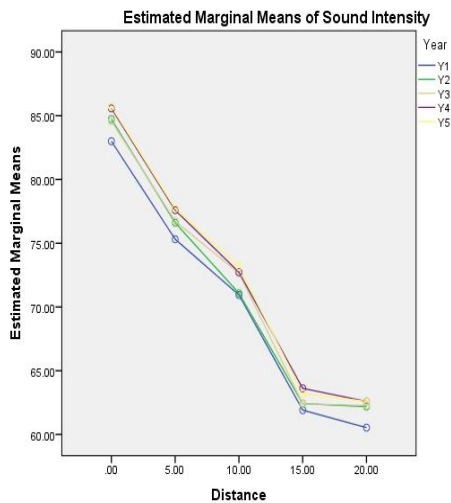


(a)

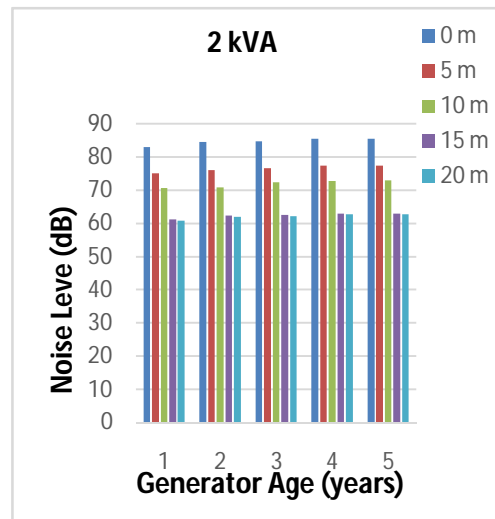


(b)

**Fig. 1(a; b).** Estimated marginal mean of sound intensity generated from 2 kVA generator set at different distances and years

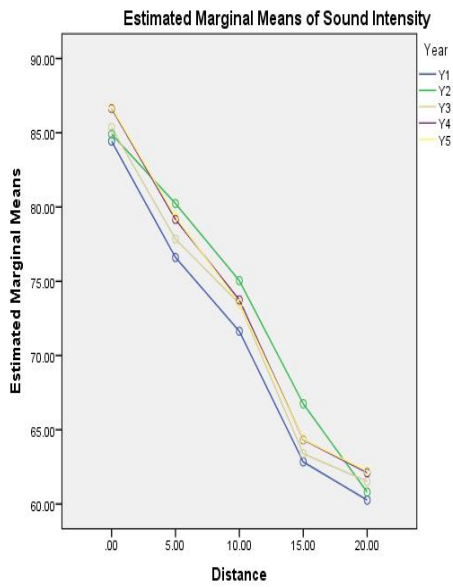


**(a)**

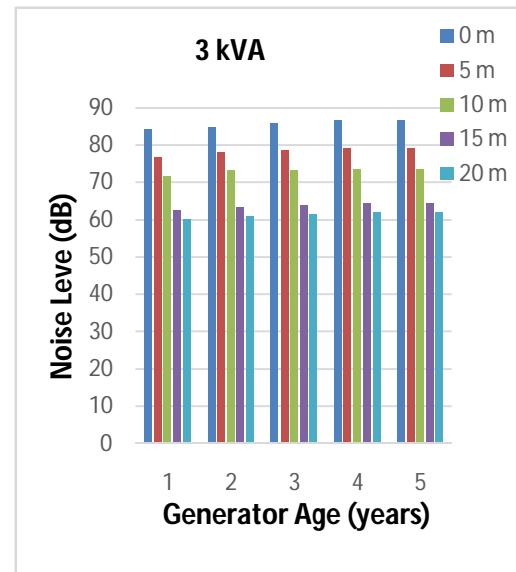


**(b)**

**Fig. 2(a; b).** Estimated marginal mean of sound intensity generated from 3 kVA generator set at different distances and years

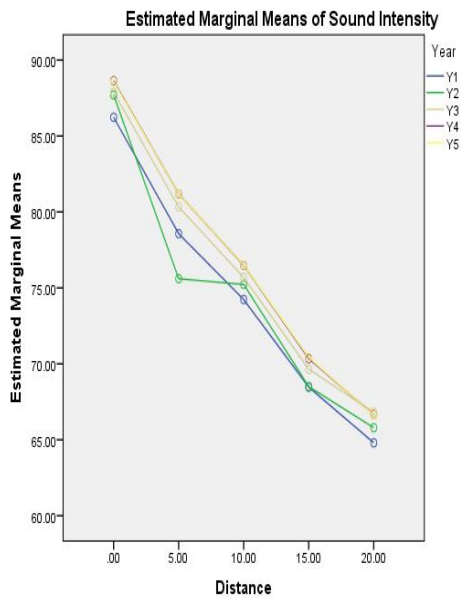


**(a)**

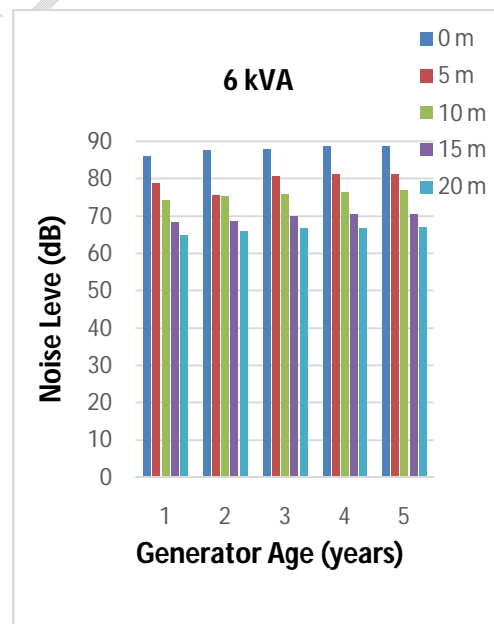


**(b)**

**Fig. 3(a; b).** Estimated marginal mean of sound intensity generated from 6 kVA generator set at different distances and years

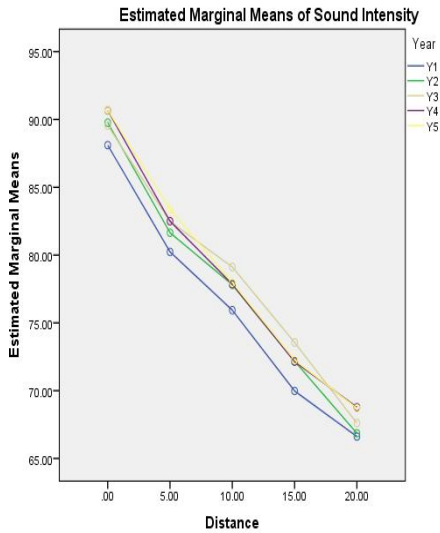


(a)

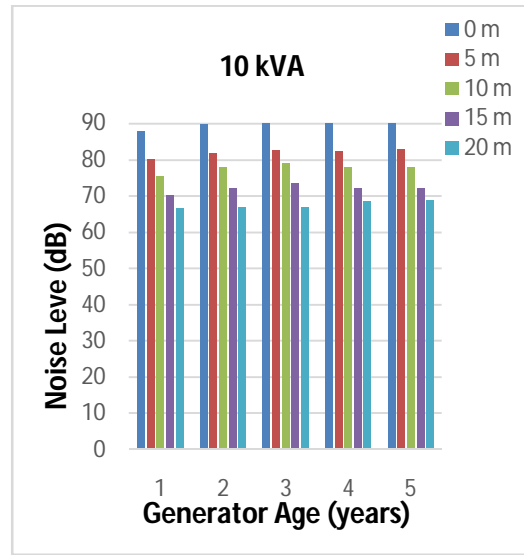


(b)

**Fig. 4 (a; b).** Estimated marginal mean of sound intensity generated from 10 kVA generator set at different distances and years

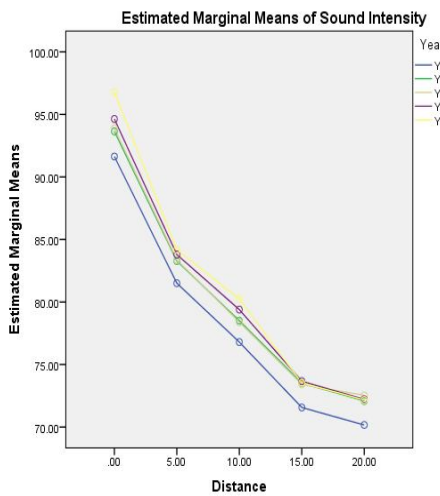

(a)

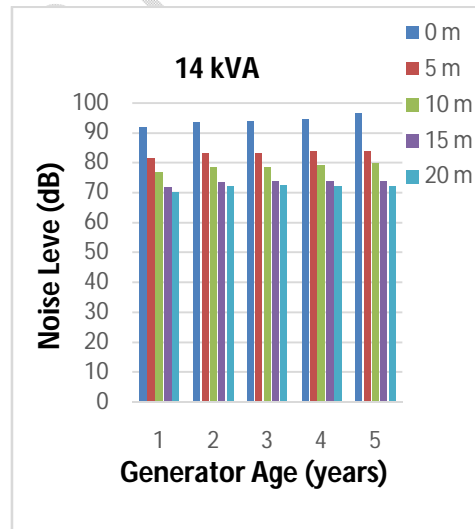

(b)

**Fig. 5.** Estimated marginal mean of sound intensity generated from 14 kVA generator set at different distances and years.

As shown in Fig1, the sound intensity decreased as distance from the 2 kVA generator increased. The lowest noise was recorded for the generators at age 1, and increased as the age of the generators increased. This trend was the same for the higher capacity generators as shown in Figs 2, 3, 4 and 5 respectively. For the capacity of generators tested, the sound level produced by 1 year old generators at distances 0-20 m from the generator ranged from 60.9-83 dB for 2 kVA generator; 60.2-84.1 dB for 3 kVA generator; 64.7-86 dB for 6 kVA generator; 66.52-88.02 dB for 10 kVA generator; 70-91.8 dB for 14 kVA generator

respectively. This trend was the same for all the other generator capacities for 2-5 years. The results are within the range of  $85.33 \pm 1.47$  dB at 3 m distance obtained by [25]. Similarly, [22], obtained mean values of 109.86, 85.95, 83.09, 80.68 and 81.69 decibels at 1-3 m distances from generators capacities of 0.5-5.0 kVA. The noise levels observed in this study are above the World Health Organization specified noise limits of 30 and 70 decibels for both indoor and outdoor cases respectively. Exposure to excessive or repetitive noise over a long duration of time can result in loss of hearing. According to [26], exposure to sound level above the range of 70 to 75 decibels can cause high blood pressure, abnormal fetal changes, extreme emotions and behaviour. Study by [27], indicated that the degree of the effect of vibration on man and animal depends the intensity and extent of exposures. It was observed that the sound levels from the generator increases as the age of the generator increases as shown in Table 1.

**Table 1.** Model relationship of sound loudness from generator capacities against age and distance

Capacity of generator (kVA)	Sound Loudness (decibel)			
	Age of Generator (year)	Distance (m)		
2	1	70.34 ± 8.70	0	84.72 ± 1.01
	2	71.40 ± 8.91	5	76.79 ± 0.92
	3	71.73 ± 8.87	10	72.12 ± 0.98
	4	72.42 ± 8.96	15	62.71 ± 0.73
	5	72.48 ± 9.10	20	62.03 ± 0.82
3	1	71.15 ± 9.20	0	85.61 ± 1.00
	2	73.54 ± 9.50	5	78.64 ± 2.00
	3	72.32 ± 9.30	10	73.48 ± 1.55
	4	73.19 ± 9.47	15	64.33 ± 2.57
	5	73.23 ± 9.48	20	61.38 ± 0.80
6	1	74.46 ± 7.81	0	87.80 ± 0.90
	2	74.57 ± 7.85	5	79.38 ± 2.19
	3	76.07 ± 7.82	10	75.63 ± 0.89
	4	76.66 ± 8.07	15	69.48 ± 0.89
	5	76.66 ± 8.05	20	66.13 ± 0.79
10	1	76.18 ± 7.87	0	89.76 ± 0.99
	2	77.65 ± 8.14	5	82.05 ± 1.11
	3	78.46 ± 7.77	10	77.74 ± 1.07
	4	78.38 ± 8.01	15	72.02 ± 1.02
	5	78.60 ± 8.12	20	67.71 ± 0.97
14	1	78.33 ± 8.04	0	94.11 ± 1.72
	2	80.21 ± 8.07	5	83.22 ± 0.96
	3	80.31 ± 8.09	10	78.67 ± 1.20
	4	80.74 ± 8.37	15	73.14 ± 0.85
	5	80.19 ± 8.20	20	71.82 ± 0.89

**Table 2.** ANOVA effect of age of generator and distance from generator on sound loudness

Generator Capacity (kVA)	Source	Sum of Squares	df	Mean Square	F	Sig.
2	D	5546.983	4	1386.746	16720.404	0.000
	Y	46.020	4	11.505	138.720	0.000
	D * Y	6.486	16	0.405	4.887	0.000
	Error	4.147	50	0.083		
	Total	5603.636	74			

							R Squared =0.999
		D	6009.094	4	1502.274	645.479	0.000
		Y	56.663	4	14.166	6.087	0.000
3		D * Y	33.538	16	2.096	0.901	0.573
		Error	116.369	50	2.327		
		Total	6215.663	74			
							R Squared =0.981
		D	4353.927	4	1088.482	44631.855	0.000
		Y	72.131	4	18.033	739.412	0.000
6		D * Y	36.698	16	2.294	94.047	0.000
		Error	1.219	50	0.024		
		Total	4463.975	74			
							R Squared =1.000
		D	4442.118	4	1110.529	24367.252	0.000
		Y	61.175	4	15.294	335.578	0.000
10		D * Y	16.758	16	1.047	22.981	0.000
		Error	2.279	50	0.046		
		Total	4522.329	74			
							R Squared =0.999
		D	4876.314	4	1219.078	29307.587	0.000
		Y	77.591	4	19.398	466.338	0.000
14		D * Y	16.482	16	1.030	24.766	0.000
		Error	2.080	50	0.042		
		Total	4972.467	74			
							R Squared =1.000

Note: D = Day, Y = Year

Reports of noise as occupational hazard in many workplaces, is common in the iron and steel industry, foundries, sawmills, textile mills, airports, and aircraft maintenance shops, crushing mills, and more [28]. These adverse developments have brought about the need for noise suppression solutions. These include studies on occupational sound levels from some noise sources with respective reference values reported [29]. For instance, mechanical noises from machine parts such as turbines can be listed as accruing from auxiliary equipment such as gearbox, generators, drift drivers, cooling fans, hydraulics [30]. Some machine parts considered as auxiliary equipment constitute considerable amount of noise source which steps are to be taken to minimize to the barest minimum [31]. Evaluation of the effects of noise pollution on the environment for effective control can be achieved by arranging noise maps [32]. According to Caliskan *et al.* [33], noise maps, either regional or local are ideal to be prepared at certain times of the day. Noise map should be made for the stage, tent, generators and other structures that are planned to be used temporarily on the facility or an area [34]. Noise Mapping Guide, [35], studied noise map for generators. Hermes, [36] evaluated the noise generated from commercial and industrial generators, commercial workplaces and industrial production areas. They noted that the parameters such as the source and the path of sound and the receiver should be evaluated distinctly. They observed that the most important factor in reducing noise pollution is to control it at source. Thus, the environment can be protected from the noise generated at the source. Furthermore, noise can be reduced in the area where it spreads. However, noise reduction at the source is more effective. Noise was reduced in different generator types using with different materials with acoustic properties [37].

The values of Probability of F lower than 0.05 as shown in Table 2 indicates a significant difference in noise level of the generators as they age. The probability values are less than 0.05 for all the generators 2, 3, 6, 10 and 14 kVA at age 1, 2, 3, 4 and 5 years respectively across all the distances investigated. Also, the very high of coefficient determination  $R^2$

values are greater 0.9990 indicates a large significant effect. The sound intensity was lowest between year 1-2 and loudest between year 4-5.

#### **4. CONCLUSION**

Investigation of sound levels from different petrol generators of varying capacities and age was carried out. The range of sound levels observed in the study fall into loud and very loud levels relatively to sensitivity to human ears. This makes electrical generators a source of noise pollution to the environment. The sound levels were above the World Health Organization (WHO) specified noise limits for both indoor and outdoor cases respectively. Sound levels beyond the (WHO) recommended limit of 70-75 dB have been associated with disturbances and ailments such as irritation, interference with communication, distraction or loss of concentration, insomnia and high blood pressure, Noise-Induced Hearing Loss (NIHL) and deafness. Nigeria's dependence on electricity generators has caused an increase in noise pollution, both in homes and workplaces, which has a negative environmental impact on human, animal and plant. The noise pollution caused by petrol generators necessitates the development of solutions for noise mitigation.

Disclaimer (Artificial intelligence)

Option 1:

Author(s) hereby declare that NO generative AI technologies such as Large Language Models (ChatGPT, COPILOT, etc.) and text-to-image generators have been used during the writing or editing of this manuscript.

Option 2:

Author(s) hereby declare that generative AI technologies such as Large Language Models, etc. have been used during the writing or editing of manuscripts. This explanation will include the name, version, model, and source of the generative AI technology and as well as all input prompts provided to the generative AI technology

Details of the AI usage are given below:

- 1.
- 2.
- 3.

#### **REFERENCES**

1. Onwe D N, Bamgboye AI. Engine Performance and Exhaust Emissions from Sandbox (Hura crepitans) Seed Methyl Ester. Journal of Engineering Research and Reports. 2022;23(9):1-12.
2. Etukudor C, Abdulkareem A, Ayo O. The daunting challenges of the Nigerian electricity supply industry. Journal of Energy Technologies and Policy. 2015;5(9):25-32.

3. Ibitoye FI, Adenikinju A. Future demand for electricity in Nigeria, *Applied Energy*. 2007;84(5):492-504.
4. Oseni MO. Households' access to electricity and energy consumption pattern in Nigeria. *Renewable and Sustainable Energy Reviews*. 2012;16(1):990-995.
5. Babatunde OM, Ayegbusi CO, Babatunde DE, Oluseyi PO, Somefun TE. Electricity supply in Nigeria: Cost comparison between grid power tariff and fossil-powered generator, *International Journal of Energy Economics and Policy*, 2020;10(2):160-164.
6. Nweke JN, Ekwue AO, Ejiogu EC. Optimal location of distributed generation on the Nigerian power system. *Nigerian Journal of Technology*. 2016;35(2):398-403.
7. Kakadiya YK, Patel BS, Hadiya JP. Design and Comparison of Mufflers Having Different Arrangements for Diesel Engine. *SSRG International Journal of Mechanical Engineering (SSRG - IJME)*. 2007;4(6):24-31.
8. Willis HL, Scott WG. Distributed power generation: planning and evaluation: In Willis HL (ed.): *Power Engineering*. New York: Marcel Dekker, Inc. 2000.
9. Ibitoye FI, Adenikinju A. Future demand for electricity in Nigeria, *Applied Energy*. 2007;84(5):492-504.
10. Yesufu L.A, Ana G, Umar OZ. Knowledge and perception of noise induced health hazards associated with generator use in selected commercial areas in Ibadan, Nigeria. *Int. J. Collab. Res. Internal Med. Public Health Hazards*. 2013;5(9):581-595.
11. Okoro RC. Survey and analysis of noise by generating plants in some parts of the university of Calabar, Calabar, Cross River state Nigeria. *Int. J. Res.Agric. Food Sci*. 2014;1(3):8-15.
12. Amos AE, Olisa YP, Kotingo K. Design and performance evaluation of a soundproof enclosure for a 2.5kVAGenerator. *J. Appl. Sci. Environ. Manage*. 2018;22(12):1975-1978.
13. Rajendra KK, Prakash KS, Gopal S. A review on a noise reduction system in IC engine, *Mechanical Engineering, Kirodimal Institute of Technology, Raigarh. International Journal of Engineering Sciences & Research & Technology (IJESRT)*. 2015;2277-9655.
14. Abhishek B, Kuldip J. Biological relevance of sound in plants. *Environmental and Experimental Botany*. 2022;Vol. 200, (<https://www.sciencedirect.com/science/article/pii/S0098847222001411>)
15. Barberousse A. Impact of road traffic noise on seed germination in urban orchids. *Science of the Total Environment*. 2018;610-611:268-276.
16. Mbamali I, Stanley AM, Zubairu IK. Environmental hazards of fossil fuel generators for electricity supply to buildings in Nigeria. *Canadian Journal on Electrical and Electronics Engineering*. 2012;3(10).
17. Bisong AS, Umana NA, Onoyom-ita V, Osim EE. Hearing acuity loss of operators of food grinding machines in Calabar, Nigeria. *Nigerian Journal of Physiological Sciences*. 2005;19(1-2):20-27.
18. Mbamali I, Stanley AM, Zubairu IK. Environmental, health and social hazards of fossil fuel electricity generators: A users' assessment in Kaduna, Nigeria. *American International Journal of Contemporary Research*. 2012;2(9):2-8.
19. Orikpete OF, Dennis NM, Kikanme KN, Ewim DRE. Advancing noise management in aviation: Strategic approaches for preventing noise-induced hearing loss. *Journal*

of Environmental Management. 2024, Vol 363.  
(<https://www.sciencedirect.com/science/article/pii/S0301479724013999>).

20. McNamara DE, Buland RP. Ambient noise levels in the continental United States. *Bulletin of the Seismological Society of America*, 2004. 94(4): p. 1517-1527.
21. Buluklu HM, Koçyiğit FB, Köse E. Analysis of different methods of suppressing generator noise reaching indoor noise *European Mechanical Science*. 2022; 6(3):161-178.
22. Azodo AP, Idama O, Mezue TC, Owwoye FT. Evaluation and analysis of environmental noise from petrol fuelled portable power generators used in commercial areas. *Journal of Experimental Research*. 2018;6(1):8-13.
23. Onwuka SU, Ezigbo CM, EnechePSU. Assessment of noise pollution from powergenerating sets: a case study of Nnewi-North L.G.A., Nigeria. *Journal of Scientific Research & Reports*. 2017;16(3): 1-12.
24. Azodo AP, AdejuyigbeSB. Examination of noise pollution fromgenerators on the residents of Obantoko, Ogun State, Nigeria. *Asian Journal of Engineering, Sciences & Technology*. 2013;3(1): 31-41.
25. Jibiri NN, Olaluwoye MO, Ayinmode BO. Assessment of health effects of noise and vibration levels at major business complexes and markets in Ibadan metropolis. *Nig. J. Health Sci*. 2015;5(4):69-75.
26. Osuntogun BA, Koku CA. Environmental impacts of urban road transportation in South-Western states of Nigeria. *J.Appl. Sci*. 2007;7(16):23-58.
27. Segerink FB, Korterik JP, Offerhaus HL. Vibration transfers to measure the performance of vibration isolated platforms on site using background noise excitation. *Rev. Sci. Instrum*. 2011;82(6):065-111.
28. Gerges S, Sehrndt GA. 5 Noise Sources. *Occupational Exposure to Noise: Evaluation, Prevention and Control*. Federal University of Santa Catarina, Mechanical Engineering Department, Noise and Vibration Laboratory. (2001)
29. Berger EH, Neitzel R, Kladden CA. Noise navigator™ sound level database with over 1700 measurement values EAR 88-34/HP 3M Personal Safety Division E-ARCAL Laboratory, Univ. of Michigan, Dept. of Environmental Health Science, Ann Arbor, (2015) MI June 26, Version 1.8. E.T: 20.12.2021.
30. Fıçıcı F, Dursun B, Gokcol C. Investigation of Noise Originating from Wind Energy Systems, SAU. *Journal of Science*. (2007);2(1):54-62.
31. Victoria E. Noise from Industry in Regional Victoria Recommended Maximum Noise Levels from Commerce, Industry and Trade Premises in Regional Victoria. Publication 1411. (2011) Authorised and published by EPA Victoria, 200 Victoria Street, Carlton. E.T: 05.07.
32. Wabarakatuh AW, Sejahtera S. Guidelines for Environment Noise Limits and Control, hereby Published by the Department of Environment is a new publication to supersede the previously published Planning Guidelines for Environmental Noise Limits and Control. (2007).
33. Çalışkan M, Bakırcı E. Mapping the Environmental Noise Emitted from the Highway and Determining Its Effect on the Exterior of Buildings, 9th National Acoustics Congress, METU Culture and Congress Center, Ankara. (2011).
34. Technical assistance project for the capacity to implement the environmental noise Directive Europe Aid/131352/D/SER/TR Technical Assistance Project for the Capacity to Implement the Environmental Noise Directive, (2015). Turkey Annex A:

Catalog of Possible Noise Reduction Measures, Output 8.1, APPENDIX A: Possible noise reduction measures Catalog 28 August 2015. E.T: 24.07.2021

35. Noise Mapping Guide. Harmonization and Implementation of EU Directives on Environmental Noise Assessment and Management European Union Twinning Project. TR/2004/IB/EN/ 02 Noise Mapping Guide. (2008)
36. Hermes M. Understanding commercial and industrial generator noise, Generac Power Systems, 1-3, E.T:08.07. (2021).
37. Toprak R, Akturk N. Raylı ulaşım sistemlerinin neden olduğu gürültü ve çevresel etkileri. Türkiye Muhendislik Haberleri. (2002):417, 33.

UNDER PEER REVIEW