

# ECONOMIC ANALYSES OF INTEGRATING SOLAR INVERTER INTO THE EXISTING ENERGY SYSTEMS IN NIGERIAN HEALTHCARE CENTERS

1

---

## ABSTRACT

**Aim:** To examine the economic implications of integrating solar inverter into existing energy systems in healthcare facilities.

**Significance of Study:** This study investigates the economic feasibility of integrating solar photovoltaic (PV) systems with existing energy infrastructure at a healthcare facility in Nigeria. Using HOMER Pro software to model and simulate different system configurations, with focus on incorporating solar PV, energy storage, alongside existing grid supply and generators.

**Problem Statement:** Reliable electricity supply is crucial towards efficient healthcare delivery in a developing country like Nigeria, where national grid faces constant outages. Many healthcare centers depend on diesel generators for backup, meaning high operational costs and environmental impacts.

**Discussion:** Analysis covered the facility's energy demand patterns, solar resource potential, and the costs associated with the different systems components over a 25-year project lifetime. Results showed that the optimal system configuration is the system comprising solar PV panels, lead-acid batteries, and a system converter alongside the existing grid and diesel generator. This system has a significantly lower net present cost (NPC) of \$382,263, compared to the base case scenario of \$1,663,158, which relies totally on grid electricity and the diesel generator. The levelized cost of energy (LCOE) for the hybrid system is \$0.139/kWh, also much lower than base case LCOE of \$0.642/kWh. While initial investment cost for this system posed a challenge, the study demonstrated a payback period of approximately 4.8 years, with return on investment of 16%, and an internal rate of return (20.3%).

**Conclusion:** The findings demonstrated the economic viability and potential benefits of integrating solar PV systems in the healthcare sector, providing a pathway towards sustainable energy solutions and improved healthcare delivery in Nigeria.

*Keywords: [Solar photovoltaic, Healthcare, Software, Energy storage, Renewable energy.]*

## 1. INTRODUCTION

Sustainable growth demands that energy supply be affordable and consistent at the same time [1]. Nigeria's healthcare system is faced with a number of challenges, foremost of which is lack of reliable power supply [2]. Unstable and inadequate electricity supply in Nigeria makes the problems currently experienced by healthcare facilities worse, by causing interruptions in vital medical services, jeopardizing patient care, and making it more difficult to store vaccinations and prescription drugs [3]; [4]. This often hinders developments and causes loss of lives in extreme situations. Most health-care centers often fall back to diesel generators, whose high cost of maintenance weighs down their already stretched budgets

[5]. Addressing these energy challenges in the healthcare sector is crucial for ensuring sustainable healthcare delivery and achieving better health outcomes for the Nigerian population. The integration of solar PV with energy supply from the national grid may serve as potential solution to some of these energy challenges [6]. Solar energy is one of the most promising of the renewable energy resources in Nigeria due to its apparent abundance. Solar generating potential of Nigeria is about  $7.1\text{Kw/m}^2/\text{day}$ , featuring as one of the highest in Africa [7]. Energy radiated from the sun is about  $3.8 \times 10^{23}$  Kw, which is 1.082 million tons of oil equivalent (mtoe) per day. This is about 4000 times the current daily crude oil production in Nigeria and about 13,000 times the natural gas daily production, based on standard energy units [8]. Solar photovoltaic (PV) adoption in Nigeria has been steadily increasing in recent years, driven by factors such as: declining solar panel costs, government incentives, and making it promising towards the actualisation of Nigeria's Sustainable Development Goals, SDGs [9]; [10]. Solar inverters are responsible for converting Direct Current (DC) output produced by solar panels into Alternating Current (AC) electricity, making it compatible with the national grid or local networks [11]. The conversion process is essential for enabling the integration of solar energy into existing energy infrastructures, ensuring its usability for various applications [12]. The role of solar inverters are critical in enhancing operational and technical performances of solar power plants by maintaining optimal voltage levels, thereby stabilizing the output of solar power systems [13]. This capability for voltage conversion and stabilization not only enhances the efficiency of solar energy utilization, but also contributes to the overall stability and resilience of the electrical grid to reinforce the viability and sustainability of renewable energy sources [14]. In the mid-80s, introduction of grid-connected PV systems led to further development of solar inverters, such that manufacturers designed inverters with these capabilities, alongside output and efficiency [15]. Technological advancement also facilitated the development of complex inverters, such as the Maximum Power Point Tracking, MPPT inverters [15]. Towards the end last millennium (1990s), more economical PV systems for residential areas came to existence with the introduction of transformerless inverters [16]. While solar energy has been the primary focus of this study, it is essential to reflect on the potential contributions of other renewable energy sources in Nigeria's energy transition. Research findings have investigated the prospects of biomass energy in Nigeria, particularly from agricultural residues and municipal solid waste [17]. By leveraging on Nigeria's abundant biomass resources, the author indicated that the country can make significant strides towards achieving its renewable energy targets, and, reducing heavy reliance on fossil fuels. In the context of Nigeria's energy sector, fossil fuels reign supreme, contributing over 80% of the national grid's electricity [18]. In spite of this heavy reliance on fossil fuel, out of a total population of about 162million people, up to 40% of these Nigerians do not have access to electricity [19]. Energy is of paramount importance, as it is widely useful in all aspects of human endeavour for technological advancements, and can exist in several forms [20]; [21]. In its own case, solar energy is sourced from arresting sun's radiant energy and afterwards converting it into heat and electricity, among others [21]. Solar PV systems hold significant importance in healthcare settings due to their potential to enhance energy efficiency, reduce operational costs, and improve access to healthcare services. Moreover, solar energy systems contribute to mitigating environmental pollution and reducing carbon emissions, thus promoting a healthier environment for patients and staff. Recent findings highlighted the positive impact of solar energy adoption in healthcare facilities, especially for sustainability in resource-limited settings [22]. Although investment decisions are affected by upfront costs, operating expenses and revenue, economic sustainability of energy storage integration is still being debated [23]. Therefore, thorough cost-benefit studies are necessary in order to evaluate the financial implications of energy storage projects to be able to advise investors, project developers and legislators. A recent study analyzed the cost-effectiveness of the grid-connected energy storage systems in mitigating peak demand and reducing consumer's electricity costs [24]. Furthermore, the importance of a holistic assessment involving financial

viability and environmental benefits has been emphasized [25]. As most studies analyze standalone solar PV systems, research directly exploring the economic feasibility of integrating solar with existing energy infrastructure systems in healthcare facilities is scarce. Moreover, grid electricity tariffs can differ considerably across Nigerian regions. Most researches do not always account for this regional variation, leading to potentially inaccurate economic assessments. More studies are needed that incorporate location-specific energy costs into the Cost-Benefit Analysis (CBA) for solar integration projects. Thus, this study was centered on providing useful insights for decision-makers in the public and private sectors, by evaluating the costs of purchasing, installing, and maintaining solar inverters alongside current energy infrastructure. It also evaluated potential savings derivable, when reliance on traditional energy sources and grid-supplied electricity become reduced. Therefore, the study was aimed at conducting an economic analysis which involved combining existing energy production and storage systems with solar inverters at a health care center. Hence, the objectives of this study include (i) Assessing the economic feasibility of integrating solar inverters into healthcare facilities in Nigeria by analyzing initial investment costs, operational expenses, and potential energy savings associated with solar energy adoption. (ii) Evaluating the technical feasibility of integrating solar inverters with existing energy systems in healthcare facilities, considering energy consumption patterns and backup power requirements. (iii) Investigating the potential economic benefits of solar inverter integration in healthcare facilities, including improved energy resilience, reduced reliance on unreliable grid infrastructure, and enhanced sustainability of healthcare services in Nigeria. In terms of justification, installing solar inverters alongside energy supply from national grid in medical centers will guarantee an improved supply of electricity for critical medical equipment, vaccine and drug refrigeration, emergency lighting, and life-saving medical supplies. Additionally, solar inverter integration has potential for lowering short- and long-term energy expenditures; providing a viable and affordable substitute for diesel generators, which are frequently utilized as backup power sources.

## **2. MATERIAL AND METHODS**

The procedures for identifying, obtaining data and analysing collected data are as presented in this section. Some of the equipment and materials used log book, solar resources data, healthcare facility being studied, costs records book, healthcare facility's historical records on national grid supply and healthcare facility's records on diesel generator and fueling.

### **2.1 Setting**

This study was focused on a privately-owned healthcare facility in Ikeja, Lagos State, Nigeria.

### **2.2 Data Collection**

#### **2.2.1 Primary data**

Historical data on daily load consumption was collected at the facility. For this, the hourly load profile data for a 24-hour period was obtained, capturing the facility's energy demand at different times of the day. The quantitative data used were collected through primary and secondary methods. Collection of primary data was by means of a walk-through audit of the facility [26] to determine the energy consumption of the medical equipment and facility as a whole.

#### **2.2.2 Secondary data**

Historical resource data, including the monthly averages of solar Global Horizontal Irradiance (GHI) and temperature data for the facility's location was acquired from government resources and solar resource data bases of the National Renewable Energy Laboratory Database. Relevant technical specifications and cost information for various

system components, such as solar PV panels, batteries, converters, and diesel generators, were collected through market research. The secondary data were obtained by assessing the facility documents and market research to gather information on equipment lifespan, costs of Solar PV components and assembly. Information on various solar PV components specifications was also obtained. Data on the solar resource assessment, including solar irradiance level and average monthly temperatures for the location of the healthcare facility in question were obtained from solar resource databases.

**Table 1. Information Collectable from Energy Audits (Source: [26])**

<b>S/n</b>	<b>Information generated</b>	<b>Definitions</b>
1	Process flowchart	A diagram that shows the sequence of operation
2	Equipment schedule	The collation of every used equipment.
3	Load summary	This is a concise summary of total load of each equipment class used in the factory and also the total load as well as the number of all the appliances in factory, it gives a quick look at what the heavy-duty appliances are.
4	Load distribution chart	This is graphical representations of the load summary via pie chart. It shows the relationship between each equipment and their loads
5	Energy consumption chart	This is a bar chart and pie chart representation of the energy consumption pattern, it shows the relationship between each equipment class and their energy consumption
6	Load intensity chart	Sets of charts that determines what the load intensive space/room are in the factory, by comparing the amount of load in each space to the area of the space
7	Energy intensity chart	Sets of charts that determines what the energy intensive space/room are in the factory, by comparing the daily, weekly or monthly energy consumption of each space to the area of the space
8	Peak load profile	The peak load curve is a graphical representation of the load to time period relationship of peak load equipment (equipment connected for both short and long periods of time). It gives a snapshot of energy consumption per time period in a day of peak load Equipment.
9	Base load profile	The base load curve is a graphical representation of the load to time period relationship of base load equipment (equipment connected for a long period of time). It gives a snapshot of energy consumption per time period in a day for base load equipment
10	Load profile (Base and Peak Load)	Chart that compares the base load profile and peak load profile.

### **2.2.3 Consumption analysis**

To accurately model and analyse the energy system integration, an understanding of the healthcare facility's energy consumption patterns was essential. Following the information available in Table 1, data were collected during the walk-through audit of the healthcare facility for energy consumption analysis.

The following steps were undertaken to conduct the energy consumption analysis:

#### *1. Load Profile Data Collection*

Historical hourly load profile data for a typical 24-hour period was collected from the healthcare facility. This data captured the fluctuations in energy demand throughout the day, allowing for the identification of peak demand periods and overall daily energy consumption patterns.

#### *2. Load Characterisation*

The collected load profile data was analyzed to determine key parameters such as:

- Average daily energy consumption (kWh)
- Peak daily load (kW)
- Minimum daily load (kW)
- Distinct peak demand periods

This characterization provided insights into the facility's energy requirements and informed the sizing and configuration of the integrated energy system components.

The interaction between the existing energy systems, storage systems, and the solar inverter system was also simulated using the HOMER pro software to assess how they can meet the facility's energy needs and optimize energy usage.

### **2.3 System Modeling**

The studied health-care system was modeled by specifying the load profile of the facility, designing the configurations and objectives of the system, and assessing the energy supply status and availability of the Solar PV systems. HOMER pro software was used to simulate the electricity generation potential of the solar inverter hybrid system under observation based on collected solar irradiance data and system specifications. For this study, three configurations were focused on in the course of the modelling.

### **2.4 Economic Analysis**

Economic tools and models were used to investigate the financial viability of this study. Using the cost-benefit analysis (CBA) as a tool, the potential cost savings from reduced grid dependence and fuel costs were compared to the initial investment. Ongoing maintenance costs were also established. Carrying out a cost-benefit analysis involves a structured process of identifying, measuring, and comparing the projected costs and benefits of a project or intervention. The simulations were based over a period of twenty-five (25) years.

### 2.4.1 Procedure for economic analysis

1. Defining the Project: This was defined as integration of solar PV systems into the existing energy infrastructure of the healthcare facility.

2. Identification of Costs and Benefits:

*Costs:* A list of all anticipated costs associated with the project was made. This includes:

*Direct Costs:* These are tangible expenses directly linked to the project.

*Indirect Costs:* less obvious costs like infrastructure upgrades needed, or potential productivity losses during implementation.

*Benefits:* The expected benefits of the intervention were identified.

3. Quantification of Costs and Benefits: Monetary value was assigned to both the costs and benefits where necessary. This allowed for a more direct comparison.

It might be challenging to assign a monetary value to some benefits like improved quality of life. In such cases, these limitations were acknowledged and qualitative descriptions were employed alongside the quantitative data.

4. Establishment of a time frame: This is the timeframe over which costs and benefits are being considered. This is important because benefits may accrue over time, while some costs might be upfront. The simulation period was set at 25 years.

5. Cost-Benefit Analysis: This method became necessary in assigning a monetary value to both costs and benefits. Likewise, net benefit (benefits minus costs) was calculated to assess the overall economic viability of an intervention.

Other financial models were employed to perform calculations for: payback period, Internal Rate of Return (IRR), Net Present Cost (NPC), and Levelized Cost of Energy (LCOE).

$$1. \text{ Cost Benefit Analysis (CBA)} = \frac{\sum \text{Present Value of Future Benefits}}{\sum \text{Present Value of Future Costs}} \dots\dots\dots (1)$$

$$2. \text{ Internal Rate of Return (IRR)} = r_a + \frac{NPV_a}{(NPV_a - NPV_b)} (r_b - r_a) \dots\dots\dots(2)$$

Where:

$r_a$  = Lower discount rate chosen

$r_b$  = Higher discount rate chosen

$NPV_a$  = Net Present Value at  $r_a$

$NPV_b$  = Net Present Value at  $r_b$

$$3. \text{ Net Present Cost (NPC)} = \sum_{n=1}^N \frac{C_n}{(1+r)^n} \dots\dots\dots(3)$$

Where:

$N$  = Total number of time periods

$n$  = Time period

$C_n$  = Net cash flow at time period

$r$  = internal rate of return

$$4. \text{ Levelized Cost Of Energy (LCOE)} = \frac{\sum \frac{(I_t + M_t + F_t)}{(1+r)^t}}{\sum \frac{E_t}{(1+r)^t}} \dots\dots\dots(4)$$

Where:

$I_t$  = The initial cost of investment expenditure in the year  $t$

$M_t$  = Maintenance and operations expenditures in the year  $t$

$F_t$  = Fuel expenditures in the year  $t$  (If applicable)

$E_t$  = The sum of all electricity generated in the year  $t$

$r$  = discount rate of the project

$n$  = Life of the system

5. Payback Period

a.  $\text{Simple Payback Period} = \frac{\text{Initial Investment or Original Cost of the Asset}}{\text{Cash Inflows}} \quad (6)$

b.  $\text{Discounted Payback Period} = \frac{\text{Initial Investment}}{(\text{Discount Rate} \times \text{Annual Cash Flow})} \quad (7)$

### 3. RESULTS AND DISCUSSION

In this section is showcased the results obtained from appraising the economics of integrating solar inverter into existing energy system at an Ikeja-based healthcare facility.

#### 3.1 Setting



**Fig. 1. Map showing Ikeja, Lagos, Nigeria, the location of the healthcare facility (Source: [27]).**

Ikeja, Lagos, Nigeria (Figure 1), the setting for this work is located on geographical coordinates  $6.6018^{\circ}$  N,  $3.3515^{\circ}$  E [28].

#### 3.2 Data Collection

Having carried out all the procedures as described under section 2.2 (walk-through audit), it was deduced that the healthcare facility installed both national electricity grid, with a 50 kV generator serving as power backup. Table 2, which gives details on the average hourly consumption of the facility for 24 hours, was obtained. From the information available in Table 2 (and the appendix), the average daily consumption of the healthcare facility is 29.02 kW, while the total daily load (averagely) is 172.24 kW. The peak daily load is 12.33kW while the minimum daily load is 2.13kW. Also shown in Figure 2 is the hourly load consumption trend.

**Table 2. Load Profile of Facility**


Hour	Load (kW)
0 – 1	2.13
1 – 2	2.15
2 – 3	2.33
3 – 4	2.21
4 – 5	2.41
5 – 6	3.16

---

6 - 7	5.12
7 - 8	7.32
8 - 9	8.11
9 - 10	12.32
10 - 11	12.21
11 - 12	12.33
12 - 13	8.23
13 - 14	8.34
14 - 15	8.14
15 - 16	8.46
16 - 17	9.04
17 - 18	12.02
18 - 19	12.32
19 - 20	12.13
20 - 21	9.47
21 - 22	10.43
22 - 23	9.16
23 - 24	5.02

---

UNDER PEER REVIEW

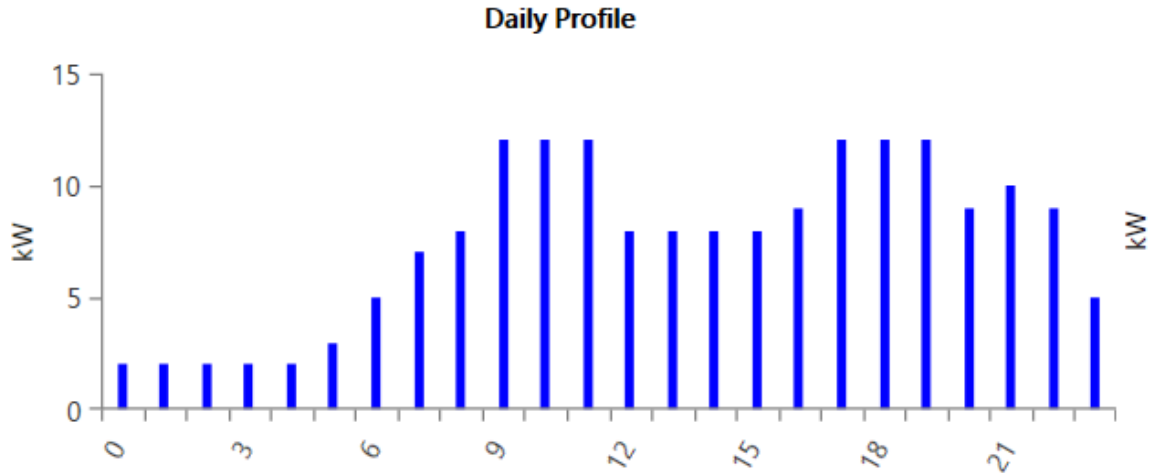


**Fig. 2. Hourly Load Profile**


This chart signifies an increase in load demand between 9am-12pm and 4pm-7pm, indicating that these are the periods the healthcare facility usually operates heavy equipment, thereby increasing the load demand.

### 3.2.1 Solar resource data

Also obtained include the data (downloaded) detailing the Solar GHI and the temperature for every month of the year. Figure 3 shows the Solar GHI while Figure 4 shows the temperature distribution.

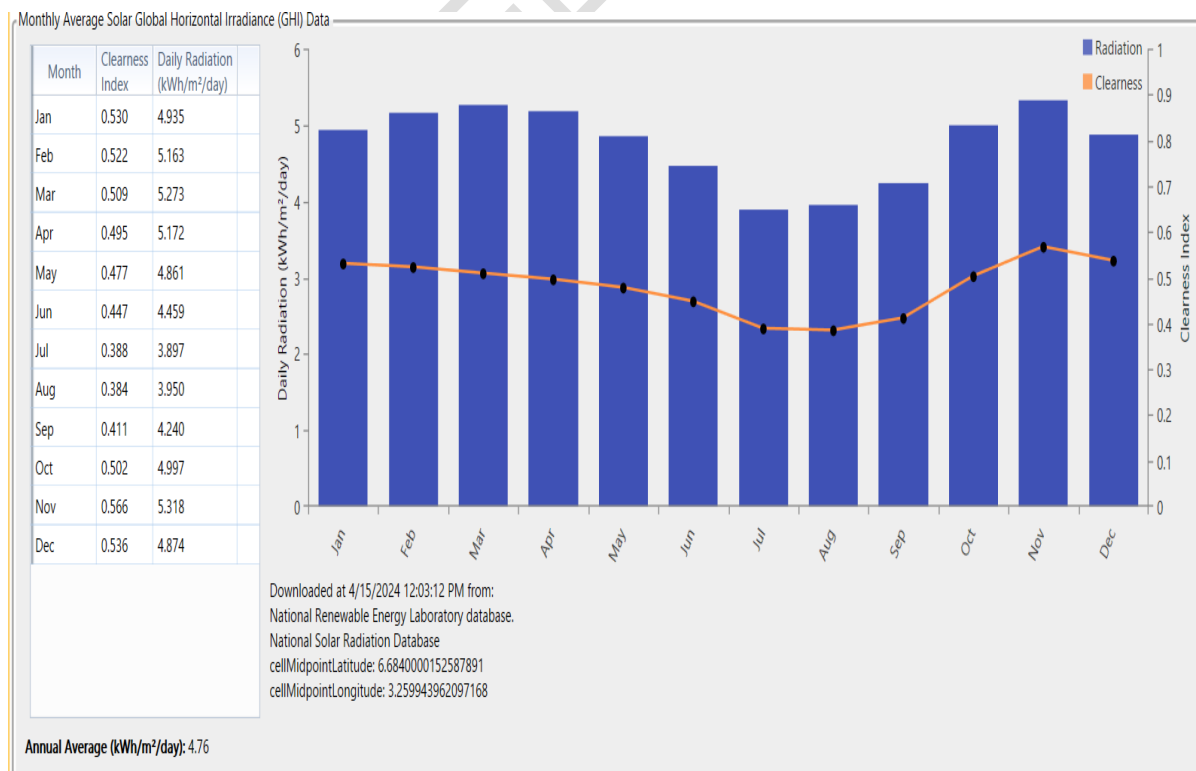

**Fig. 3. Solar GHI for facility Location (Source: [29])**

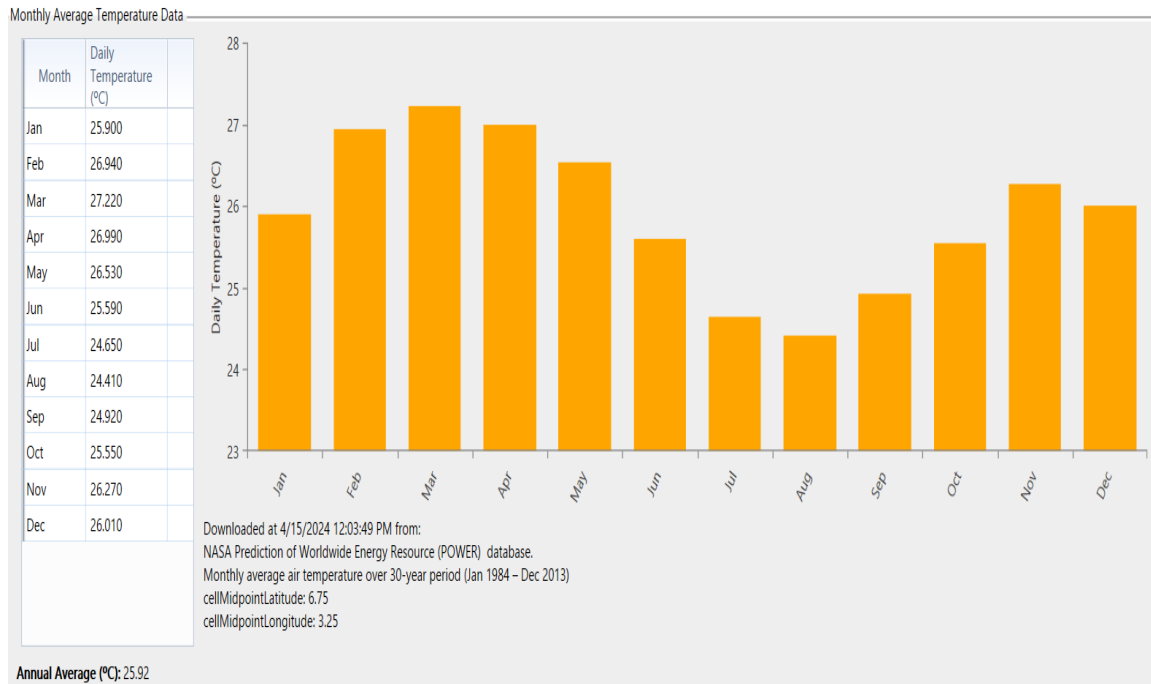

**Fig. 4. Monthly average temperature data for facility location (Source: [29])**

From the Figures 3 and 4, it can be seen that the months of Feb, Mar, Apr, May, Nov and Dec have the highest radiation values, indicating that these are months wherein the Solar PV system can generate peak electricity. With August having the lowest radiation level, it means it is the month with the lowest solar energy potential.

### 3.2.2 Costs related data

The relevant technical specifications and cost information for the systems components, such as solar PV panels, batteries, converters, and diesel generators, collected through market research and secondary sources include: information on size, the cost of purchase, installation, operation, maintenance, and the useful life of the equipment. These are as presented in Table 3. The Solar PV system considered for this modelling consists of a generic flat plate PV and 12v, 1kWh lead acid battery as storage.

**Table 3. Cost of System components**


Equipment	Size	Capital Costs (\$)	Replacement Costs (\$)	O & M costs (\$)	Useful Life
Solar Panels	0.325 Kw	200	190	5.00	25 years
50 kVa Generator	50 kVa	0.0	3,000	1.50	15,000 hours
System	10Kw	1,500	1,500	10	15 years

Converter						
Battery	12v, 2.64kWh	200	200	2.00	18 years	

The Base system already has a 50Kva generator as a backup source bringing the capital cost of the generator to \$0.

**3.3 System Modelling**

The three major energy sources put into consideration for in the study include: 1) Grid electricity, 2) a 50kva backup generator currently in use at the facility and 3) the proposed Solar PV system. Figure 5 shows a schematic model of the system detailing the converter, batteries, PV system Generator, and load profile.

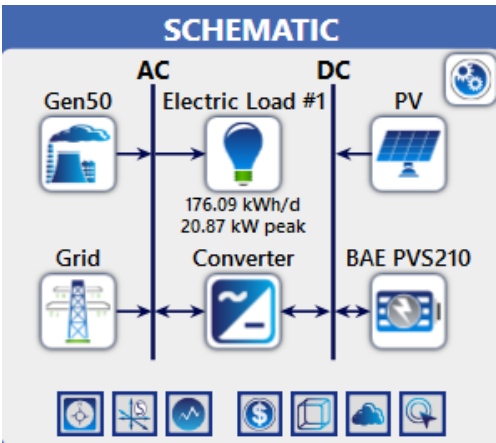


**Fig. 5. Schematic model of the system**

The healthcare facility under study currently relies solely on Grid electricity, and with a 50Kva Generator as power backup. The facility combines these two sources to achieve a 24-hour power supply. Altogether, the three configurations considered in this study include: Base configuration (GG – Grid electricity and Generator, currently in use in the healthcare center under consideration); Test A configuration (SGG – Solar, Grid electricity and Generator) configuration; Test B configuration (SG – Solar and Grid electricity).

**3.4 Economic Analysis**

**3.4.1 Results of economic analysis of base system**

With the existing energy system in the healthcare facility taken as the base configuration for the first simulation, over a period of 25 years, results, as shown in Figure 6 were obtained. Table 4 also presents the details of the economic analysis of the system.

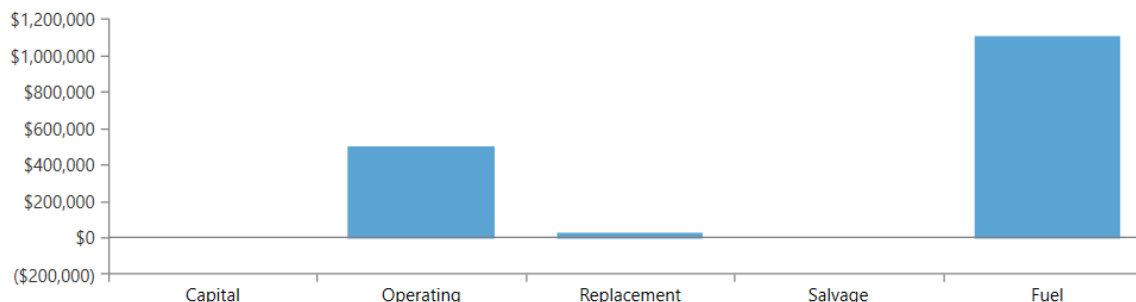

**Fig. 6. Cost distribution for Base system over 25 years**

There was no capital cost incurred for the generator and grid, due to the fact that the system is already under usage. The diesel generator incurs majority of the costs (replacement costs, operating and maintenance (O and M) costs, and high cost of fuel. Over the length of the simulation, 27,447 liters of diesel fuel will be consumed, bringing the total fueling cost to \$1,113,849.16 with an average daily consumption of 75.2L. This poses a major problem for the base system, due to inconsistent grid supply, hence heavy dependence on backup and invariably, high cost of fuel and operating.

**Table 4. Net Present Cost of Base System**

Component	Capital (\$)	Replacement (\$)	O & M (\$)	Fuel(\$)	Salvage (\$)	Total (\$)
50 kVa Capacity Generator	0.00	37,908.91	324,013.67	1,113,849.16	472.39	1,475,299.35
Grid	0.00	0.00	187,858.76	0.00	0.00	187,858.76
System	0.00	37,908.91	511,872.43	1,113,849.16	472.39	1,663,158.11


### 3.4.2 Results of economic analysis of the solar-grid hybrid system configuration

On simulating another (GG) system (Test B configuration), also over a period of 25 years, the system recorded a total NPV of \$422,558.31, with majority of the costs being associated to capital and operating costs, as shown in Figure 7. While this is significantly lower than the NPC of the base system, it also poses a challenge of high initial setup cost and partial reliance on unstable grid electricity without provision for a backup in a case of unmet electricity demand by the solar PV system. Table 5 covers the economic analysis of the Solar-Grid system.

**Table 5. Net Present Cost of Solar-Grid Hybrid System**

Component	Capital (\$)	Replacement (\$)	O & M (\$)	Fuel (\$)	Salvage (\$)	Total (\$)
BAE PVS Block 12V 210	72,400.0	134,429.79	29,177.35	0.00	104,503.85	131,503.29

Grid	0.00	0.00	95.13	0.00		95.13
Generic Flatplate PV	138,927.94	0.00	139,970.62	0.00	0.00	278,898.56
System Converter	5,593.92	9,368.73	1,502.91	0.00	4,404.22	12,061.34
System	216,921.86	143,798.51	170,746	0.00	108,908.06	422,558.13

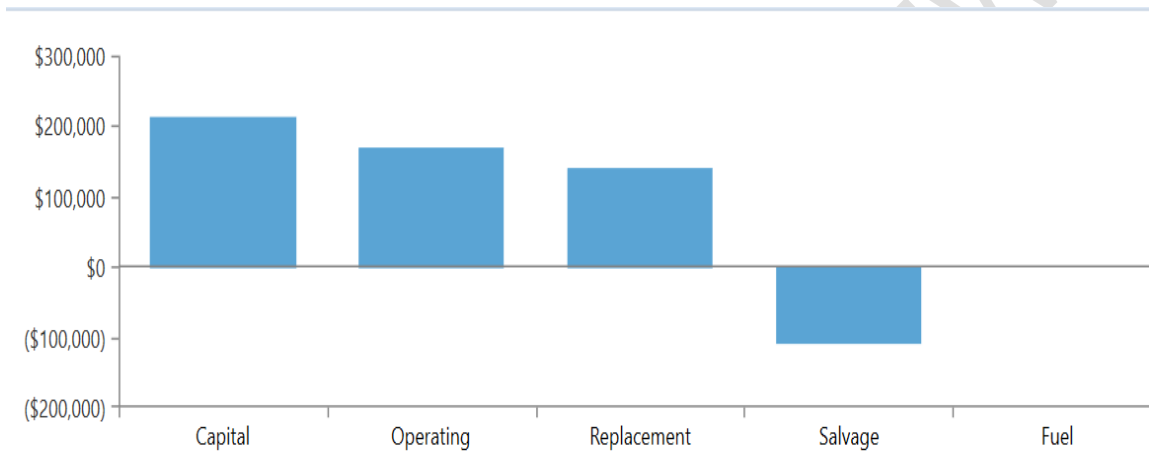

**Fig. 7. Cost distribution of Solar-Grid system over 25 years**

This hybrid configuration has an LCOE of \$0.1436 and a yearly operating cost of \$5102.62, which are also lower than those of the base configuration. However, with an initial capital of \$216,922, ROI 12.5% of and a discounted payback period of 5.28 years, this may not be the most economical option for the healthcare facility.


### 3.4.3 Results of economic analysis of the Solar-Grid-Gen. system configuration

On simulating the Solar-Grid-Gen. (SGG) system (Test A) configuration over a period of 25 years, results, as shown in Figure 8 were obtained. Table 6 also presents the details of the economic analysis of the system.

**Table 6. Net Present Cost of Hybrid System**

Component	Capital (\$)	Replacement (\$)	O & M (\$)	Fuel (\$)	Salvage (\$)	Total (\$)
BAE PVS Block 12V 210	50,400.0	87,062.93	20,311.30	0.00	50,912.09	106,862.14
50Kva Capacity	0.00	0.00	5,682.33	19,312.11	5,975.77	19,018.66

Generator						
Grid	0.00	0.00	856.77	0.00		856.77
Generic Flatplate PV	123,678.4	0.00	124,606.68	0.00	0.00	248,285.14
System Converter	3,358.13	5,624.21	902.22	0.00	2,643.93	7240.63
System	177,436.5	92,687.13	152,359.31	19,312.11	59,531.79	382,263.33
	8					

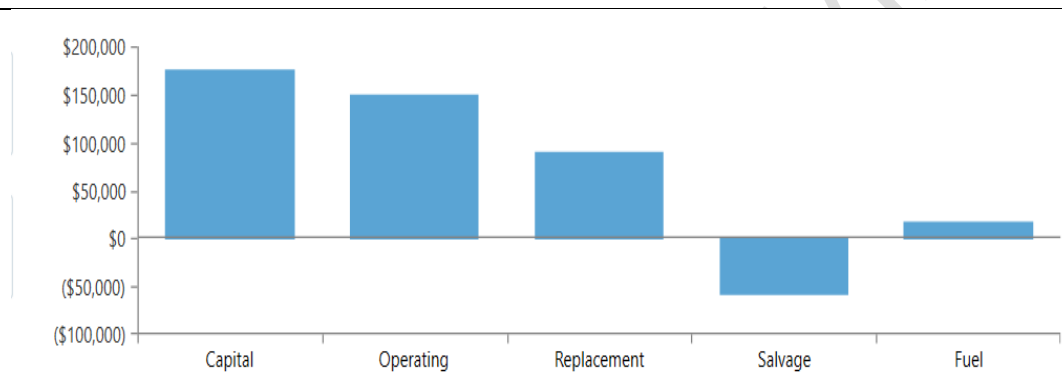

**Fig. 8. Cost distribution of Solar-Grid-Generator system over 25 years**

The total NPC for the SGG system is \$382,263.33 with the majority coming from capital, operating and maintenance costs, as shown in Figure 8. The system also generates \$59,531.79 in salvage costs. The SGG system can be said to be almost independent of grid electricity with, a total purchase of 113 kWh/yr at a cost of \$856.77. This is due to the system generating enough electricity to meet the maximum load demand of the facility, which is 64,273 kWh/yr. The Solar PV system generates 88,046 kWh/yr. This brings about an excess electricity of 12,112 kWh/yr. So far, it seems the most economical option out of the three configurations considered.

#### 3.4.4 Cost benefit analyses of the GG (base) and optimal (SGG) Systems

Having discussed the results of various simulation scenarios, a summary of the cost analyses of both GG (base) and SGG (lowest cost) systems are as shown in Table 7.

<b>Table 7. Cost Comparison of all three systems</b>		
Summary	GG (Base) System	SGG System
Total NPC	\$1,663,158.11	\$382,263
Initial Capital	0.00	\$177,437


Operating Cost	\$41,269/yr.	\$5,083/yr.
Levelised COE	0.642/kWh	0.139/kWh

As shown in Table 7, while the GG system in use by the healthcare facility incurred an NPC of \$1,663,158.11, the SGG configuration generated a total NPC of \$382,263 over the simulation lifetime (25 years), realising a total savings of \$1,280,895.11. The system payback period is 4.8 years, with an ROI of 16% and an IRR of 20%. Table 8 shows a summary of the economic metrics of the lowest-cost (SGG) system.

**Table 8. Economic Metrics**

Metric	Value
Present Worth (\$)	1,280,895
Annual Worth(\$)	31,784
Return on Investment (%)	16.2
Internal rate of return (%)	20.3
Simple Payback yr.	4.83
Discounted payback yr.	4.39

The levelized cost of energy for the optimal system is \$0.1390 while the operating cost of the system is \$5,083/yr as against the base system where the levelized cost of energy is \$0.642 with an operating cost of 41,269/yr. This shows that the integration of solar PV is a much more economically viable option for the healthcare facility in the long run. Figure 9 shows the graph of the cost savings of the SGG system against the base system over time.

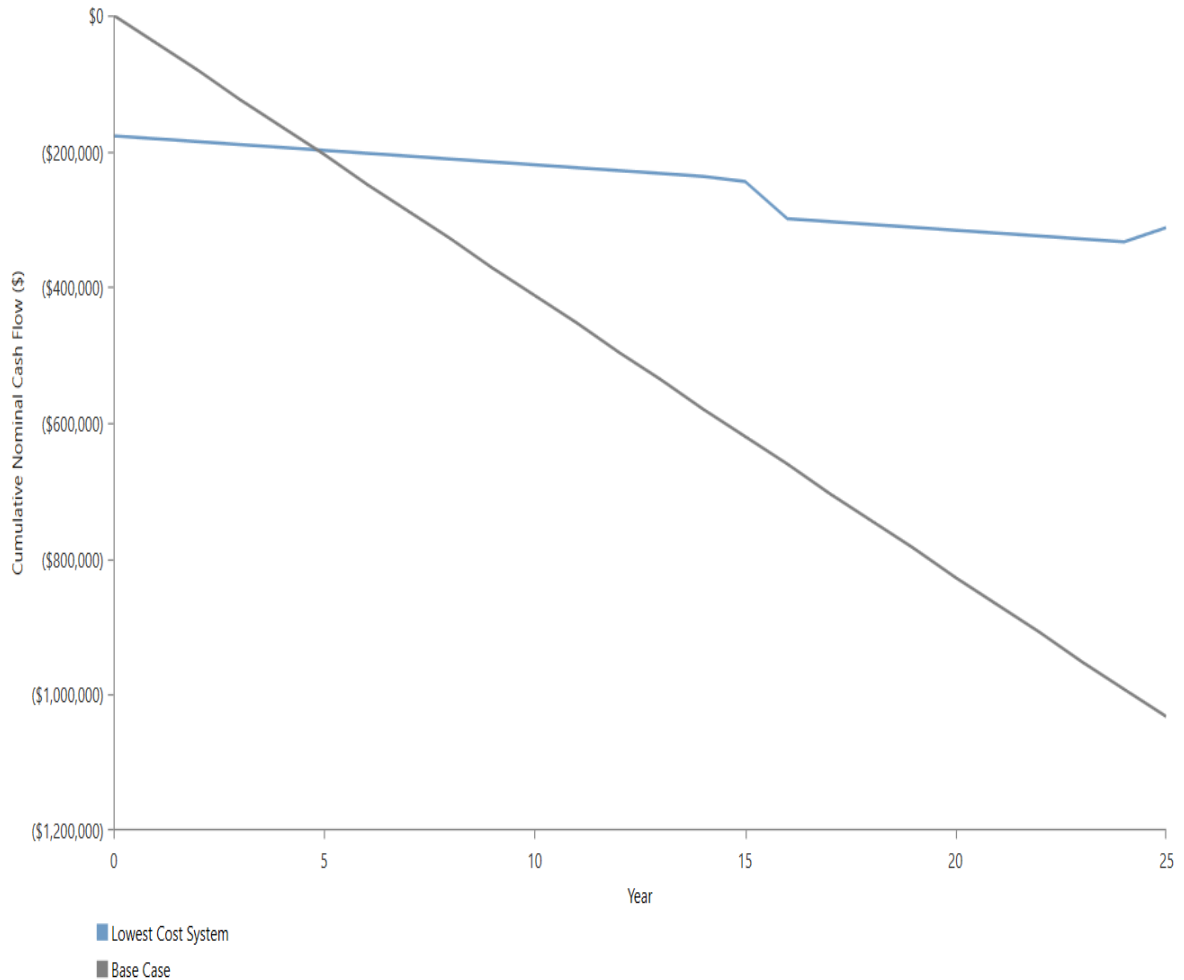

**Fig. 9. Graph of cumulative nominal cash flow against time**

The lowest cost system starts out as more expensive due to the high initial setup capital required but due to the low operating and maintenance costs, it is able to save a lot of cost overtime that would have otherwise been incurred for fueling in the base system.

It is very important to note that while this might be the most cost-effective of both options, Initial investment cost is a major barrier to the implementation of this system as the facility under observation is a medium-scale privately owned healthcare facility. Another challenge faced in the implementation of this lowest-cost system is the availability of space for the installation of panels and batteries.

### **3.5 Qualitative Benefits of the SGG System**

Some of the benefits of the SGG configuration cannot be quantified by cost as monetary value cannot be attached to them. Some of these benefits are listed below;

**1. Increased Energy Security and Resilience:** By introducing a renewable energy source like solar PV, the system becomes less reliant on the main grid. This reduces the risk of outages caused by grid failures or disruptions. Even during partial outages, the PV system can provide a sufficient level of power, keeping critical equipment operational.

**2. Reduced Dependence on Fossil Fuels:** A solar PV system generates clean energy, decreasing the reliance on fossil fuel-based power plants. This translates to lower greenhouse gas emissions and a smaller environmental footprint for the entire healthcare system which is important as Nigeria is one of the largest greenhouse gas producers in West Africa.

**3. Improved Quality of Healthcare:** A stable and reliable electricity supply is crucial for maintaining critical medical equipment and ensuring uninterrupted patient care. Even though the base system also ensures 24-hour electricity supply, the frequent interruptions, and changeovers were a major problem. This includes equipment for life support systems, diagnostic tools, and temperature-controlled storage for medications and vaccines. Consistent power also improves the overall environment for both patients and staff, enhancing the quality of care provided.

#### 4. CONCLUSION

In this study, the economic analysis of integrating a solar photovoltaic (PV) system into the existing energy infrastructure in a healthcare facility in Nigeria has been appraised. Findings showed the optimal system configuration to be the Solar-Grid-Generator (SGG) system, comprising of solar PV panels, lead-acid batteries, a system converter, alongside existing national grid and diesel generator. This hybrid system has a significantly lower net present cost (NPC) of \$382,263, compared to the base case scenario of \$1,663,158, which relies totally on grid electricity and the diesel generator. The levelized cost of energy (LCOE) for the hybrid system is \$0.139/kWh, which is also much lower than the base case LCOE of \$0.642/kWh.

Also, integrating solar PV systems with existing energy infrastructure in a healthcare facility, considering the facility's load profile and energy demand patterns, solar resource potential, and the requirement for power backup from diesel generator was successfully modeled and simulated.

Beyond economic benefits, the Solar-Grid-Generator (SGG) system also offers qualitative benefits that cannot be quantified by cost. It increases energy security and resilience by eliminating reliance on the main grid and diesel generators. The integration of a solar PV system which is a renewable energy source also contributes to a lower environmental footprint and reduced greenhouse gas emissions. The stable and reliable electricity supply facilitated by this system can improve the quality of healthcare services provided at the facility.

Finally, this study successfully demonstrated that integrating a solar PV system with the existing energy infrastructure at the healthcare facility in is not only economically feasible, but additionally offers significant long-term cost savings, as well as contributing to environmental sustainability and improved healthcare services. However, the implementation of such a system may face challenges of initial high investment costs and space availability for the installation of solar panels and batteries.

## REFERENCES

- [1] Oyedepo, S.O., 2014. Towards achieving energy for sustainable development in Nigeria. *Renewable and Sustainable Energy Reviews* 34:255-272.
- [2] Afolabi, D. D., Adeyemo, A. A. and Odumosu, A. A. 2018. Economic Analysis of Renewable Energy Sources for Power Generation in Hospitals within Ibadan Metropolis, Nigeria. *International Journal of Scientific & Engineering Research* 9.8:1872-1881.
- [3] Ikeako, L. C., Okoli, B. E. and Nwagha, U. G. 2018. The effects of health worker strikes on access to healthcare services in developing countries: The case of Nigeria. *International Journal of Nursing Studies* 87: 102-110.
- [4] Uche, I. M., Okafor, C. N. and Onwurah, I. O. 2019. Challenges of communication in the Nigerian healthcare system. *International Journal of Research in Pharmacy and Science* 9.6:1822-1828.
- [5] Ojo, T., Adebayo, O. M. and Onifade, T. M. 2020. Improving access, quality and efficiency in health care delivery in Nigeria: a perspective. *Pan African Medical Journal*. 36.208.
- [6] Onoh, C. H., and Igwono, O. U. 2021. Powering Rural Healthcare Facilities with Renewable Energy in Nigeria: A Review of Challenges and Opportunities. *International Journal of Renewable Energy Research*, 11(4), 381-388.
- [7] International Renewable Energy Agency (IRENA). (2019). Renewable Energy Market Analysis: The Case of Nigeria.
- [8] Sambo, A. S., and Sanda, M. N. 2016. Solar Energy Resource Assessment and Potential in Nigeria.  
[https://www.researchgate.net/publication/285704500\\_Solar\\_energy\\_potentials\\_in\\_strategically\\_located\\_cities\\_in\\_Nigeria\\_Review\\_resource\\_assessment\\_and\\_PV\\_system\\_design](https://www.researchgate.net/publication/285704500_Solar_energy_potentials_in_strategically_located_cities_in_Nigeria_Review_resource_assessment_and_PV_system_design).
- [9] Nwadei, O., and Oladipo, E. O. 2017. Challenges and policy options for deploying renewable energy in Nigeria. World Economic Forum. <https://www.weforum.org/agenda/2023/05/how-nigeria-is-tackling-barriers-to-its-green-energy-transition/>
- [10] Akinola, A. A. 2023. Solar photovoltaics development in Nigeria: Drivers, barriers, and policies. *Energy and Power Engineering*, 15(3), 315-328.
- [11] Khatib, T., 2019. Photovoltaic Systems and the National Electrical Code: Suggested Practices. Photovoltaic Systems and the National Electrical Code: Suggested Practices.
- [12] Faias, S., Ferreira, P. and Teixeira, F., 2020. Bi-directional single-phase battery charger for solar photovoltaic powered electric vehicle charging station in buildings. *Electric Power Systems Research*, 185.106357.
- [13] Forsberg, C., Petit, E.J., Beckman, J.P. and Rathbun, H., 2021. Shades of green: Spatial, manufacturing, and life cycle environmental impacts of regionally-

adapted light-weight green roofs. *Renewable and Sustainable Energy Reviews* 152:111833.

[14] Wang, B., Canha, L.N., Alhindawi, N. and Tabors, R., 2018. The impacts of resource integration and transmission constraints on energy system economics and renewable energy resources. *Applied Energy* 226:357-368.

[15] Blaabjerg, F. and Teodorescu, R., 2013. Inverters for photovoltaic systems - an overview. In *Photovoltaic Energy Conversion: The State of the Art of Inverters, Power Conditioning and MPPT* (pp. 508-562). Noida: Alpha Science International Ltd.

[16] Kourovskaya, P. R., Boggarov, S. C., Hinov, N. L., and Rangelova, V. M. 2014. Grid connected photovoltaic systems. *Technical Gazette* 21.2:293-299.

[17] Bolarinwa, M. A. 2018. Techno-economic evaluation of biogas generation from selected substrates in a teaching and research farm in Ibadan, Oyo State, Nigeria. *International Journal of Innovative Science and Research Technology*. Vol.3. Issue 7: 699-704.

[18] National Bureau of Statistics (NBS). 2022. Nigerian Electricity Report.

[19] Bolarinwa, M. A., Adeyemi, A. A., and Kassim, O. E. (2023). Technoeconomic analysis of prototype hydropower plant development in Nigeria. *European Journal of Engineering and Technology Research*, 8(3), 29–37. <https://doi.org/10.24018/ejeng.2023.8.3.2972>

[20] Akorede, M.F., Ibrahim, O., Amuda, S.A., Otuoze, A.O. and Olufeagba, B.J., 2018. Current status and outlook of renewable energy development in Nigeria. *Nigerian Journal of Technology* 36.1:196-212.

[21] Bolarinwa, M. A. 2020. The role of renewable energy in Nigeria's energy transformation: Advancing industrial engineering in Nigeria through teaching, research and innovation. Edited by Ayodeji E. Oluleye; Victor O. Oladokun and Olusegun G. Akanbi. A book of reading. Chapter 7. Pp 171-194. Leading Edge Printers and Publisher, Ibadan.

[22] Chatterjee, A., Isufaj, A., Ali, M., Lanka, E., Yan, D., Hegedus, L. and Hossain, J.A., 2019. Use of solar photovoltaic power for sustainable healthcare facilities: A case study on health facilities in the Indian Himalayan region of Uttarakhand. *Journal of Cleaner Production* 228:1512-1521.

[23] Luo, X., Wang, J., Li, Z., Lei, Z., and Li, J. 2021. Economic viability analysis of energy storage integration in power systems: A review. *International Journal of Electrical Power & Energy Systems*, 130, 106922. <https://www.sciencedirect.com/science/article/abs/pii/B978012821602600016X>

[24] Tran, Q. N. 2020. Cost-Effectiveness of Grid-Connected Energy Storage Systems for Peak Demand Reduction: *A Review on Sustainability* 12.24:10533.

[25] Ogbu, M. O., Baruah, D. C., Achumba, I. B. and Egbe, C. U. 2017. Economic analysis of grid-connected solar pv systems for residential buildings in Uyo, Nigeria. *International Journal of Renewable Energy Research (IJRER)* 7.2:567-578.

[26] Bolarinwa, M. A., and Abodunde, P. A. 2023. Energy waste reduction in university of Ibadan, Nigeria's water factory using energy audit approach. *European Journal of Engineering and Technology Research* 8 (5), 1-11

[27] Map data. 2024. Google Nigeria.

<https://www.google.com/maps/place/Ikeja,+Lagos/data=!4m2!3m1!1s0x103b922fa2a39990xd7a8324bddbba1f0?sa=X&ved=1t:2428.;ctx=111>

[28] Maptons. 2024. Ikeja on the map of Nigeria. <https://ng.maptons.com/2892711>

[29] National Renewable Energy Laboratory (NREL) Database. 2024. Energy efficiency and renewable energy. Alliance for sustainable energy, LLC. U.S. Department of Energy. <https://www.nrel.gov/comm-standards/editorial/references-and-citations.html>

## APPENDIX

S/N	Hospital Equipment	Peak Power Usage	Minimum Power Usage	Duration of Usage (hrs)		
1	Lightnings	3.24	1.24	24		
2	Fans	3.46	1.33	24		
3	A.C	5.68	2.77	24		
4	T.V	5.26	1.79	20		
5	Phone and Laptop Charging	3.4	1.08	18		
6	X-Ray	5.75	7.21	7		
7	CT Scanner	8.23	6.04	7		
8	Ultrasound Machine	3.95	2.16	10		
9	Patient Monitor	0.55	0.25	24		
10		5.34	3.11	6		
11	Defibrillator	0.58	0.21	15		
12	Dialysis Machine	3.28	2.41	6		
13		0	0	0		
14		0	0	0		
15		0	0	0		



**Weather  
Data:**

Month	Average Temperature (oC)	Average Humidity (%)
January	25.9	65
February	26.94	60
March	27.22	55
April	26.99	50
May	26.35	45
June	25.5	40
July	24.65	45
August	24.41	50
September	24.92	55
October	25.55	60
November	26.2	70
December	26.01	70

Fixture Type	Number of Fixture	Wattage	Operating Schedule
Fluorescent	120	28W	6 AM - 8 PM daily
LED	60	15W	24/7

Building Size (Sq. ft.)	Number of Floors	Building Age (Years)	Construction Materials	Window Types
26,800	2	21	Concrete, Steel, Brick	Double-paned

WEEKDAYS	Load Profile								
	0_3	3_6	6_9	9_12	12_1	15_18	18_21	21_24	
JAN	6.043	7.34	19.44	36.34	24.25	26.03	29.33	39.45	
FEB	4.643	7.13	19.75	36.11	24.87	25.43	35.34	30.22	
MAR	5.46	6.88	18.67	35.09	24.65	24.67	38.21	32	
APR	6.222	6.78	20.22	37.22	21.28	25.54	34.56	31.33	
MAY	7.03	7.11	20.33	33.99	23.76	24.44	34.97	32.45	
JUN	6.98	7.28	19.75	35	22.97	27.87	35.66	34.56	
JUL	5.77	6.88	19.55	36.63	24.64	25.77	35.56	33.14	
AUG	6.043	6.86	19.47	36.05	24.25	25.23	35.33	30.45	
SEPT	4.65	7	20.66	35.34	23.76	25.99	34.65	33.24	
NOV	5.87	7.24	19.75	36.12	21.88	24.86	33.45	30.22	
DEC	6.44	6.98	19.85	37.43	22.87	23.98	35.34	30.44	

<b>Occupant Type</b>	<b>Number</b>	<b>Occupancy Schedule</b>
<b>Patients</b>	30	24/7
<b>Staff (Doctors/Nurses)</b>	35	7 AM - 7 PM (Weekdays)
<b>Staff (Administrative)</b>	15	8 AM - 5 PM (Weekdays)
<b>Visitors(Avrg)</b>	30	10AM-8PM(DLy.)

UNDER PEER REVIEW