

# Comparative Analysis of Direct and Soft Starting Method for Induction Motor on Difference Load Levels

**Abstract:** Asynchronous machines are considered nowadays the most commonly used electrical machines, which are mainly used as electrical induction motors. The induction motors, which is considered as the backbone of industrial applications and operation, demand a reliable and efficient starting method to minimize mechanical stress and electrical disturbances. This research study presents a comparative analysis of Direct Online (DOL) and Soft Starter techniques for three-phase induction motors, utilizing MATLAB/Simulink software for simulation and performance evaluation. The simulation results highlight the effectiveness of the soft starter in achieving a faster and more controlled start-up, making it a superior choice in applications where reducing start-up transients and mechanical wear is critical such as conveyors, pumps and compressors. This was achieved by deploying a 35-kW induction motor to analyze the performance of direct online (DOL) starters and soft starters, with a particular focus on the latter's use of a thyristor block to mitigate inrush current. The analysis was carried out at different load conditions, such as no load, 25% load, 50% load, 75% load, and 100% load. The result obtained shows that, the direct online takes longer transient than the soft starter, for example, during no load test direct online transient time was 0.4 second while soft starter was 0.2 second. This study underscores the significance of advanced simulation tools in optimizing motor startup strategies, thereby enhancing the efficiency and longevity of three-phase induction motors.

**Keyword:** *induction motors, soft starter, direct online starter, rotor speed, electromagnetic torque and stator current,*

## 1. INTRODUCTION

Asynchronous machines are considered nowadays the most commonly used electrical machines, which are mainly used as electrical induction motors. The induction motors, which is considered as the backbone of industrial applications and operation, demand a reliable and efficient starting method to minimize mechanical stress and electrical disturbances [28] [29][30]. Starting of a three-phase induction motor has a significant transient effect on the power system stability due to high starting current [22] [25][26]. The value of transient parameters, and its during can impair negatively on a given system if not properly managed. The starting transient parameters must satisfy the transient characteristics requirements with minimized starting current and settling time suitable for operation within some electrical and electronics system with sensitive that components that cant withstand sudden current rise. If the starting technique is suitable, the life of the induction would be prolonged, and this can lead to some economic benefits.

[1-8]. Some works have been done in the induction motor starting techniques, aiming at improving the transient parameter values.

According to [1], who proposed a saturation and a deep bar effect for the study of transients of three-phase squirrel-cage type induction motors. The researchers use mathematical model of an induction motor to expressed the six differential equations of three-phase instantaneous voltage and current. Similarly, [2] presents a quality mathematical model of induction machine based on the steady state and dynamic equations and D-Q transformation technique. The model was used for steady state as well as transient analysis of squirrel cage or wound rotor structure. Simulation of three phase induction motor in MATLAB with Direct and Soft starting methods was carried out in [3], The theory behind the research was based on representing the real motor by a set of equations and values in MATLAB using the subsystem feature, forming a corresponding idealistic motor in a way where all the physical effects are similar. The motor was started under different loads in two methods: Direct and Soft starting. Each method was studied and discussed using supporting simulation of currents, torque, speed, efficiency and power factor curves. Linear and nonlinear controllers can also be used to control the starting operation of an induction motor driving a system which can include system powered by renewable energies.[5][16] [22] [25]

For example, [6] developed a model of induction motor drive for speed control using a hybrid controller consisting of proportional integral derivative (PID) and fuzzy logic, and the target load was a nonlinear load like a pump. The model gave an improved response when compared to either fuzzy logic or PID controller. In [11], dynamic response using a fuzzy logic controller (FLC) was compared with a proportional integral (PI) controller; the latter showed superior performance at from the current and Electromagnetic torque response In [14], particle swarm optimization (PSO) was used in getting an optimized value of starting current, while [12] proposed a novel hybrid control of IM based on the combination of direct torque control (DTC) and genetic algorithm. The control method showed good performance at only one operating speed. A novel research algorithm was proposed in [16] and [26] to improve the design of the FLC and FLC-PIC, respectively, for IM starting current and electromagnetic torque. The proposed algorithm provides an easy approach for obtaining membership functions. The developed controller provided the needed stability and good dynamic response under speed and mechanical load change.[26] developed an optimized hybrid controller model for vector speed control technique on variable speed and intermittent loading operating conditions. The speed range considered was lower in the region of 5 to 30 rad/sec. The study was useful in the Lower speed applications. [18] studied the different methodologies of IM drives control. The study showed that speed, power, and efficiency of IM have been controlled by various techniques like frequency control, supply voltage control, and the multiple stator winding method. Implementation of IFOC on IM drive with PI control was presented in [5], and the results show a good dynamic response on intermittent loading operating conditions. [4] used a finite element analysis

approach to obtain the dynamic performance of IM under intermittent loading conditions without control.

The simulation results of the cited literature show that sensitive parameters like starting current and settling time of the transients response still need a research attention modern industrial applications like cranes, and robotics

## 2. METHODOLOGY

From the flow chart, literature reviewed on three-phase induction motor transient effects on direct online starter and soft starter was first carried out, this follows by developing and mathematical expression to size the three-phase induction motor parameter, and the torque equation was used as shown in figure 1. After sizing the induction motor, a review was carried out again to choose a situation software for modelling and simulating of the system. MATLAB/Simulink simulation soft was chosen because it provides a comprehensive environment for modeling, simulating, and analyzing complex systems. It's also allowed for detailed modeling of the behavior of induction motors under different operating conditions as well as integrating seamlessly with other MATLAB toolboxes and software packages, enabling engineers to perform multidomain simulations and incorporate additional functionalities such as signal processing, control system design, and optimization. The system for both direct on-line and soft starter was modeled with appropriate functional block in Simulink library

The modeled was simulated and their output waveform was studied and improve upon where it is necessary. The Simulink model of direct on line starter and soft starter are shown in figure 2 and 3 respectively

## 3. ANALYTICAL MODELLING OF SCIM

SCIM is an AC machine whose speed at loading conditions is always less than the synchronous speed, and it operates on the principle of electromagnetic induction. [1] and [19] analyzed the performance of SCIM in steady-state conditions. [20][21] also outlined the design strategy for achieving a desired performance.

The voltage equations of SCIM in dq0 axis using analytical method are given equation (1) – (4):

$$v_{qs} = R_s i_{qs} + \frac{d\phi_{qs}}{dt} + \omega_e \phi_{ds} \quad (1)$$

$$v_{ds} = R_s i_{ds} + \frac{d\phi_{ds}}{dt} - \omega_e \phi_{qs} \quad (2)$$

$$v_{qr} = R_r i_{qr} + \frac{d\phi_{qr}}{dt} + (\omega_e - \omega_r) \phi_{dr} \quad (3)$$

$$v_{dr} = R_r i_{dr} + \frac{d\phi_{dr}}{dt} - (\omega_e - \omega_r) \phi_{qr} \quad (4)$$

and

$$v_{qr} = v_{dr} = 0$$

The flux equation :

$$\varphi_{qs} = L_{Is}i_{qs} + L_m(i_{qs} + i_{qr}) \quad (5)$$

$$\varphi_{qr} = L_{Ir}i_{qr} + L_m(i_{qs} + i_{qr}) \quad (6)$$

$$\varphi_{ds} = L_{Is}i_{ds} + L_m(i_{ds} + i_{dr}) \quad (7)$$

$$\varphi_{dr} = L_{Ir}i_{dr} + L_m(i_{ds} + i_{dr}) \quad (8)$$

where  $v_{qs}$ ,  $v_{ds}$  are the applied voltages to the stator,  $i_{ds}$ ,  $i_{qs}$ ,  $i_{dr}$ ,  $i_{qr}$  are the corresponding d and q axis stator current and rotor currents.  $\varphi_{qs}$ ,  $\varphi_{qr}$ ,  $\varphi_{ds}$ ,  $\varphi_{dr}$ , are the rotor flux component,  $R_s$ ,  $R_r$  are the stator and rotor resistances,  $L_{Is}$ ,  $L_{Ir}$  denotes stator and rotor inductances, whereas  $L_m$  is the mutual inductance [23][24]. Combining the flux equation with (1), (2), (3) and (4), the electrical transient model in term of voltage and current can be represents in matrix form as:

$$\begin{bmatrix} v_{qs} \\ v_{ds} \\ v_{qr} \\ v_{dr} \end{bmatrix} = \begin{bmatrix} R_s + SL_s & \omega_e L_s & SL_m & \omega_e L_m \\ -\omega_e L_s & R_s + SL_s & -\omega_e L_m & SL_m \\ SL_m & (\omega_e - \omega_r)L_m & R_s + SL_s & (\omega_e - \omega_r)L_r \\ -(\omega_e - \omega_r)L_m & SL_m & -(\omega_e - \omega_r)L_r & R_r + SL_r \end{bmatrix} \begin{bmatrix} i_{qs} \\ i_{ds} \\ i_{qr} \\ i_{dr} \end{bmatrix}$$

where, S is the Laplace operator. (9)

The electromagnetic torque equation given in equation (10)

$$T_e = \frac{3PL_m}{4L_r} (\varphi_{dr}i_{qs} - \varphi_{qr}i_{ds}) \quad (10)$$

where P, denote the pole number of the motor. If the vector control is fulfilled, the q component of the rotor field  $\varphi_{qr}$  would be zero. Then the electromagnetic torque is controlled only by q-axis stator current and is shown in equation (11)

$$T_e = \frac{3PL_m}{4L_r} (\varphi_{dr}i_{qs}) \quad (11)$$



Fig. 1: Flow chart of the research reasearch

The modeled was simulated and their output waveform was studied and improve upon where it is necessary. The Simulink model of direct on line starter and soft starter are shown in figure 2 and 3 respectively.

Table 1: Specification of the Asynchronous Machine Rated Parameters

Number	Parameters	Value
1	Input power of the motor	37Kw
2	Motor input voltage	400V
3	Frequency	50Hz
4	Motor speed	1480 RPM
5	Mechanical input	238.7 N * m
6	Mechanical power	37Kw
7	Stator resistance	0.08233Ω
8	Stator inductance	0.000724 mH
9	Rotor resistance	0.05037Ω
10	Rotor inductance	0.000724 mH
11	Mutual inductance	0.02711H
12	Inertia(J)	0.37 (kg.m <sup>2</sup> )
13	Friction factor(F)	0.02791 (N.m.s)
14	Number of pole pair	4
15	Initial condition	10000000

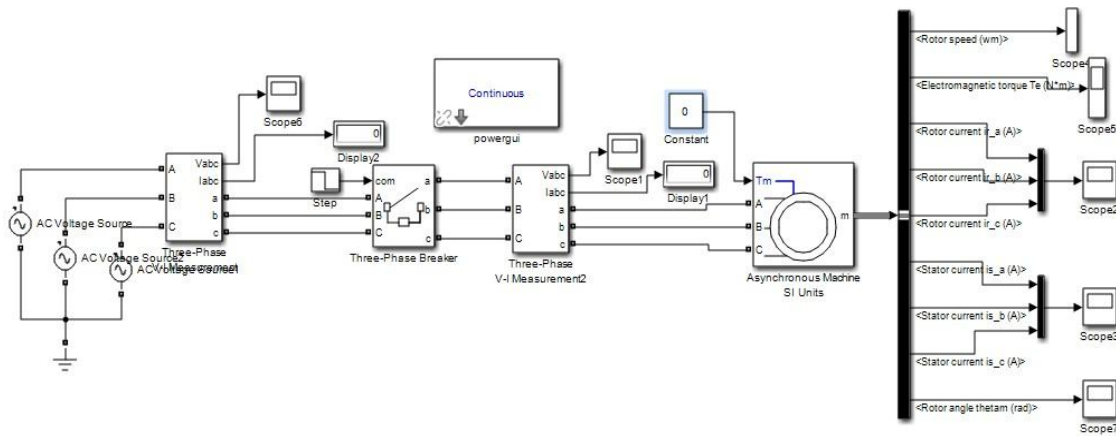


Fig. 2: SIMULINK model of direct online starter

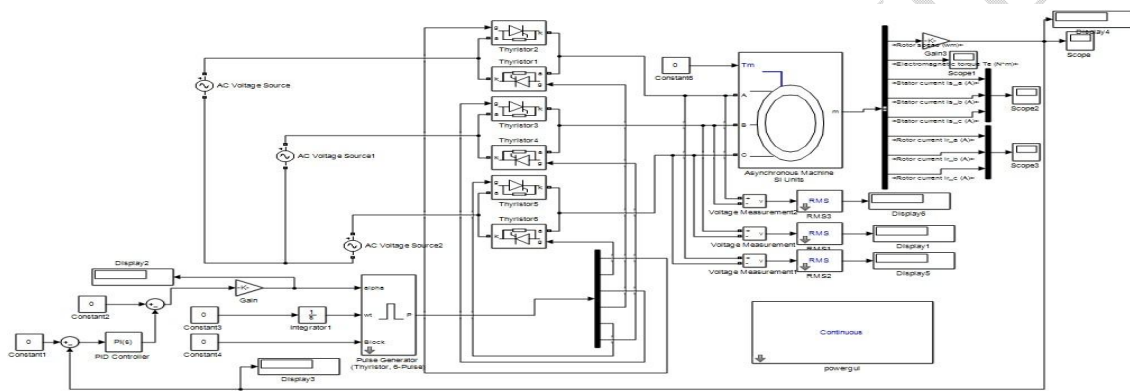



Fig.3: SIMULINK model soft starter

#### 4. RESULTS AND DISCUSSION

The starting performance of an induction motor with direct online and soft starter at different loading conditions is presented in this section. The parameters of the tested motor are listed in Table 1. The design and simulation were carried out using the Simulink toolbox of MATLAB. The starters were separately designed for induction starting technique at different levels of load. The speed, torque, and current responses of induction motors with these starters were studied, analyzed, and compared in terms of settling time and overshoot. The simulation results are subdivided in the subsequent sections.

##### 4.1. Direct Online and Soft Starter Rotor Speed Result

The rotor speed at transient states which reflect the difference in starting methods between a DOL starter and a soft starter are analyzed and shown in this section. The rotor speed responses are presented in Figures 4 to 8.

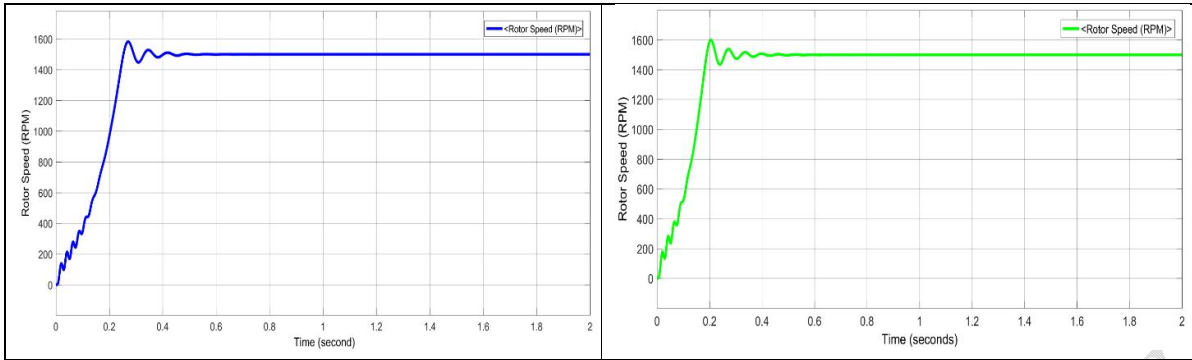


DOL

Soft starter

Fig 4: Direct online and soft starter rotor speed at 0% load (0 N\*m)

The transient time of rotor speed of direct online and soft starter at 0% of the rated load is shown in Fig 4, direct . Online starter (DOL) reaches it transient state at 0.3 seconds while that of soft starter is 0.2 seconds.

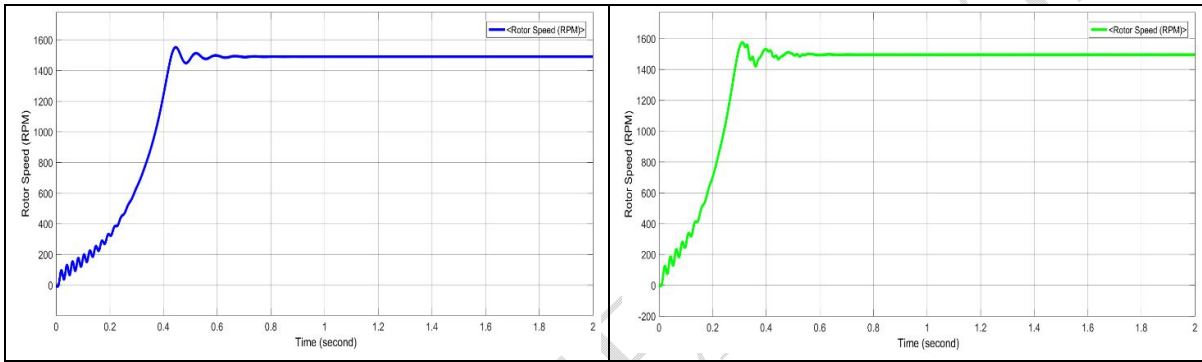


DOL

Soft starter

Fig 5: Direct online and soft starter rotor speed at 25% load (60 N\*m)

At 25% load, transient time of direct online is 0.5 seconds while soft starter is 0.3 second as seen in Fig 5

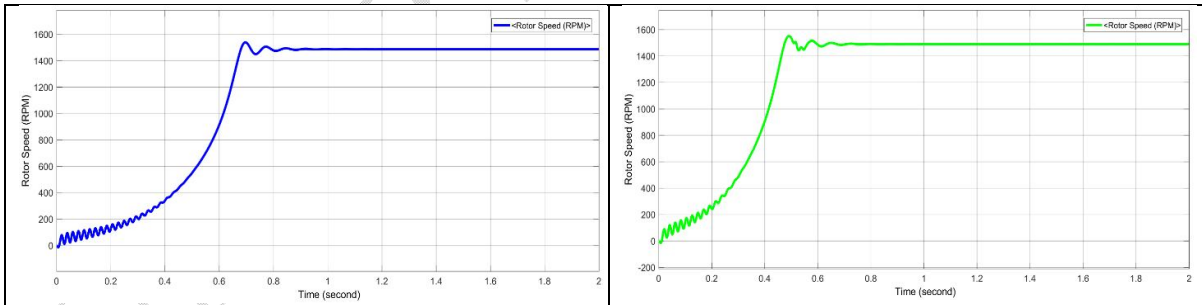


DOL

Soft starter

Fig 6: Direct online and soft starter rotor speed at 50% load (119 N\*m)

At 50% load, transient time of direct online is 0.7 seconds while soft starter is 0.5 second as seen in Fig 6.

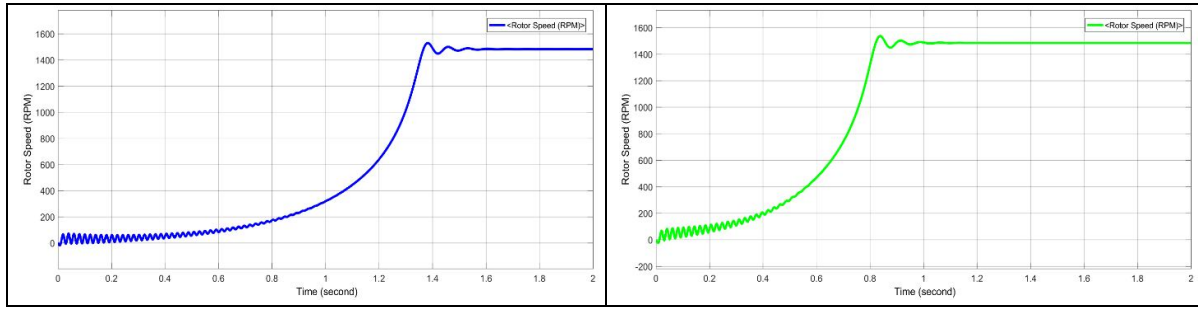


DOL

Soft starter

Fig 7: Direct online and soft starter rotor speed at 75% load (179 N\*m)

At 75% load, transient time of direct online is 1.4 seconds while soft starter is 0.9 second as seen in Fig 7

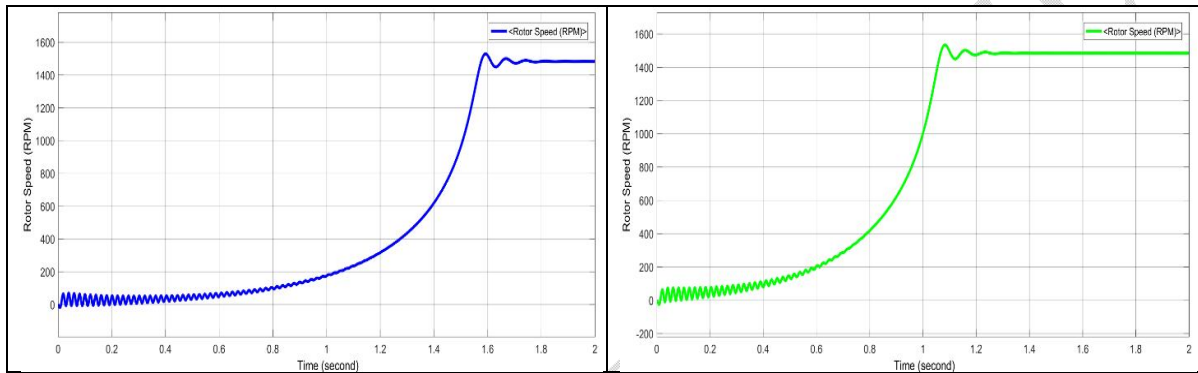

DOL

Soft starter

Fig 8: Direct online and soft starter rotor speed at 100% load (238 N\*m)

At 100% load, transient time of direct online is 1.6 seconds while soft starter is 1.1 second as seen in Fig 8


Table 2: DOL and Soft starter transient time simulation results on rotor speed.

Load %	DOL transient time (sec)	Soft Starter transient time (sec)
0%	0.3	0.2
25%	0.5	0.3
50%	0.7	0.5
75%	1.4	0.9
100%	1.6	1.1

Table 2 shown the summary of comparison between direct online starter and soft starter of rotor speed.

#### 4.2 Direct Online and Soft Starter Electromagnetic Torque Result

The electromagnetic torque transient states which reflect the difference in starting methods between a DOL starter and a soft starter are analyze below. The responses of electromagnetic torque are presented in Figures 9 to 13.

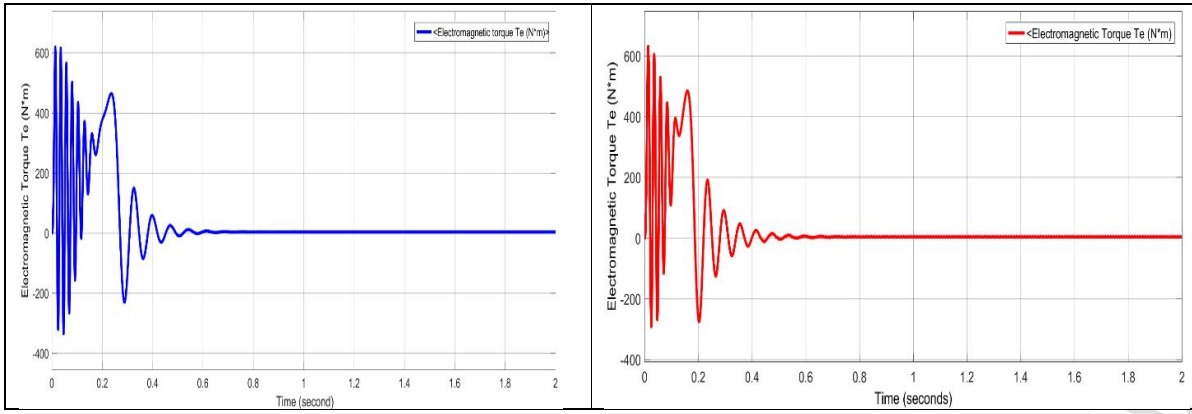


DOL

Soft starter

Fig 9: Direct online and soft starter electromagnetic torque at 0% load (0 N\*m)

At 0% load, transient time of direct online is 0.4 seconds while soft starter is 0.3 second as seen in Fig 9

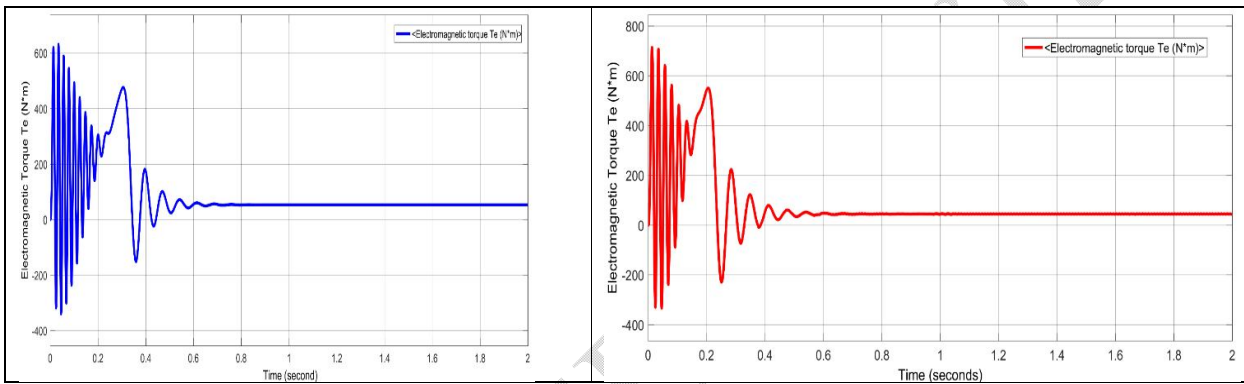


DOL

Soft starter

Fig 10: Direct online and soft starter electromagnetic torque at 25% load (60 N\*m)

At 25% load, transient time of direct online is 0.5 seconds while soft starter is 0.4 second as seen in Fig 10

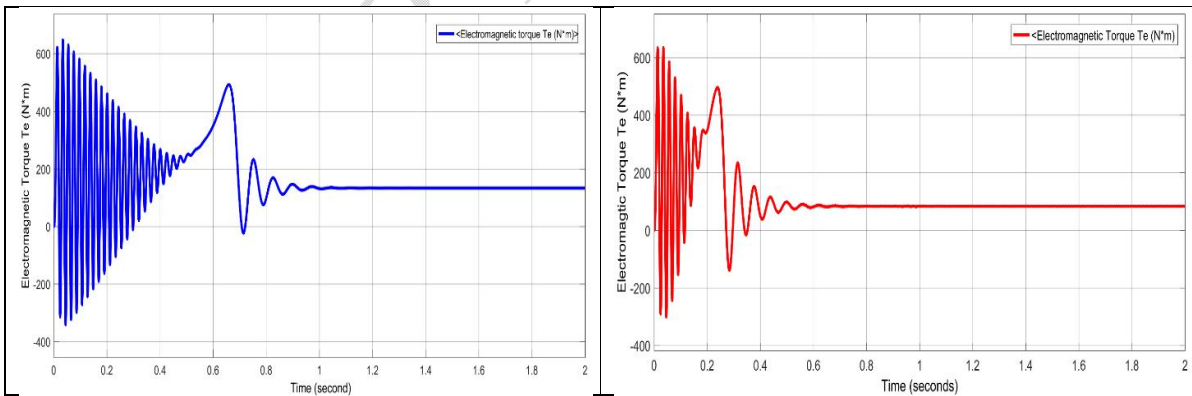


DOL

Soft starter

Fig 11: Direct online and soft starter electromagnetic torque at 50% load (119 N\*m)

At 50% load, transient time of direct online is 0.8 seconds while soft starter is 0.5 second as seen in Fig 11

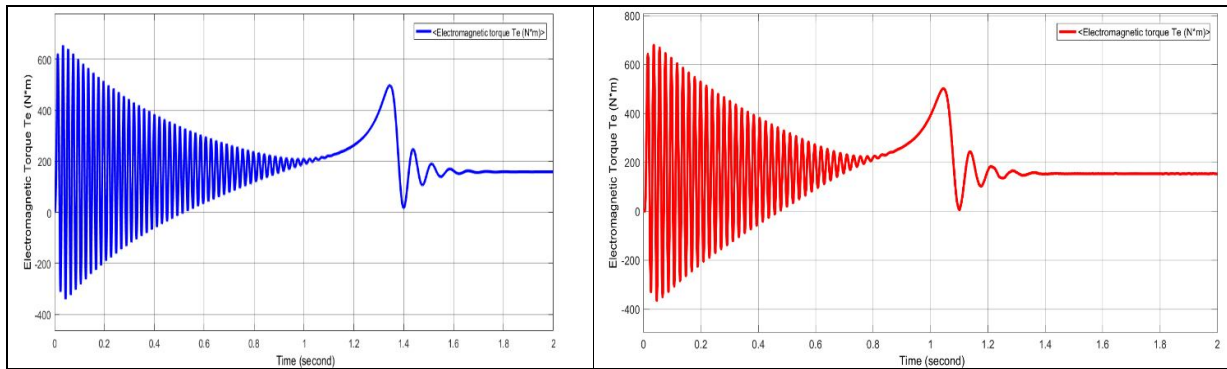


DOL

Soft starter

Fig 12: Direct online and soft starter electromagnetic torque at 75% load (179 N\*m)

At 75% load, transient time of direct online is 1.5 seconds while soft starter is 1.2 second as seen in Fig 12

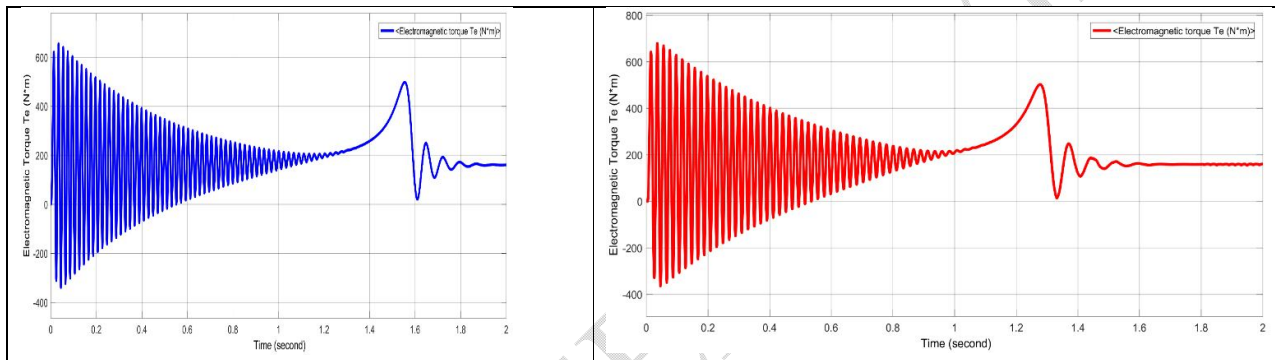

DOL

Soft starter

Fig 13: Direct online and soft starter electromagnetic torque at 100% load (238 N\*m)

At 100% load, transient time of direct online is 1.7 seconds while soft starter is 1.5 second as seen in Fig 13


Table 3: DOL and Soft starter transient time simulation results on electromagnetic torque.

Load %	DOL transient time (sec)	Soft Starter transient time (sec)
0%	0.4	0.3
25%	0.5	0.4
50%	0.8	0.5
75%	1.5	1.2
100%	1.7	1.5

Table 3 shown the summary of comparison between direct online starter and soft starter of electromagnetic torque.

### 4.3 Direct Online and Soft Starter Stator Current Result


The stator current transient time of both the direct online starter and soft starter are shown in Fig. 14 to 18. Direct online starter with high inrush current causes the voltage to dips they by stressing the electrical components. Soft Starter reduced the high inrush current and minimizes the voltage dips and electrical stress.

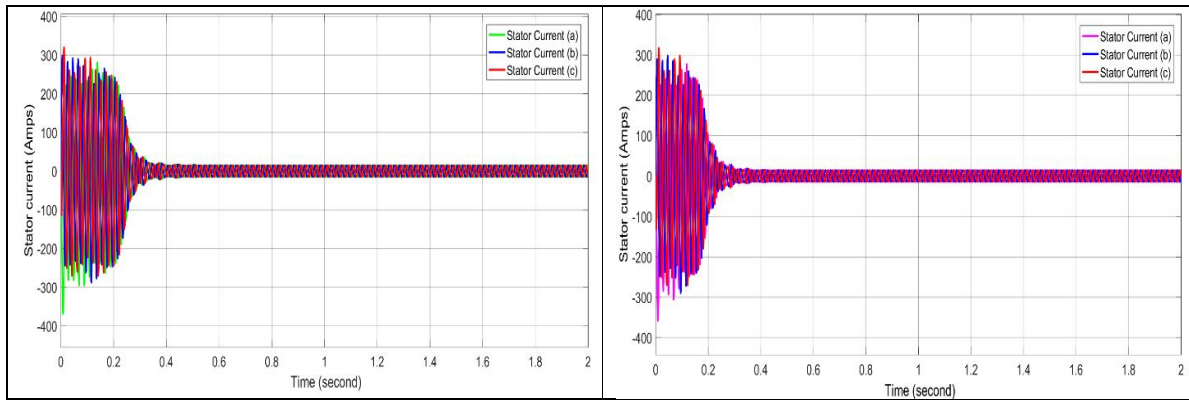

DOL Soft starter

Fig 14: Direct online and soft starter stator current at 0% load (0 N\*m)


At 0% load, transient time of direct online is 0.3 seconds while soft starter is 0.2 second as seen in Fig 14

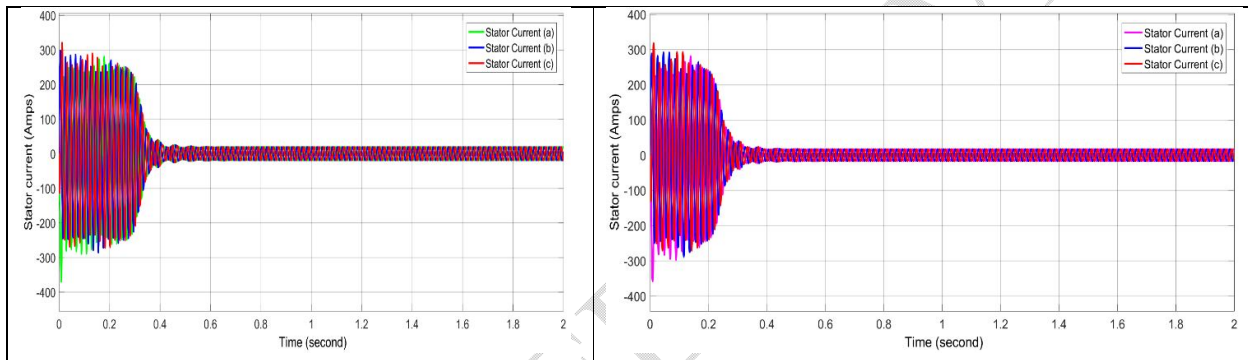

DOL Soft starter

Fig 15: Direct online and soft starter stator current at 25% load (60 N\*m)


At 25% load, transient time of direct online is 0.4 seconds while soft starter is 0.3 second as seen in Fig 15

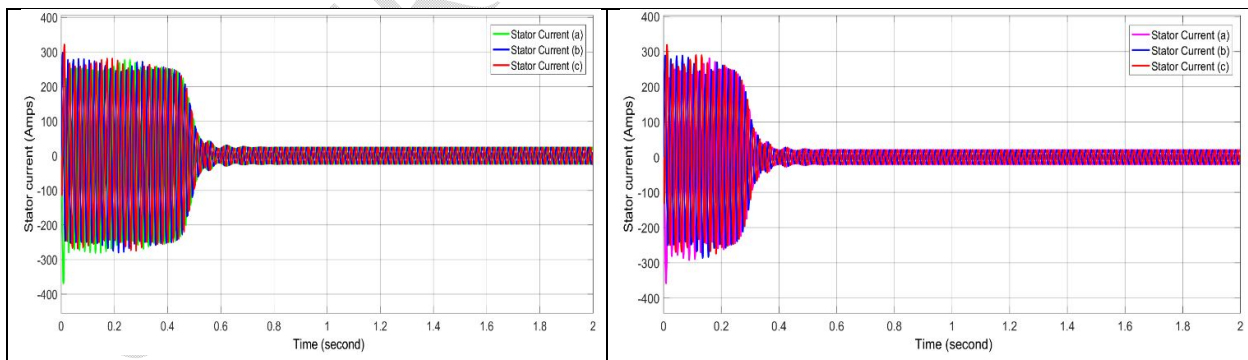

DOL Soft starter

Fig 16: Direct online and soft starter stator current at 50% load (119 N\*m)

At 50% load, transient time of direct online is 0.6 seconds while soft starter is 0.4 second as seen in Fig 16

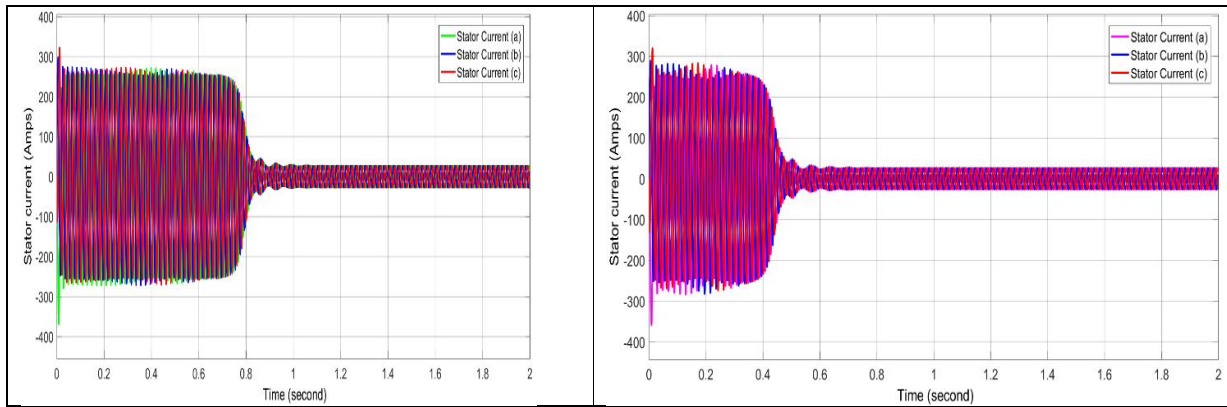


DOL

Soft starter

Fig 17: Direct online and soft starter stator current at 75% load (179 N\*m)

At 75% load, transient time of direct online is 0.9 seconds while soft starter is 0.5 second as seen in Fig 17

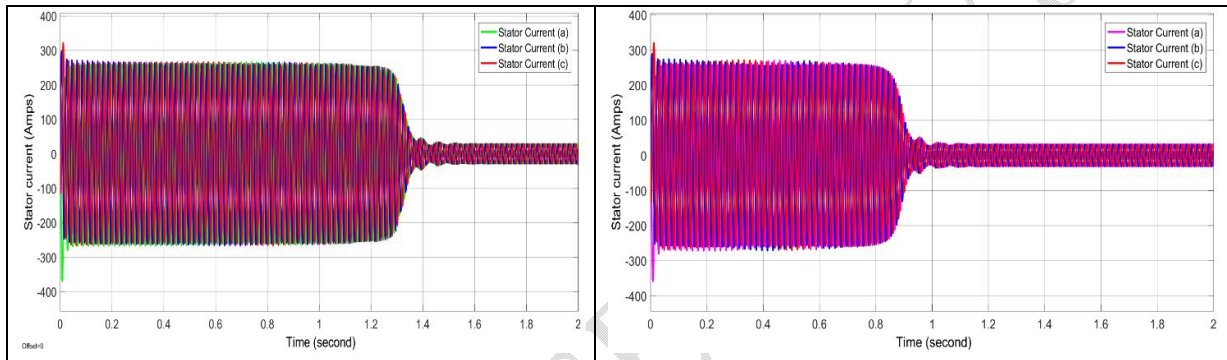

DOL

Soft starter

Fig 18: Direct online and soft starter stator current at 100% load (238 N\*m)

At 100% load, transient time of direct online is 1.4 seconds while soft starter is 1.0 second as seen in Fig 18

Table 4: DOL and Soft starter transient time simulation results on stator current

Load %	DOL transient time (sec)	Soft Starter transient time (sec)
0%	0.3	0.2
25%	0.4	0.3
50%	0.6	0.4
75%	0.9	0.5
100%	1.4	1.0

The direct comparison is shown in graph of DOL and Soft Starter Rotor speed, Electromagnetic torque and Stator current represented in fig 19 and 20.

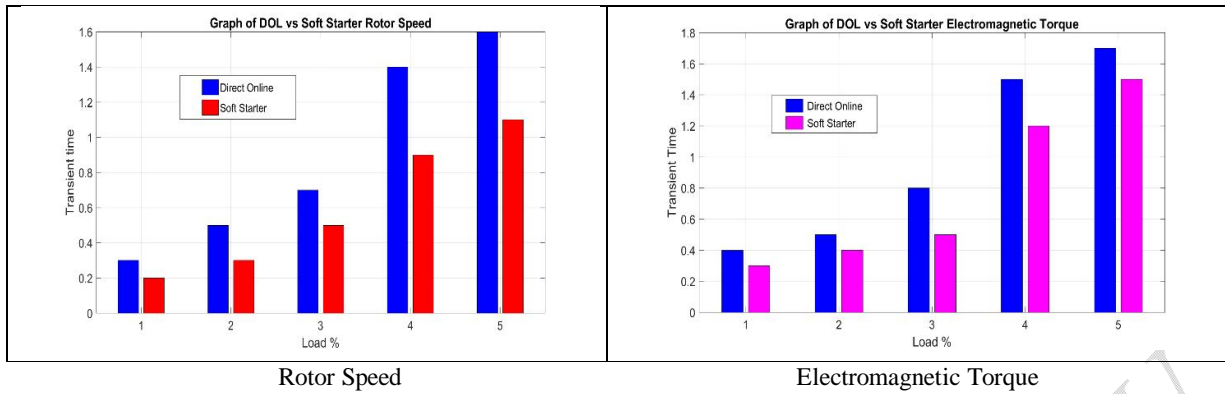


Fig 19: Direct online and soft starter Rotor speed and Electromagnetic torque

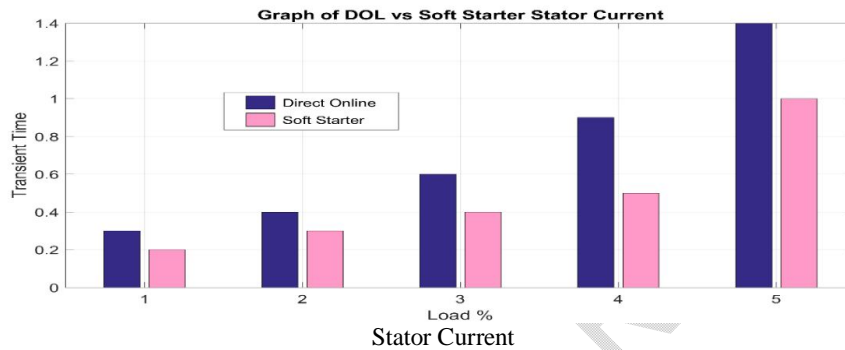


Fig 20: Direct online and soft starter Rotor speed and Electromagnetic torque

## 5. CONCLUSION

In this study, the transient effects of a three-phase induction motor using both Direct Online (DOL) and Soft Starter methods were analyzed. The modeling and simulation were done using MATLAB/Simulink software. The simulation models were meticulously developed to capture the dynamic behavior of the motor during startup, allowing for an in-depth analysis of the different starting load torque.

The results from the simulation indicate a stark contrast in performance between the DOL and Soft Starter methods. The DOL starter, while simple and cost-effective, exhibited significant inrush currents and torque transients, leading to mechanical and electrical stresses on the motor and associated equipment. This method, although widely used, can result in substantial wear and tear, reducing the lifespan of the motor and increasing maintenance requirements.

Conversely, the Soft Starter demonstrated a more controlled and gradual increase in voltage, leading to a substantial reduction in inrush current and smoother torque transition.

Disclaimer (Artificial intelligence)

Author(s) hereby declare that NO generative AI technologies such as Large Language Models (ChatGPT, COPILOT, etc.) and text-to-image generators have been used during the writing or editing of this manuscript.

## REFERENCES

- [1] Gonzalez A. and Arjona M. A., " New starting system for three-phase induction motors by using a part-winding and capacitors," in 7th IET International Conference, Manchester, England, 2014.
- [2] Zenginobuz G., Isik C., Muammer E. and Cüneyt B., "Performance optimization of induction motors during voltage-controlled soft starting," IEEE transactions on energy conversion, vol. 19, no. 2, pp. 278-288, 24 May 2004.
- [3] Hammid A. T., "Direct on Line Starter Motor and Reverse System in Allen-Bradley PLC," Diyala Journal for Pure Sciences (DJPS), vol. 12, no. 4, pp. 132-148, 2016.
- [4] Umoette, A. T. Okoro O. I. and Davidson, I. E. "Performance Analysis of a 10hp Three phase Induction Motor Using Classical and Finite-Elements for Varying Load Conditions," 2021 IEEE PES/IAS PowerAfrica, 2021, pp.1-5.
- [5] Umoette, A. T. Okoro O. I. and Davidson, I. E "Implementation of Indirect Field Oriented Control of a 2.2kW Three-Phase Induction Motor Using MATLABSimulink," 2021 IEEE AFRICON, 2021, pp. 1-6.
- [6] Umoette, A. T. Okoro O. I. and Davidson, I. E, "Speed Performance Enhancement and Analysis of a Three Phase Induction Motor Driving a Pump Load using Vector Control Technique," 2022 IEEE PES/IAS PowerAfrica, Kigali, Rwanda, 2022, pp. 1-5,.
- [7] G. S. Reddy, "Vector controller based speed control of induction motor drive with 3-Level SVPWM based inverter," International Journal of Emerging Trends in Electrical and Electronics, vol. 1, no. 4, pp. 1-11, 1 Mar 2013.
- [8] Okpo E. E and Nkan I.E A. "Constructional features and performance analysis of 3-phase Linear induction motor. ," international journal of scientific and sustainable development in 2016, vol 6, issue 1, pp 176-185
- [9] Wang H., Yang Y., Ge X. Zuo Y. Yue Y. and Li S. "PLL- and FLL-Based Speed Estimation Schemes for Speed-Sensorless Control of Induction Motor Drives: Review and New Attempts," in IEEE Transactions on Power Electronics, vol. 37, no. 3, pp. 3334-3356, March 2022.
- [10] Panchal S. N, Vishal S. S and Akshay P. A, "Simulation analysis of SVPWM inverter fed induction motor drives," International Journal of Emerging Trends in Electrical and Electronics (IJETEE) , vol. 2, no. 4, pp. 18-24, Apr 2013
- [11] Sahu S.K., Neem D.D., "A robust speed sensorless vector control of multilevel inverter fed induction motor using particle swarm optimization," international journal of innovative research in electrical, electronics, instrumentation, and control engineering vol. 3, issue 1, January 2015.
- [12] Nazeer N., and Shahina T.N. " speed control for indirect vector control of induction motor drives at low speeds IEEE Transactions on Energy, Communication, Data Analytics and Soft Computing, pp. 1111 - 1118, sept. 2019.

- [13] Ekom E.E. Okoro I.O, Awa C.C Akuru U. B " Performance evaluation of 5.5 Kw SIX PHASE ASYNCHRONOUS MOTOR' IEEE PES/IAS power africa (2019) Vol. 3, PP. 639-644.
- [14] Jayashri. W., Swapnil Z., and Rahul S., "Review of Various Methods in Improvement in Speed, Power & Efficiency of Induction Motor", IEEE Transactions on Energy, Communication, Data Analytics and Soft Computing, (2017) Vol. 5, No. 17, PP. 3293-3297.
- [15] Umoette A.T, Mbetobong U. F., Ubom E.A., "Development of Site-Specific Optimal Tilt Angle Model for Fixed Tilted Plane PV Installation in Akwa Ibom State, Nigeria". Science Journal of Energy Engineering. Vol. 4, No. 6, 2016, pp. 50-55.
- [16] Umoette A.T, Udofia J. P. and Ubom E.A, "Energy Audit and Standalone Solar Power Generation Design For Akwa Ibom State University Main Campus". International Multilingual Journal of Science and Technology (IMJST) ISSN: 2528-9810 Vol. 8 Issue 6, June – 2023
- [17] Fizatul A. P., Marizan S., Zulkifilie I., "Performance of Sliding Mode Control for ThreePhase Induction Motor' Conference Of Science And Social Reseach, Malaysia 2010,
- [18] Hannan M.A., Ali J. A., Mohamed A., Amirulddin U. A. U, Tan N. M. L and Uddin M. N., "Quantum-Behaved Lightning Search Algorithm to Improve Indirect Field-Oriented Fuzzy-PI Control for IM Drive," in IEEE Transactions on Industry Applications, vol. 54, no. 4, pp. 3793-3805, July-Aug. 2018.
- [19] Blashke F., "The principle of field orientation as applied to the new transvector closed loop control system for rotating field machines", SiemensRev, Vol 39, no.5, pp 217-220, May 1972.
- [20] Stephen O., Ejiofor N., Abuch N. Ci, Damian N., Okoro O. I, "Performance study of three-phase induction motor driving a load". ANALYSIS ARTICLE DISCOVERY ISSN 2278–5469 EISSN 2278–5450 A 2019.
- [21] Bhola J., Panda M., Pandey, P.K, and Pan Lt. " PSO-Based Online Vector Controlled Induction Motor Drives." IEEE International Conference on Electrical, Electronics, and Optimization Techniques (ICEEOT) - 2016: 2234-2240.
- [22] Silas A. F., Umoette A.T., and Ekanem B.D. "Energy Analytical Model for The Selection of Peak Sun Hour and Days of Power Autonomy for PV Solar Power System Components Sizing". Journal of Multidisciplinary Engineering Science and Technology (JMEST) ISSN: 2458-9403 Vol. 11 Issue 3, March – 2024
- [23] Zicheng, L., yongdong L., and Zheng Z., "A review of drive techniques for multiphase machines." CES Transactions on Electrical Machines and Systems 2, no. 2 (2018): 243-251.
- [24] Tiwari R. and Chatterji S., "Comparative Analysis of Vector Control of Induction Motor using PI Controller with Fuzzy Logic Controller," International Journal of Science and Research (IJSR), vol. 2, no. 4, pp. 404-409, April 2013.
- [25] Umoette A.T., Silas A. F. and Kingsley B. C. "Clearness Index–Based Computation and Evaluation of Mean Daily Insolation and Optimal Fixed Tilt Angle for PV Installation in Uyo,

Akwa Ibom State”. International Multilingual Journal of Science and Technology (IMJST) ISSN: 2528-9810 Vol. 9 Issue 3, March – 2024

- [26] Umoette A.T, Okoro I. O and Abunike E ‘Performance Enhancement of 2.5kW Induction Motor Drive Using Novel Hybridized Control Algorithm’ American Journal of Engineering Research (AJER) e-ISSN: 2320-0847 p-ISSN : 2320-0936 Volume-13, Issue-8, pp-47-61
- [27] Singha A.K., Chaturvedib D.K. and Palc N.K, “PSO based Fractional Order PID Controller for Speed Control of Induction International Conference on Power Energy”, Environment and Intelligent Control (PEEIC) 2019.
- [28] Rao, G. M., Karthik, M. V., Kumar, A. A., Kumar, C. S., Parameshwar, T., & Bindu, A. H. (2024). ANFIS-based optimisation for achieving the maximum torque per ampere in induction motor drive with conventional PI. *International Journal of Applied*, 13(2), 320-327.
- [29] Rao, G. M., & Srikanth, G. (2018). Comparative study of maximum torque control by pi ann of induction motor. *International Journal of Applied Engineering*
- [30] Etim, I. S., Umoette A.T, and Ukommi U. S. 2024. “Comparative Performance Analysis of PID and Sliding Mode Controllers in Speed Control of Induction Motor Drives With Intermittent Loading”. *Journal of Engineering Research and Reports* 26 (10):93-106. <https://doi.org/10.9734/jerr/2024/v26i101292>