

Original Research Article

Evaluation of the Earth's Electrical Properties of the Undeveloped Area at the Delta State University of Science and Technology, Ozoro, Nigeria

ABSTRACT

The application of good electrical earthing system is inevitable in every electrical installation. This study was carried out to evaluate the earth's electrical properties of an undeveloped area of Delta State University of Science and Technology, Ozoro, Nigeria. The soil resistance of the study area was determined according to Wenner Four Point method, while the soil resistivity was calculated from the soil resistance obtained. Six locations (A, B, C, D, E and F) were tested across the area; while five probe distances (3 m, 6 m, 9 m, 12 m and 15 m) were adopted at each testing location. Results obtained from the soil test revealed that, the soil resistance and resistivity varied widely across the study area. It was observed that the northern part of the area generally had lower soil resistance and resistivity than the southern part of the study area. The soil resistance ranged between 3.2 Ω and 4.8 Ω at the northern part of the study area; while the soil resistance ranged between 5.1 Ω and 17.2 Ω at the southern part of the study area. In term of the soil resistivity, the results revealed that the northern part of the area had the lowest soil resistivity, compared to the southern part of the area. The soil resistivity ranged from 96.15 Ωm to 324.25 Ωm at the southern region of the area, while at the northern region of the area, the soil resistivity ranged from 60.33 Ωm to 90.49 Ωm . Furthermore, the result established that the northern region of the study area will be suitable for electrical earthing without any soil treatment.

Keywords: Earthing system, electrical installation, soil – treatment, soil - resistance, soil – resistivity, Wenner-Method.

INTRODUCTION

Electrical earthing is an essential component of any electrical wiring/installation system. According to Akpoyibo [1], an electrical earthing of an electrical wiring system implies an electrical connection to general mass of the earth. The earth crust acts as a reservoir for excessive electrical charges, due to its poor electrical conductivity nature; but its resistivity is influenced by the materials that makeup each earth's stratum. Earth resistivity is dependent on the soil geochemical and geotechnical properties of the location. Therefore under certain conditions (soil compaction, high moisture content, high electrical conductivity, etc.) the soil can conduct significant amount of electrical charges [2]. A good electrical earthing system must be devoid of soils with high resistance level and substandard earthing materials, which provide unsafe path for excessive current within the wired structure to the earth reservoir; hence subjecting the occupants of the structure to the risk of electrocution, damage of the electrical appliances connected to the electrical line, instrumentation errors, and/or incidence of electrical fire outbreak [3]. An effective electrical earthing system secured not only the human occupants of the structure, but also prevents damage to the electrical equipment within the structure [4]. To optimize the performance of the electrical system, the specifications of earthing materials used for any earthing (grounding) operation, must be chosen in accordance with the electrical load the building was designed to carry. Soil resistivity is the resistance between two opposing surfaces of a 1m³ cube of the soil; which is an essential factor to be considered during the design of earthing systems [5,6].

Several studies have been conducted on the state of soil resistivity at various locations, using different testing and computing methods. According to Unde and Kushare [7] weather conditions, earth rod length and depth of placement affected the soil resistivity. It was observed that the soil resistance decreased from 1.937 Ω to 1.853 Ω , as the earth rod length increased from 3 m to 9 m. Additionally, He [8] reported that raining season (soil moisture content) affected the soil resistance capacity; hence, the resistivity developed by the various soil strata affects the safety of grounding system. In freezing climatic condition, the safety of the earthing system is only guaranteed when special system designed specifications (e.g. long vertical earthing rods) are adopted. In the work of Ronda [9] on soil resistance and resistivity, they reported that soils with high resistance levels are not appropriate for an effective earthing system, without appropriate soil treatment or addition of external plates. This is because these soils can compromise the optimization of the earthing system; hence endangering the electrical installation inside the structure. Citing El-Sayed [10], the utilization of additional plates in electrical earthing system, optimize the resistance of the earthing system. This it does by allowing the current to diverge to each conductor; thus offering lower impedance within the system.

Within the past decade some researches had been carried out to determine the electrical properties of Nigeria soils. The resistance of the soils within the engineering complex, Delta State University, Oleh campus was determined [11], and the results revealed a decline in the soil resistances from 20.80 Ω to 0.64 Ω , as the probes spacing increased from 5 m to 30. Additionally, [11] reported that soil pH had significant effect on the durability of the earthing materials. Likewise, the soil resistance of the proposed school of environmental technology, the federal university of technology, Akure, Nigeria area decreased from 54 Ω to 13.9 Ω , as the probes spacing increased from 1 m to 17 m; relatively the soil resistivity declined from 1018 Ωm to 262 Ωm , as the probes spacing increased from 1 m to 17 m [12]. Furthermore, Obukoeroro [2] studied the geotechnical properties of soils samples around the school of engineering complex, Delta State Polytechnic, Ozoro, Nigeria. The authors reported that the soil resistance was greatly influenced by the soil geotechnical properties, as the soil resistance decreased from 17.2 Ω to 4.8 Ω , as the soil electrical conductivity increased from 3.09 dS/m to 5.41 dS/m. Although some literature had been recorded on the electrical properties of some soils samples within Delta state; literature search provides no recorded information on the status of the soil electrical properties, of the undeveloped area of Delta State University of Science and technology, Ozoro Nigeria. Therefore this objective of this study is to determine the resistive and resistivity of soils within the undeveloped area of Delta State University of Science and technology, Ozoro Nigeria, using the Wenner Four Point method. Results obtained from this study will be helpful in designing appropriate earthing system, for the structures that will be later sited in this area

MATERIALS AND METHODS

Study area description

The study was carried out within the premises of the Delta State University of Science and Technology, Ozoro, Nigeria. The chosen area was an undeveloped area of the school, and witnesses seasonal flooding during the peak of the rainy season. Ozoro community, where the university is sited, has two major climatic conditions, which are: the dry and rainy seasons. During the rainy season, the area witnesses bimodal rainfall distribution pattern, with mean annual rainfall of about 2500 mm [13].

The geographical locations of the location from where the earth's resistivity was tested are presented in Table 1. The locations were taken a distance of 200 m from each other; hence the total area cover in this study was 80,000 m² (8 hectares). Schematic view of the study area, and the position from the earth resistance was taken is presented in Figure 1. The soil type within the study area is mainly alluvial, and the thick vegetation cover was very dense, apart from its southern that was cleared for road construction.

Table 1: GPS co-ordinate of the test locations

Test location	GPS co-ordinate	Remark
A	5.562 N, 6.246 E	Little vegetation cover and close to the main road
B	5.562 N, 6.248 E	Little vegetation cover and close to the main road
C	5.563 N, 6.249 E	Thick vegetation cover
D	5.564 N, 6.246 E	Thick vegetation cover
E	5.563 N, 6.248 E	Thick vegetation cover
F	5.564 N, 6.249 E	Thick vegetation cover

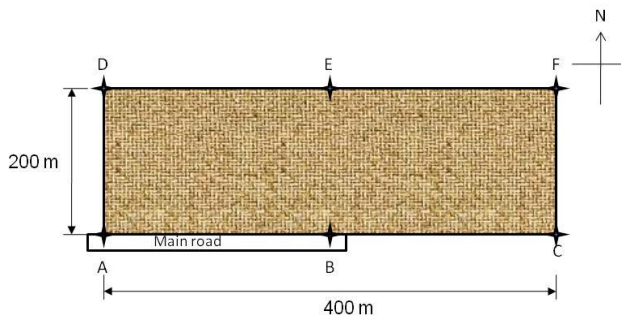


Figure 1: Schematic diagram of the testing locations

Particle size grading

From each test location 1 kg of the soil was uniformly collected across the depth of 1 m. This soil was air-dried in the laboratory under ambient temperature. The sieve analysis of the dried soil was carried on in accordance with NIS-87 standard recommendation, as described by [14]. Then the textural nature of the soil sample was read from the textural triangle.

Earth's resistance testing method

The Wenner Four Point method was adopted for this research work. Four probes are driven at an equal distance apart into the soil, at each testing spot in a straight line. The distance between two probes was taken as "a", while the depth at which each probe was driven into the soil was taken as "b". During the earth's resistance determination, the voltmeter is used to measure the voltage between the two potential probes (electrodes); while the current between the two outer probes was measured with the aid of the ammeter. The schematic view of the experimental setup is presented in Figure 2. This research was carried during the beginning of rainy season (April, 2020), when the soil was not fully saturated with water.

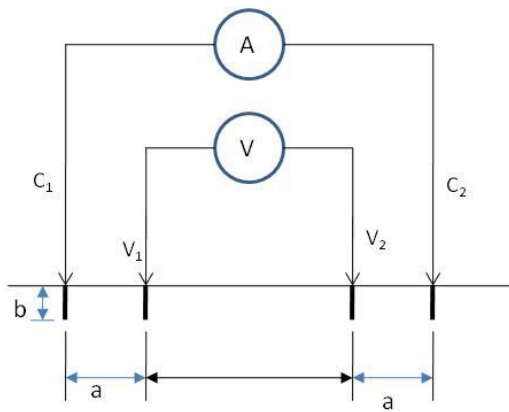


Figure 2: A schematic view of the experimental setup

At each testing location, the GPS co-ordinates of the place were taken and the values recorded accordingly. Then the probes were driven into the soil at a depth “b” of 0.5m, according to a predefined spacing order. Five distances (3 m, 6 m, 9 m, 12 m and 15 m) between the probes were adopted for this study. The connections were secured before the earth’s resistivity meter was turned on. As the meter was powered on, current passes between the C₁ and C₂ terminals; while the resulting voltage in the experimental setup was measured between the V₁ and V₂ terminals, with the aid of the voltmeter [2,15].

From the current “I” and voltage “V” values obtained from the experimental setup, the earth’s resistance can be calculated using equation 1 [15].

$$R = \frac{V}{I} \quad 1$$

Where:

R = resistance (Ω),

V = potential difference across the conductor (V),

I = current flowing through the conductor (A).

Then the earth resistivity (ρ) was calculated from the calculated resistance and the distance of the probe spacing, as given in Equations 2 and 3 [24].

$$\rho = 2\pi a \frac{V}{I} \quad 2$$

Then substituting $\frac{V}{I}$ for “R” in Equation 2, the resistivity becomes:

$$\rho = 2\pi a R \quad 3$$

Where:

ρ = Resistivity (Ωm)

a = Probe spacing (m)

V = Voltage measured (V)

I = applied current (A)

R = Measured resistance (Ω)

Data analysis

The obtained data were statistically analyzed using the MS Excel 2015 (Microsoft Corporation Redmond, WA 98052). The mean results were plotted by using Microsoft Excel.

RESULTS AND DISCUSSION

Particle size distribution

The results of the particle sieve analysis which were read from the textural triangle are presented in Table 2. As shown in Table 2, area is dominated with clay (fine particles) soil. At Location A, the soil texture was sandy clay; then at Location B, the soil texture was sandy clay loam nature; while at Location C, the soil texture was also sandy clay loam nature. Similarly, Locations D, E and F soil textures were clay, clay and sandy clay, respectively. The relative fine soil particles found in this area, will have significant effect on the soil resistance and resistivity. Previous researchers [16, 17] reported that as fine grain soils (clay) tend to have lower soil resistance and resistivity, compared to their coarse grain counterpart soils.

Table 2: Particle size distribution of the soil particles

Spatial Location	Soil texture
Location A	Sandy Clay
Location B	Sandy Clay Loam
Location C	Sandy Clay Loam
Location D	Clay
Location E	Clay
Location F	Sandy Clay

Earth's resistance

Results obtained from the earth's resistance test are presented in Figures 3 to 8. As presented in the results, the earth's resistance varied across the study area. Regardless of the testing location, the earth's resistances decrease as the probe distance increased from 3 m to 15 m. The results revealed Location B had the highest soil resistance, irrespective of the probe distance; while Location E had the lowest soil resistance, irrespective of the probe distance. As seen in the results the southern part (Locations A, B and C) of the area generally had higher soil resistance, compared to the northern part (Locations D, E and F) of the study area. The high soil resistance recorded at location A and B, could be attributed to the road compaction, little vegetation cover and probably the soil texture and moisture. Soil with high compaction and coarse texture tends to have higher soil resistance, compared to its counterpart with poor compaction and fine texture [18]. As seen in Location B (Figure 4), the soil resistance decreases from 18.4 Ω to 8.5 Ω as the probe distance increased from 3 m to 12 m; but then increased from 8.5 Ω to 10.2 Ω , as the probe distance increased from 12 m to 15 m. This irregularity could be attributed to the variation in the soil geotechnical properties, along the testing area [2]. Similar results were obtained by [12], where the soil resistance at some locations at the Federal University of Technology, Akure, Nigeria fluctuated with increased in the probe distance.

As seen in the results, apart from Locations A and B, the other Locations are ideal for electrical earthing, without special soil conditioning, due to their poor (low) soil resistance. Idoniboyeobu [19] reported that soils with low soil resistance (about 5 Ω) are good for

earthing system; since soils with low resistance are good conductor, which facilitate easy discharge of the excessive charges into the earth reservoir. The Nigerian Electricity Management Services Agency (NEMSA) prescribes the maximum earth resistance of 2.0Ω as recommended value for earthing of structures within the country. While the Institute of Electrical and Electronics Engineers (IEEE) and National Electric Code (NEC), prescribe the maximum earth resistance of 5.0Ω [20].

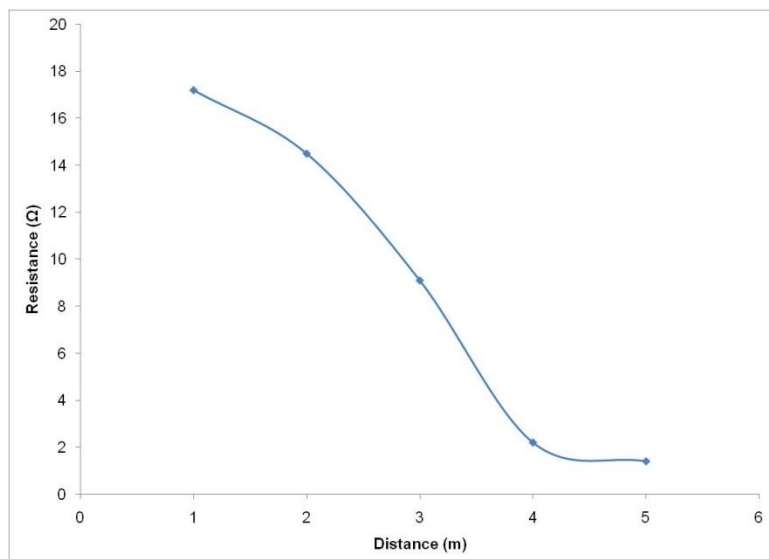


Figure 3: Soil resistance at Location A

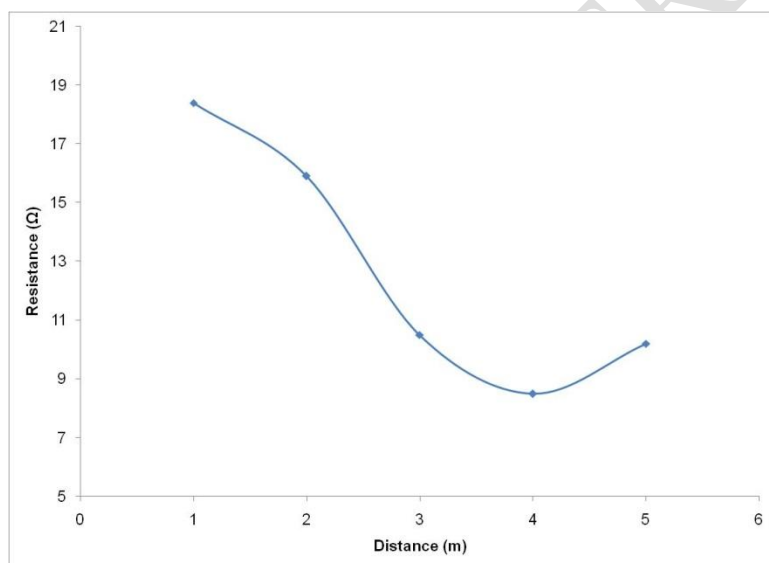


Figure 4: Soil resistance at Location B

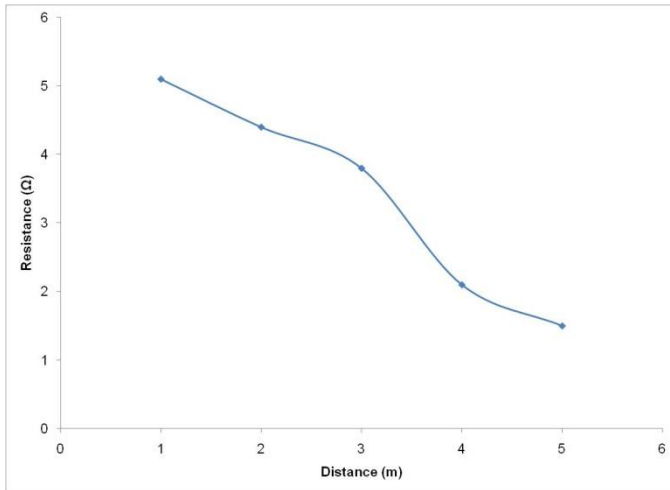


Figure 5: Soil resistance at Location C

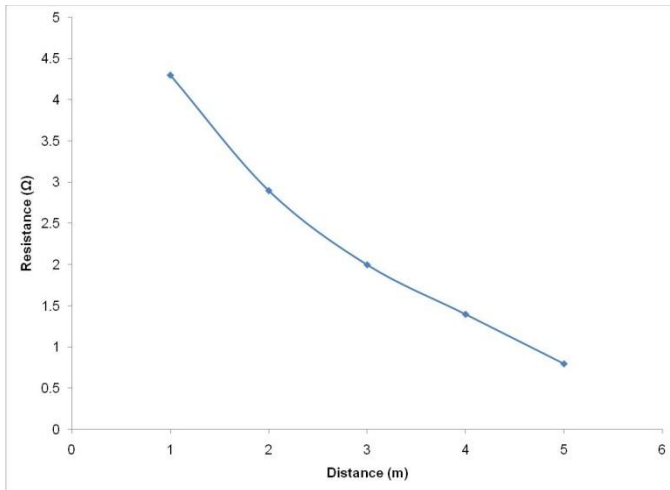


Figure 6: Soil resistance at Location D

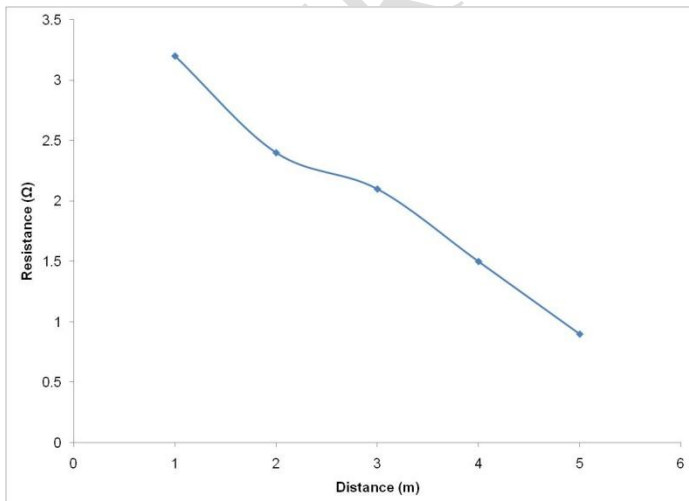


Figure 7: Soil resistance at Location E

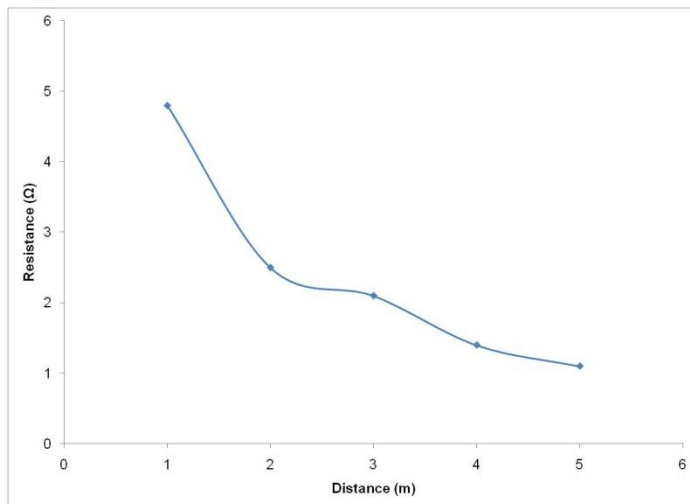


Figure 8: Soil resistance at Location F

Soil resistivity

The results of the soil resistivity are presented in Table 3. From the analysis of the results shown in Table 3, it can be seen that Locations A and B had the highest soil resistivity, while Locations D and E had the lowest soil resistivity, irrespective of the testing location. The lower soil resistivity recorded at Locations A and B, could be attributed to the fine nature of the soil grains (Table 2). Fine grain soils tend to have lower resistance and resistivity than large grain soils. Hence, sandy clay soil will tend to have lower soil resistance and resistivity, when compared to stony soil [12, 21].

It was also observed from the results (Table 3) that the soil resistivity generally increased as the probe spacing increase between 3 m and 9 m; whereas, as the probe spacing increased from 9 m and 15 m, the soil resistivity declined respectively at Location A, B, D, E and F. These variations could be attributed to the geotechnical and geochemical properties of the soils. Siow [22] states that fine soil texture, high moisture content and high soil electrical conductivity can lower the soil resistivity, at a particular location. Similar results were obtained by [11, 12], when the values of the soil resistivity fluctuated with increased in the probe distance, at some testing locations at Ondo and Delta States of Nigeria, respectively.

From the results, it can be seen that apart from Locations A and C, the other locations are ideal for electrical earthing, without special soil treatment, due to their superior electrical properties. According to Gabriel [23], soil resistivity is a key component, which is used to evaluate the resistance of the charging electrode will be, and the depth the earth rod must be buried into the ground in order to achieve an ideal low earth resistance. Hence, soils with low resistivity are chosen over soil with high resistivity.

Table 3: Soil resistivity at different location and spacing

Spatial point	Soil resistance (Ωm)				
	3 m apart	6 m apart	9 m apart	12 m apart	15 m apart
Location A	324.25	546.71	514.66	165.90	131.96
Location B	346.88	599.49	593.84	640.97	961.45
Location C	96.15	165.90	214.91	158.36	141.39
Location D	81.06	109.34	113.11	105.57	75.41
Location E	60.33	90.49	118.77	113.11	84.83
Location F	90.49	94.26	118.77	105.57	103.69

CONCLUSION

The study was done to evaluate the electrical properties (soil resistance and soil resistivity) of an undeveloped area of Delta State University of Science and Technology. The soil resistance of the area was tested by using the Wenner Four Point procedure, at six different spatial locations within the study area. The soil resistivity was calculated from the values of the soil resistance obtained. Results obtained revealed that the soil resistance and resistivity varied greatly across the study area. The soils located at the northern parts of the area had the lowest soil resistance and resistivity, when compared the soils situated at the southern part of the study area. The soil with the highest resistance and resistivity was found at Location B, while the soil with the lowest resistance and resistivity was located at Location E. This study results revealed that the soils located at the northern part of the study area are ideal for electrical earthing, without special soil treatment. This is because the soil resistance is fairly within the range approved Institute of Electrical and Electronics Engineers and National Electric Code.

REFERENCES

1. Akpoyibo FE. *Earthing arrangements*, in: Nigerian Institution of Electrical & Electronics Engineers' International Conference-ICEPT. 2014;1–6.
2. Obukoeroro J, Uguru HE. Evaluating the geotechnical and electrical properties of soil samples around Delta State Polytechnic, Ozoro, Nigeria. *Applied Journal of Physical Science*. 2021; 3(1):21-27.
3. Salam M, Rahman QM, Ang SP, Wen F. Soil resistivity and ground resistance for dry and wet soil. *J. Mod. Power Syst. Clean Energy*. 2015;1-8
4. Obukoeroro J, Uguru HE. Appraisal of electrical wiring and installations status in Isoko area of Delta State, Nigeria. *Journal of Physical Science and Environmental Studies*. 2021;7 (1):1-8
5. Cronshaw G. Earthing: IEE Wiring Matters. 2005. Available online at: <https://www.ee.iitb.ac.in/course/~emlab/assets/earthing.pdf> (Retrieved 10 June 2021).
6. Omar FM. Obtaining chemical properties through soil electrical resistivity. *Journal of Civil Engineering Research*, 2012; 2(6): 120-128
7. Unde MG, Kushare BE. Grounding grid performance of substation in two layer soil - a parametric analysis. *International Journal of Engineering Sciences & Emerging Technologies*. 2012; 1(2): 69-76
8. He JL, Zeng R, Gao YQ, Tu Y, Sun W, Zou J, Guan Z. Seasonal influence on safety of substation grounding system. *IEEE Transactions on Power Delivery*. 2003; 18(3):788–795

9. Ronda S, Oliver C, Martinez O, Marquez P, Miranda JM. Applying electromagnetic field analysis to minimize the earth resistance on high resistivity soils. 2020; *Progress In Electromagnetics Research*. 96: 157–167.
10. El-Sayed GO. *Design Parameters of Electrical Network Grounding Systems*, IGI Global. 2018.
11. Oyubu AO. Soil resistivity and soil pH profile investigation: A case study of Delta State university faculty of engineering complex. *International Journal of Scientific & Engineering Research*, 2015; 6(10): 583 – 589
12. Oyeleye MO, Makanju TD. Soil resistivity adequacy assessments: Case study of proposed school of environmental technology building federal university of technology, Akure. *European Journal of Engineering Research and Science*. 2020; 4(2): 1-6
13. Eboibi O, Akpokodje OI, Uguru H. Growth performance of five bean (*Phaseolus spp*) varieties as influenced by organic amendment. *J. Appl. Sci. Environ. Manage.* 2018; 22(5): 759 – 763
14. Agbi GG, Akpokodje OI, Uguru H. Compressive strength of commercially produced sandcrete blocks within Isoko metropolis of Delta State, Nigeria. *Turkish Journal of Agricultural Engineering Research (TURKAGER)*, 2020; 1(1): 91-103.
15. Oyeleye MO, Ale TO. Foundational steel reinforcement earthing evaluation case of Ogomudia electrical and electronics laboratory building extension, federal university of technology Akure. Federal university of technology Akure. *Journal of engineering and engineering Technology*. 2019; 13: 96-102.
16. Akwukwaegbu IO, Gerald O. Soil resistivity measurement and evaluation for power system earthing a case study of radio Nigeria Pacesetter F.M Umuahia Nigeria. *US Open Science & Technology Journal*. 2017; 1(1): 1-9
17. Kalinski RJ, Kelly WE. Estimating water content of soils from electrical resistivity. *Geotechnical Testing Journal*, 1993; 16(3): 323-329
18. Seladji S, Cosenza P, Tabbagh A, Ranger J, Richard G. The effect of compaction on soil electrical resistivity: a laboratory investigation. *European Journal of Soil Science*. 2010; 1-10
19. Idoniboyeobu DC, Bala TK, Okekem E. Assessment and evaluation of soil effect on electrical earth resistance: A case study of Woji area, Port-Harcourt, Nigeria. *International Journal of Engineering and Technical Research (IJETR)*. 2018; 8(6):83-94
20. Omorogiuwa OS, Fayose O. Performance evaluation of the earthing system in Ambrose Alli University, Ekpoma, Nigeria. *Advances in Electrical and Telecommunication Engineering*, 2018; 1(2): 93-98
21. Telford WM, Geldart LP, Sheri RE. *Applied Geophysics* (Second Edition). Cambridge University Press. 1990.
22. Siow CL, Chandima G, Zainal M, Kadir A. Electrical earthing in troubled environment. *International Journal of Electrical Power & Energy Systems*. 2013; 47,117-128.
23. Gabriel A, Kehinde O. Assessment of soil resistivity on grounding of electrical systems a case study of north east zone, Nigeria. *J. Acad. Appl. Stud.* 2011; 28-38
24. Southey RD, Dawalibic FP. Improving the reliability of power systems with more accurate grounding systems resistance estimates. *Safe engineering*. 2005. Available online at: https://www.sestech.com/pdf/161_short%20pin%20spacing%20paper.pdf (Retrieved 10 January 2021).